


3" MIN. - 8" MAX. OF ADJUSTING RINGS SHALL BE ALLOWED UNLESS NOTED IN PLAN SET

R-3067 (TYPICAL)

SEALING OF RINGS SHALL BE PER STANDARD DETAIL DRAWING 5.7.7

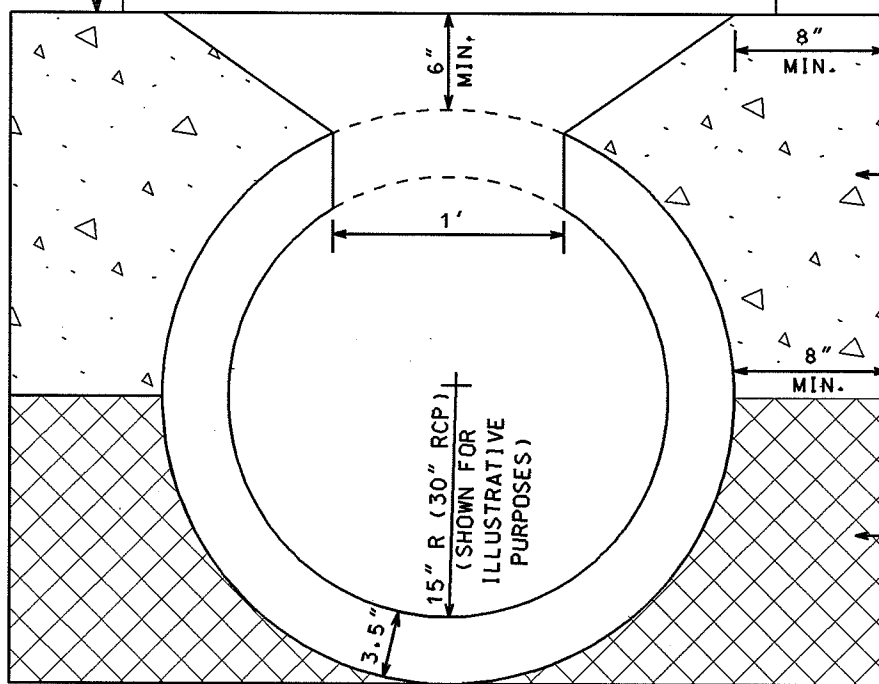

MONOLITHIC CONCRETE

GRANULAR BACKFILL

TO BE USED ON PIPES OR BOXES WHERE THE O.D. OF THE THROUGH PIPE IS LESS THAN OR EQUAL TO 4'-4".

2004

CITY OF MADISON  
ENGINEERING DIVISION

MADISON STANDARD  
SADDLED INLET  
TYPE I

STANDARD DETAIL DRAWING 5.7.8