


Well 26 Influence Zone 2/19/2019

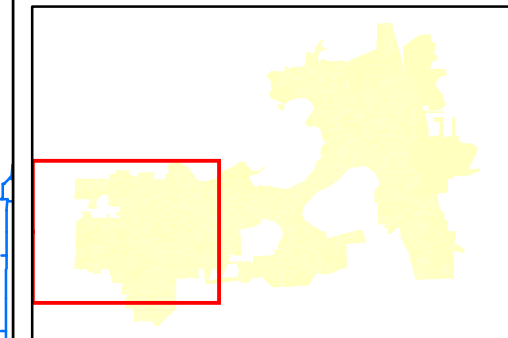

Legend

- Unit Well
- Water Main
- Pressure Zone Boundary

Well Source %


- 80 - 100
- 60 - 80
- 40 - 60
- 20 - 40
- 10 - 20
- 5 - 10
- 1 - 5



NOT TO SCALE



Disclaimer: The City of Madison makes no representation about the accuracy or completeness of these records and in no event shall the City be liable for any damages whatsoever resulting from the use of these records.
This information will be updated every three to five years, or as necessary, to reflect general changes in operating conditions, such as the development of new water sources and the abandonment of older ones.

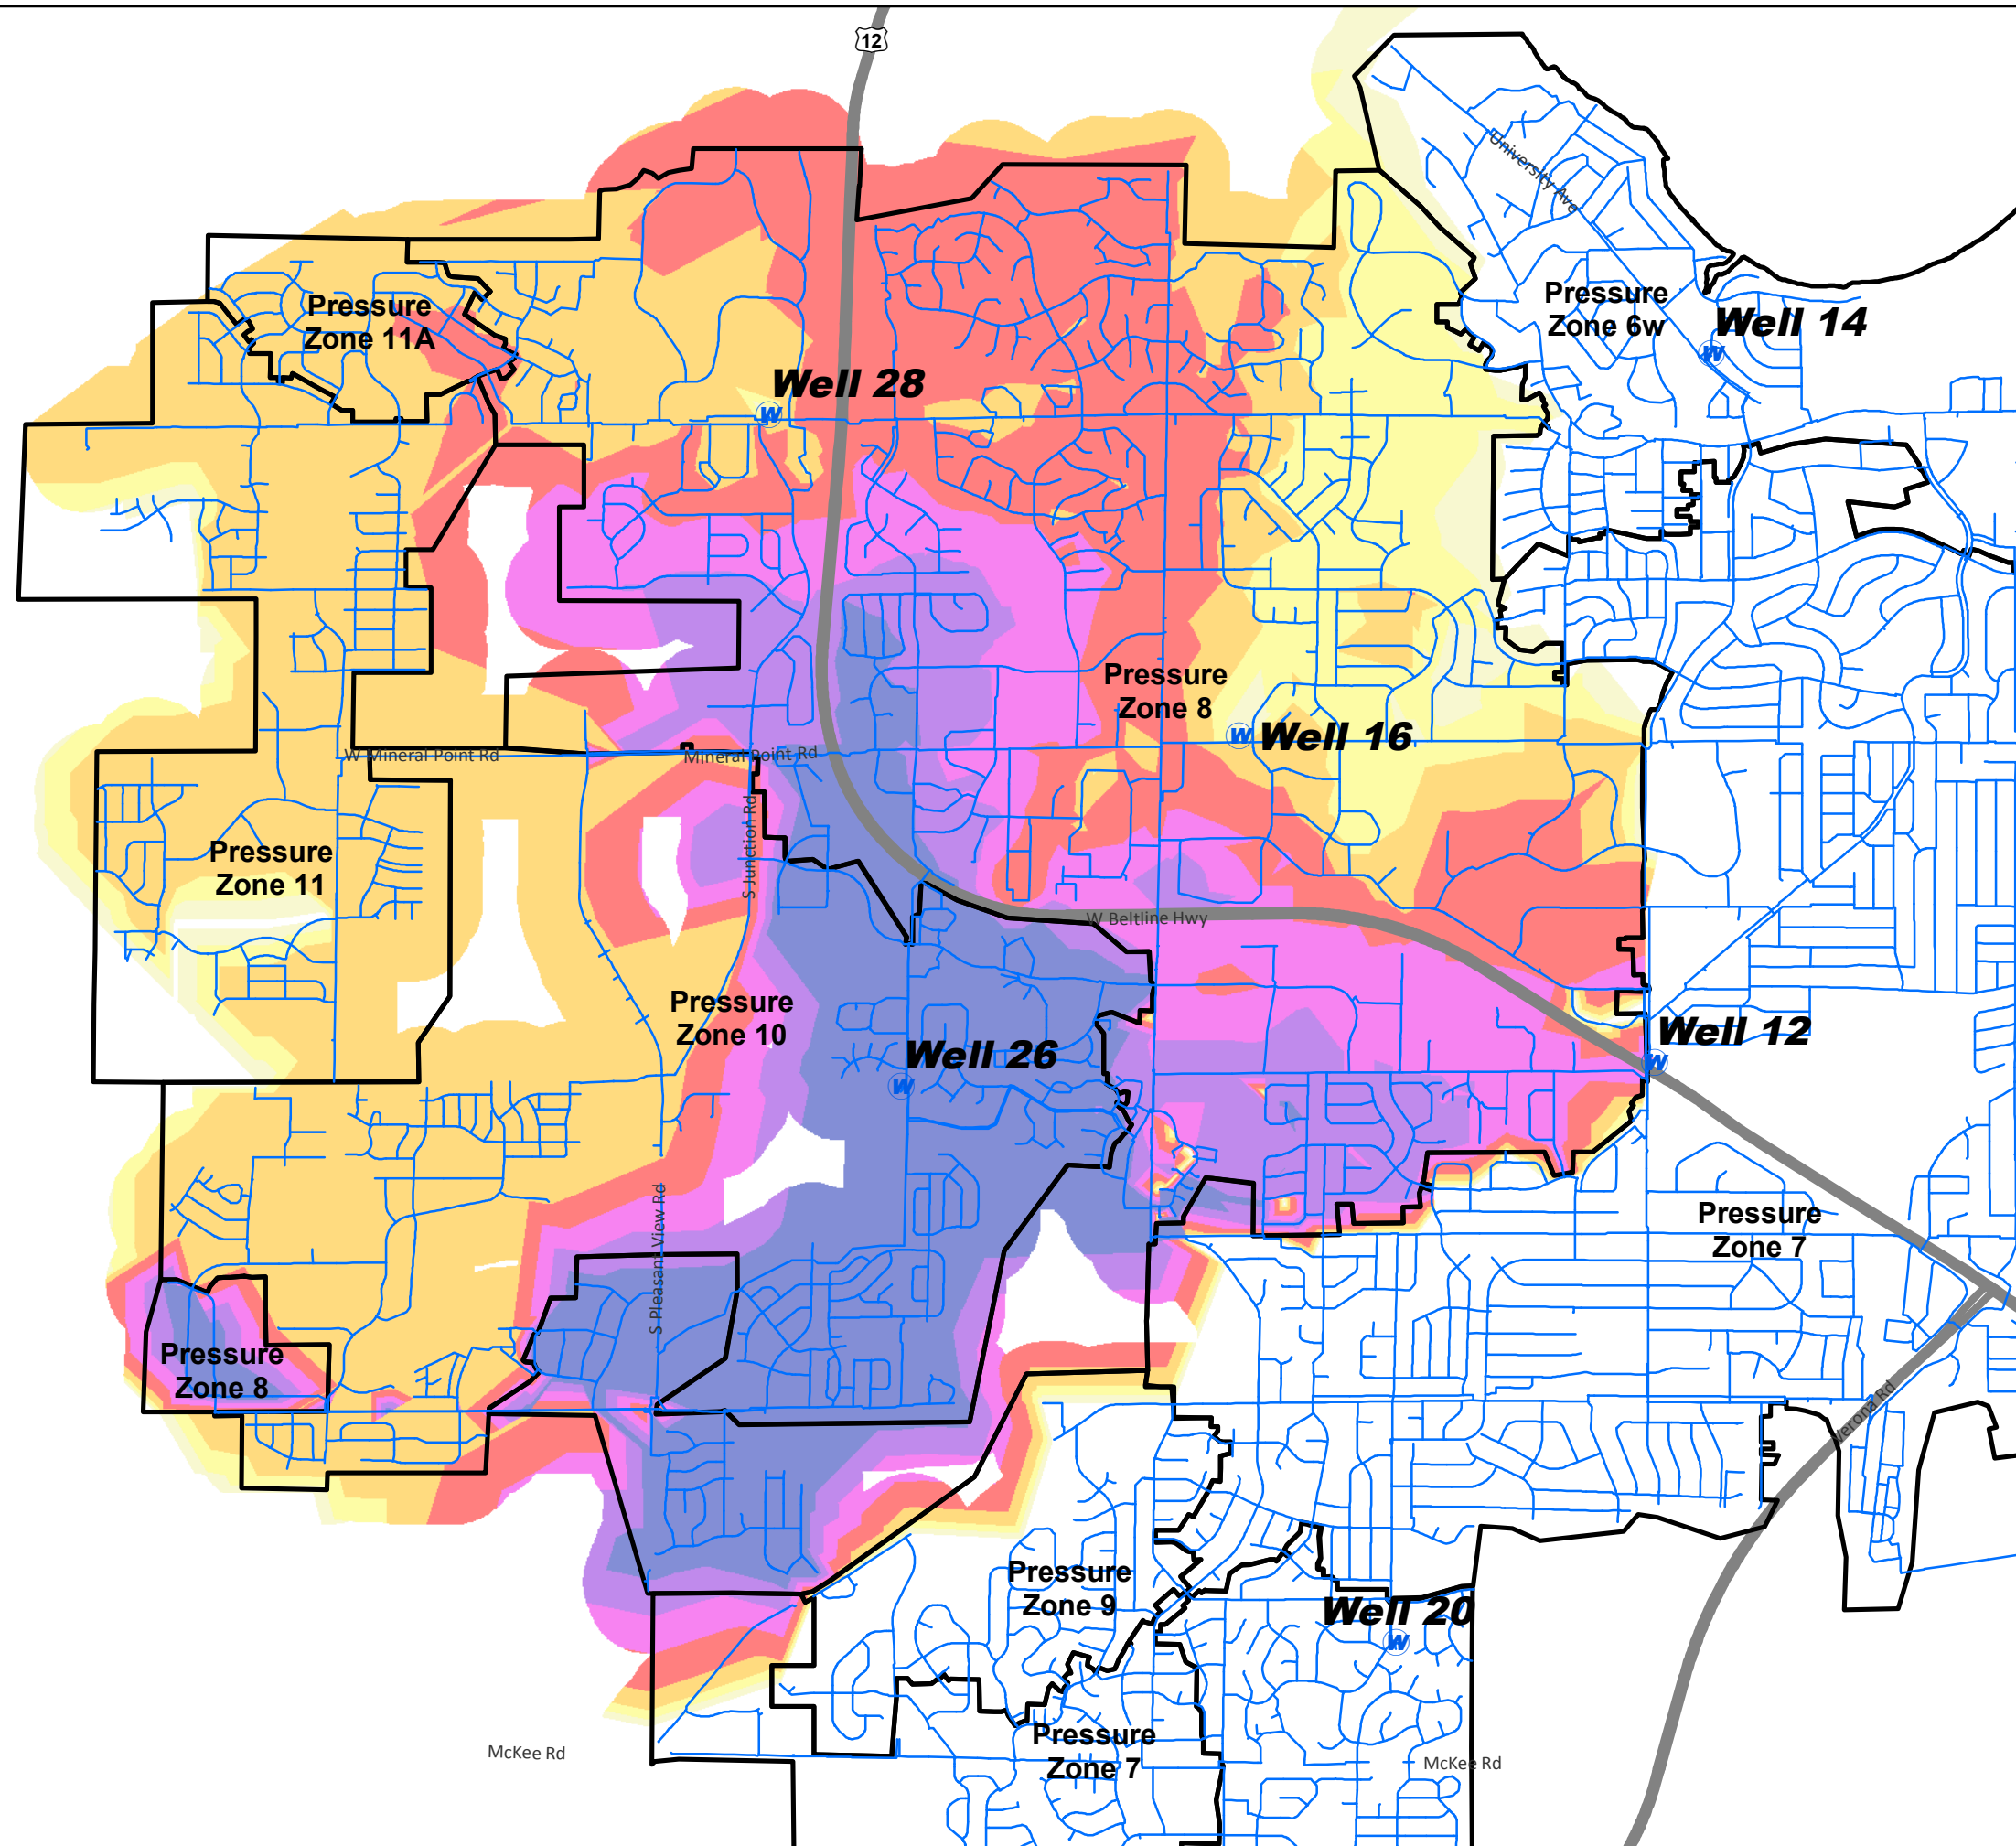

W Mineral Point Rd

McKee Rd

McKee Rd