



Legend

● Denotes Boring Location



Notes

1. Soil Borings performed by America's Drilling Co. (B3-B7) in Sept 2022 or Badger State Drilling (B1 & B2) in May 2017
2. Boring locations are approximate

Scale: Reduced

Date: 10/2022	
Job No. C22051-16	

**Soil Boring Location Map
Segoe Road and Sheboygan Avenue
Madison, WI**



LOG OF TEST BORING

Project Sheboygan Avenue
535'E of Eau Claire, 15'S of Centerline
 Location Madison, Wisconsin

Boring No. 1
 Surface Elevation (ft) 945±
 Job No. C22051-16
 Sheet 1 of 1

2921 Perry Street, Madison, WI 53713 (608) 288-4100, FAX (608) 288-7887

SAMPLE					VISUAL CLASSIFICATION and Remarks	SOIL PROPERTIES				
No.	Rec (in.)	Moist	N	Depth (ft)		qu (qa) (tsf)	w	LL	PL	LOI
					X	6 in. Asphalt Pavement/7 in. Base Course				
1	10	M	12		/	Stiff, Brown Lean CLAY (CL)				
					.	Medium Dense to Dense, Brown Fine to Medium SAND, Some Silt and Gravel, Scattered Cobbles and Boulders (SM)				
2	8	M	13							
				5						
3	16	M	15							
				10						
4	18	M	13							
5	4	M	44							
				15		End of Boring at 15 ft				
						Borehole backfilled with bentonite chips and asphalt patch				
				20						

WATER LEVEL OBSERVATIONS

GENERAL NOTES

While Drilling NW Upon Completion of Drilling _____
 Time After Drilling _____
 Depth to Water _____
 Depth to Cave in _____

Start 5/17/17 End 5/17/17
 Driller BSD Chief MC Rig CME-55
 Logger DB Editor ESF
 Drill Method 2-1/4" HSA; Autohammer

The stratification lines represent the approximate boundary between soil types and the transition may be gradual.



LOG OF TEST BORING

Project Sheboygan Avenue
325'W of Segoe, 15'S of Centerline
 Location Madison, Wisconsin

Boring No. 2
 Surface Elevation (ft) 947±
 Job No. C22051-16
 Sheet 1 of 1

2921 Perry Street, Madison, WI 53713 (608) 288-4100, FAX (608) 288-7887

SAMPLE					VISUAL CLASSIFICATION and Remarks	SOIL PROPERTIES				
No.	TYPE	Rec (in.)	Moist	N		Depth (ft)	qu (qa) (tsf)	W	LL	PL
					5 in. Asphalt Pavement/6 in. Base Course					
1	AS	0	M	9	FILL: Loose, Brown Fine to Medium Sand Mixed with Silt, Gravel and Clay					
2		10	M	8						
3		6	M	21	Weathered to Competent, Light Tan, Orange and White Probable Sandstone BEDROCK					
4		12	M	23	Firm Drilling Noted Beginning Near 12 ft					
5		8	M	68/12'	End of Boring at 15 ft Borehole backfilled with bentonite chips and asphalt patch					

WATER LEVEL OBSERVATIONS

GENERAL NOTES

While Drilling NW Upon Completion of Drilling _____
 Time After Drilling _____
 Depth to Water _____
 Depth to Cave in _____

Start 5/17/17 End 5/17/17
 Driller BSD Chief MC Rig CME-55
 Logger DB Editor ESF
 Drill Method 2-1/4" HSA; Autohammer

The stratification lines represent the approximate boundary between soil types and the transition may be gradual.



LOG OF TEST BORING

Project Segoe Road
200'S of University, 35'E of Centerline
 Location Madison, Wisconsin

Boring No. 3
 Surface Elevation (ft) 939±
 Job No. C22051-16
 Sheet 1 of 1

2921 Perry Street, Madison, WI 53713 (608) 288-4100, FAX (608) 288-7887

SAMPLE					VISUAL CLASSIFICATION and Remarks	SOIL PROPERTIES				
No.	Rec (in.)	Moist	N	Depth (ft)		qu (qa) (tsf)	W	LL	PL	LOI
					X	4 in. Asphalt Pavement/7 in. Base Course				
1	10	M	22		█	FILL: Medium Dense Brown Sand with Silt, Gravel and Scattered Cobbles				
					█					
2	16	M	19		█					
				5	█					
3	18	M	24		█					
					█					
4	8	M	58/9"		█	Very Dense/Rough Drilling Near 9 ft (Presumed Large Cobble or Boulder)				
				10	█					
5	16	M	37		█	Dense, Brown Fine to Medium SAND, Some Silt and Gravel, Scattered Cobbles and Boulders (SM)				
					█					
6	18	M	37		█					
				15	█	End of Boring at 15 ft				
					█	Borehole backfilled with bentonite chips and asphalt patch				
				20	█					

WATER LEVEL OBSERVATIONS

GENERAL NOTES

While Drilling NW Upon Completion of Drilling _____
 Time After Drilling _____
 Depth to Water _____
 Depth to Cave in _____

Start 9/26/22 End 9/26/22
 Driller ADC Chief KD Rig CME-55
 Logger DB Editor ESF
 Drill Method 2-1/4" HSA; Autohammer

The stratification lines represent the approximate boundary between soil types and the transition may be gradual.



LOG OF TEST BORING

Project Segoe Road
90'S of Frey, 35'E of Centerline
 Location Madison, Wisconsin

Boring No. 4
 Surface Elevation (ft) 948±
 Job No. C22051-16
 Sheet 1 of 1

2921 Perry Street, Madison, WI 53713 (608) 288-4100, FAX (608) 288-7887

SAMPLE					VISUAL CLASSIFICATION and Remarks	SOIL PROPERTIES					
No.	TYPE	Rec (in.)	Moist	N		Depth (ft)	qu (qa) (tsf)	w	LL	PL	LOI
					0						
1	█	14	M	20	0-4	4 in. Asphalt Pavement/6 in. Base Course					
					4	Very Stiff, Brown Lean CLAY, Trace Sand and Gravel (CL - Possible Fill)	(2.5)				
					8	Loose, Brown Clayey Fine SAND (SC - Possible Fill)					
2	█	10	M	8	8-10	Medium Dense to Very Dense, Brown Fine to Medium SAND, Some Silt and Gravel, Scattered Cobbles and Boulders (SM)					
					10	End of Boring at 11.5 ft due to auger refusal on boulder or possible bedrock					
3	█	0	-	50/3"	10-11.5	Borehole backfilled with bentonite chips and asphalt patch					
					12						
4	█	14	M	12	12-15						
					15						
5	█	0	-	50/1"	15-20						

WATER LEVEL OBSERVATIONS

GENERAL NOTES

While Drilling NW Upon Completion of Drilling _____
 Time After Drilling _____
 Depth to Water _____
 Depth to Cave in _____

Start 9/27/22 End 9/27/22
 Driller ADC Chief KD Rig CME-55
 Logger DB Editor ESF
 Drill Method 2-1/4" HSA; Autohammer

The stratification lines represent the approximate boundary between soil types and the transition may be gradual.



LOG OF TEST BORING

Project Segoe Road
140' SE of Sheboygan, 40' NE of Centerline
 Location Madison, Wisconsin

Boring No. 5
 Surface Elevation (ft) 936±
 Job No. C22051-16
 Sheet 1 of 1

2921 Perry Street, Madison, WI 53713 (608) 288-4100, FAX (608) 288-7887

SAMPLE					VISUAL CLASSIFICATION and Remarks	SOIL PROPERTIES				
No.	Type	Rec (in.)	Moist	N		Depth (ft)	q _u (qa) (tsf)	W	LL	PL
					5	5 in. Asphalt Pavement/5.5 in. Base Course				
1	█	16	M	14	5-14	FILL: Medium Dense Brown Sand with Silt, Gravel and Scattered Cobbles				
2	█	14	M	18	14-18	Medium Dense to Very Dense, Light Brown Fine to Coarse SAND, Some Gravel, Trace to Little Silt (SP/SP-SM - Possible Fill)				
3	█	10	M	68/ 10"	18-26	Dense to Medium Dense, Brown Fine to Medium SAND, Some Silt and Gravel, Scattered Cobbles and Boulders (SM)				
4	█	14	M	37	26-37					
5	█	16	M	26	37-43					
6	█	18	M	26	43-49					
					15	End of Boring at 15 ft				
					15-20	Borehole backfilled with bentonite chips and asphalt patch				

WATER LEVEL OBSERVATIONS

GENERAL NOTES

While Drilling NW Upon Completion of Drilling _____
 Time After Drilling _____
 Depth to Water _____
 Depth to Cave in _____

Start 9/27/22 End 9/27/22
 Driller ADC Chief KD Rig CME-55
 Logger DB Editor ESF
 Drill Method 2-1/4" HSA; Autohammer

The stratification lines represent the approximate boundary between soil types and the transition may be gradual.



LOG OF TEST BORING

Project Segoe Road
435' SE of Sawyer, 35' SW of Centerline
 Location Madison, Wisconsin

Boring No. 6
 Surface Elevation (ft) 917±
 Job No. C22051-16
 Sheet 1 of 1

2921 Perry Street, Madison, WI 53713 (608) 288-4100, FAX (608) 288-7887

SAMPLE					VISUAL CLASSIFICATION and Remarks	SOIL PROPERTIES				
No.	TYPE	Rec (in.)	Moist	N		Depth (ft)	q _u (qa) (tsf)	w	LL	PL
					5.5 in. Asphalt Pavement/7 in. Base Course					
1	█	8	M	4	FILL: Medium Stiff to Stiff Brown Clay with Sand and Gravel	(1.0)				
2	█	10	M	3	Medium Stiff, Brown Lean CLAY (CL - Possible Fill)	(0.75)				
3	█	12	M	26	Medium Dense, Red and Brown Fine to Coarse SAND and GRAVEL, Some Silt (SM/GM - Possible Fill)					
4	█	12	M	58/8"	Weathered to Competent, Reddish-Brown, White and Tan Sandstone Bedrock					
5	█	3	-	50/3"						
6	█	2	-	50/2"						
					End of Boring at 15 ft					
					Borehole backfilled with bentonite chips and asphalt patch					

WATER LEVEL OBSERVATIONS					GENERAL NOTES				
While Drilling	<input checked="" type="checkbox"/>	NW	Upon Completion of Drilling	<input type="checkbox"/>	Start	9/26/22	End	9/26/22	
Time After Drilling					Driller	ADC	Chief	KD	Rig CME-55
Depth to Water				<input checked="" type="checkbox"/>	Logger	DB	Editor	ESF	
Depth to Cave in					Drill Method	2-1/4" HSA; Autohammer			
The stratification lines represent the approximate boundary between soil types and the transition may be gradual.									



LOG OF TEST BORING

Project Segoe Road
120'S of Vernon, 35'E of Centerline
 Location Madison, Wisconsin

Boring No. 7
 Surface Elevation (ft) 902±
 Job No. C22051-16
 Sheet 1 of 1

2921 Perry Street, Madison, WI 53713 (608) 288-4100, FAX (608) 288-7887

SAMPLE					VISUAL CLASSIFICATION and Remarks	SOIL PROPERTIES				
No.	TYPE	Rec (in.)	Moist	N		Depth (ft)	qu (qa) (tsf)	W	LL	PL
					0					
					0	6.5 in. Asphalt Pavement/5 in. Base Course				
1	█	8	M	4	0	Stiff to Soft, Brown Lean CLAY (CL) (Possible Fill to 2 ft)				
					5					
2	█	14	M	5	5	(1.5)				
					10					
3	█	14	M	5	10	(1.0)				
					15					
4	█	18	M	10	15	Becoming Sandy Near 6 ft				
					20					
5	█	8	M	65/ 11"	20	Loose to Medium Dense, Brown Fine to Medium SAND, Some Silt, Trace to Little Clay (SM)				
					25					
6	█	8	M	35	25	Very Dense to Dense, Brown Fine to Medium SAND, Some Silt and Gravel, Scattered Cobbles and Boulders (SM)				
					30					
					35	End of Boring at 15 ft				
					40	Borehole backfilled with bentonite chips and asphalt patch				
					45					
					50					
					55					
					60					
					65					
					70					
					75					
					80					
					85					
					90					
					95					
					100					

WATER LEVEL OBSERVATIONS	GENERAL NOTES
While Drilling <input checked="" type="checkbox"/> NW Upon Completion of Drilling _____ Time After Drilling _____ Depth to Water _____ Depth to Cave in _____	Start <u>9/27/22</u> End <u>9/27/22</u> Driller <u>ADC</u> Chief <u>KD</u> Rig <u>CME-55</u> Logger <u>DB</u> Editor <u>ESF</u> Drill Method <u>2-1/4" HSA; Autohammer</u>
The stratification lines represent the approximate boundary between soil types and the transition may be gradual.	

LOG OF TEST BORING
General Notes

DESCRIPTIVE SOIL CLASSIFICATION

Grain Size Terminology

Soil Fraction	Particle Size	U.S. Standard Sieve Size
Boulders	Larger than 12"	Larger than 12"
Cobbles	3" to 12"	3" to 12"
Gravel: Coarse.....	¾" to 3"	¾" to 3"
Fine	4.76 mm to ¾"	#4 to ¾"
Sand: Coarse.....	2.00 mm to 4.76 mm.....	#10 to #4
Medium	0.42 to mm to 2.00 mm	#40 to #10
Fine	0.074 mm to 0.42 mm.....	#200 to #40
Silt.....	0.005 mm to 0.074 mm.....	Smaller than #200
Clay.....	Smaller than 0.005 mm.....	Smaller than #200

Plasticity characteristics differentiate between silt and clay.

General Terminology

Physical Characteristics
 Color, moisture, grain shape, fineness, etc.
Major Constituents
 Clay, silt, sand, gravel
Structure
 Laminated, varved, fibrous, stratified,
 cemented, fissured, etc.
Geologic Origin
 Glacial, alluvial, eolian, residual, etc.

Relative Density

Term	"N" Value
Very Loose.....	0 - 4
Loose.....	4 - 10
Medium Dense.....	10 - 30
Dense.....	30 - 50
Very Dense.....	Over 50

Relative Proportions Of Cohesionless Soils

Proportional Term	Defining Range by Percentage of Weight
Trace.....	0% - 5%
Little.....	5% - 12%
Some.....	12% - 35%
And	35% - 50%

Consistency

Term	q _u -tons/sq. ft
Very Soft.....	0.0 to 0.25
Soft.....	0.25 to 0.50
Medium.....	0.50 to 1.0
Stiff.....	1.0 to 2.0
Very Stiff.....	2.0 to 4.0
Hard.....	Over 4.0

Organic Content by Combustion Method

Soil Description	Loss on Ignition
Non Organic.....	Less than 4%
Organic Silt/Clay.....	4 - 12%
Sedimentary Peat.....	12% - 50%
Fibrous and Woody Peat...	More than 50%

Plasticity

Term	Plastic Index
None to Slight.....	0 - 4
Slight.....	5 - 7
Medium.....	8 - 22
High to Very High ..	Over 22

The penetration resistance, N, is the summation of the number of blows required to effect two successive 6" penetrations of the 2" split-barrel sampler. The sampler is driven with a 140 lb. weight falling 30" and is seated to a depth of 6" before commencing the standard penetration test.

SYMBOLS

Drilling and Sampling

- CS – Continuous Sampling
- RC – Rock Coring: Size AW, BW, NW, 2"W
- RQD – Rock Quality Designation
- RB – Rock Bit/Roller Bit
- FT – Fish Tail
- DC – Drove Casing
- C – Casing: Size 2 ½", NW, 4", HW
- CW – Clear Water
- DM – Drilling Mud
- HSA – Hollow Stem Auger
- FA – Flight Auger
- HA – Hand Auger
- COA – Clean-Out Auger
- SS – 2" Dia. Split-Barrel Sample
- 2ST – 2" Dia. Thin-Walled Tube Sample
- 3ST – 3" Dia. Thin-Walled Tube Sample
- PT – 3" Dia. Piston Tube Sample
- AS – Auger Sample
- WS – Wash Sample
- PTS – Peat Sample
- PS – Pitcher Sample
- NR – No Recovery
- S – Sounding
- PMT – Borehole Pressuremeter Test
- VS – Vane Shear Test
- WPT – Water Pressure Test

Laboratory Tests

- q_a – Penetrometer Reading, tons/sq ft
- q_a – Unconfined Strength, tons/sq ft
- W – Moisture Content, %
- LL – Liquid Limit, %
- PL – Plastic Limit, %
- SL – Shrinkage Limit, %
- LI – Loss on Ignition
- D – Dry Unit Weight, lbs/cu ft
- pH – Measure of Soil Alkalinity or Acidity
- FS – Free Swell, %

Water Level Measurement

- ▽ - Water Level at Time Shown
- NW – No Water Encountered
- WD – While Drilling
- BCR – Before Casing Removal
- ACR – After Casing Removal
- CW – Cave and Wet
- CM – Caved and Moist

Note: Water level measurements shown on the boring logs represent conditions at the time indicated and may not reflect static levels, especially in cohesive soils.

CGC, Inc.

Madison - Milwaukee

Unified Soil Classification System

UNIFIED SOIL CLASSIFICATION AND SYMBOL CHART

COARSE-GRAINED SOILS

(more than 50% of material is larger than No. 200 sieve size)

Clean Gravels (Less than 5% fines)



GW

Well-graded gravels, gravel-sand mixtures, little or no fines



GP

Poorly-graded gravels, gravel-sand mixtures, little or no fines

Gravels with fines (More than 12% fines)



GM

Silty gravels, gravel-sand-silt mixtures



GC

Clayey gravels, gravel-sand-clay mixtures

Clean Sands (Less than 5% fines)



SW

Well-graded sands, gravelly sands, little or no fines



SP

Poorly graded sands, gravelly sands, little or no fines

Sands with fines (More than 12% fines)



SM

Silty sands, sand-silt mixtures



SC

Clayey sands, sand-clay mixtures

FINE-GRAINED SOILS

(50% or more of material is smaller than No. 200 sieve size.)



ML

Inorganic silts and very fine sands, rock flour, silty or clayey fine sands or clayey silts with slight plasticity



CL

Inorganic clays of low to medium plasticity, gravelly clays, sandy clays, silty clays, lean clays



OL

Organic silts and organic silty clays of low plasticity



MH

Inorganic silts, micaceous or diatomaceous fine sandy or silty soils, elastic silts



CH

Inorganic clays of high plasticity, fat clays



OH

Organic clays of medium to high plasticity, organic silts



PT

Peat and other highly organic soils

LABORATORY CLASSIFICATION CRITERIA

GW $C_u = \frac{D_{60}}{D_{10}}$ greater than 4; $C_c = \frac{D_{30}}{D_{10} \times D_{60}}$ between 1 and 3

GP Not meeting all gradation requirements for GW

GM Atterberg limits below "A" line or P.I. less than 4

Above "A" line with P.I. between 4 and 7 are borderline cases requiring use of dual symbols

GC Atterberg limits above "A" line or P.I. greater than 7

SW $C_u = \frac{D_{60}}{D_{10}}$ greater than 4; $C_c = \frac{D_{30}}{D_{10} \times D_{60}}$ between 1 and 3

SP Not meeting all gradation requirements for GW

SM Atterberg limits below "A" line or P.I. less than 4


Limits plotting in shaded zone with P.I. between 4 and 7 are borderline cases requiring use of dual symbols

SC Atterberg limits above "A" line with P.I. greater than 7

Determine percentages of sand and gravel from grain-size curve. Depending on percentage of fines (fraction smaller than No. 200 sieve size), coarse-grained soils are classified as follows:

Less than 5 percent GW, GP, SW, SP
 More than 12 percent GM, GC, SM, SC
 5 to 12 percent Borderline cases requiring dual symbols

PLASTICITY CHART

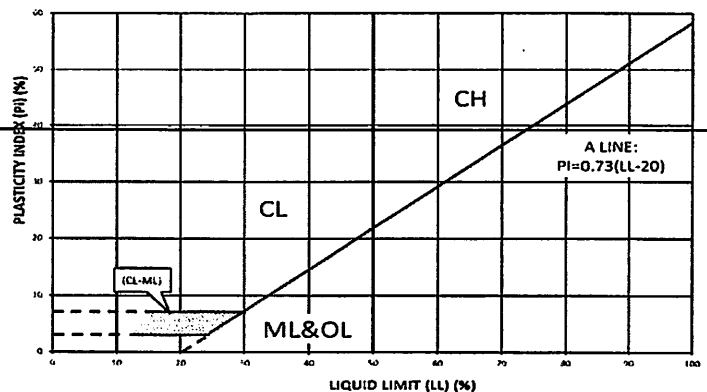

APPENDIX B

RECOMMENDED COMPACTED FILL SPECIFICATIONS

APPENDIX B

CGC, INC.

RECOMMENDED COMPACTED FILL SPECIFICATIONS

General Fill Materials

Proposed fill shall contain no vegetation, roots, topsoil, peat, ash, wood or any other non-soil material which by decomposition might cause settlement. Also, fill shall never be placed while frozen or on frozen surfaces. Rock, stone or broken concrete greater than 6 in. in the largest dimension shall not be placed within 10 ft of the building area. Fill used greater than 10 ft beyond the building limits shall not contain rock, boulders or concrete pieces greater than a 2 sq ft area and shall not be placed within the final 2 ft of finish subgrade or in designated utility construction areas. Fill containing rock, boulders or concrete pieces should include sufficient finer material to fill voids among the larger fragments.

Special Fill Materials

In certain cases, special fill materials may be required for specific purposes, such as stabilizing subgrades, backfilling undercut excavations or filling behind retaining walls. For reference, WisDOT gradation specifications for various types of granular fill are attached in Table 1.

Placement Method

The approved fill shall be placed, spread and leveled in layers generally not exceeding 10 in. in thickness before compaction. The fill shall be placed at moisture content capable of achieving the desired compaction level. For clay soils or granular soils containing an appreciable amount of cohesive fines, moisture conditioning will likely be required.

It is the Contractor's responsibility to provide all necessary compaction equipment and other grading equipment that may be required to attain the specified compaction. Hand-guided vibratory or tamping compactors will be required whenever fill is placed adjacent to walls, footings, columns or in confined areas.

Compaction Specifications

Maximum dry density and optimum moisture content of the fill soil shall be determined in accordance with modified Proctor methods (ASTM D1557). The recommended field compaction as a percentage of the maximum dry density is shown in Table 2. Note that these compaction guidelines would generally not apply to coarse gravel/stone fill. Instead, a method specification would apply (e.g., compact in thin lifts with a vibratory compactor until no further consolidation is evident).

Testing Procedures

Representative samples of proposed fill shall be submitted to CGC, Inc. for optimum moisture-maximum density determination (ASTM D1557) prior to the start of fill placement. The sample size should be approximately 50 lb.

CGC, Inc. shall be retained to perform field density tests to determine the level of compaction being achieved in the fill. The tests shall generally be conducted on each lift at the beginning of fill placement and at a frequency mutually agreed upon by the project team for the remainder of the project.

**Table 1
Gradation of Special Fill Materials**

Material	WisDOT Section 311	WisDOT Section 312	WisDOT Section 305			WisDOT Section 209		WisDOT Section 210
	Breaker Run	Select Crushed Material	3-in. Dense Graded Base	1 1/4-in. Dense Graded Base	3/4-in. Dense Graded Base	Grade 1 Granular Backfill	Grade 2 Granular Backfill	Structure Backfill
Sieve Size	Percent Passing by Weight							
6 in.	100							
5 in.		90-100						
3 in.			90-100					100
1 1/2 in.		20-50	60-85					
1 1/4 in.				95-100				
1 in.					100			
3/4 in.			40-65	70-93	95-100			
3/8 in.				42-80	50-90			
No. 4			15-40	25-63	35-70	100 (2)	100 (2)	25-100
No. 10		0-10	10-30	16-48	15-55			
No. 40			5-20	8-28	10-35	75 (2)		
No. 100						15 (2)	30 (2)	
No. 200			2-12	2-12	5-15	8 (2)	15 (2)	15 (2)

Notes:

1. Reference: Wisconsin Department of Transportation *Standard Specifications for Highway and Structure Construction*.
2. Percentage applies to the material passing the No. 4 sieve, not the entire sample.
3. Per WisDOT specifications, both breaker run and select crushed material can include concrete that is 'substantially free of steel, building materials and other deleterious material'.

**Table 2
Compaction Guidelines**

Area	Percent Compaction (1)	
	Clay/Silt	Sand/Gravel
Within 10 ft of building lines		
Footing bearing soils	93 - 95	95
Under floors, steps and walks		
- Lightly loaded floor slab	90	90
- Heavily loaded floor slab and thicker fill zones	92	95
Beyond 10 ft of building lines		
Under walks and pavements		
- Less than 2 ft below subgrade	92	95
- Greater than 2 ft below subgrade	90	90
Landscaping	85	90

Notes:

1. Based on Modified Proctor Dry Density (ASTM D 1557)

APPENDIX C

ROCK EXCAVATION CONSIDERATIONS

APPENDIX C

ROCK EXCAVATION CONSIDERATIONS

In order to minimize probable "rock" excavation expenses during construction, we suggest that project specifications incorporate the following:

- A. It is assumed that all excavations to levels and dimensions required by the Contract Documents are earth excavation. Earth excavation includes removal and disposal of all materials encountered except rock/sound bedrock which is defined as natural materials which:
 - 1. Cannot be excavated with a minimum 3/4 cubic yard capacity backhoe without drilling and blasting;
 - 2. Cannot be economically removed with a one-tooth ripper on a D8 cat (or equivalent);
 - 3. Requires the use of special equipment such as a pneumatic hammer;
 - 4. Requires the use of explosives (after obtaining written permission of the owner).
- B. Examples of material classified as rock are boulders 1/2 cubic yard or more in volume, bedrock, rock in ledges, and rock-hard cementitious aggregate deposits.
- C. Do not proceed with rock excavation work until architect, engineer and/or testing firm (i.e., CGC) has taken the necessary measures to determine quantity of rock excavation required to complete the work. Measurements will be taken after properly stripped of earth by the contractor. Contractor will be paid the difference between the cost of rock and earth excavation based on an agreed upon unit price established prior to starting rock excavation.

A statement should also be included in the specifications to the effect that: "Stated models of earth excavation equipment are merely for purposes of defining the various excavation categories and are not intended to indicate the brand or type of equipment that is to be used."

APPENDIX D
DOCUMENT QUALIFICATIONS

APPENDIX D

DOCUMENT QUALIFICATIONS

I. GENERAL RECOMMENDATIONS/LIMITATIONS

CGC, Inc. should be provided the opportunity for a general review of the final design and specifications to confirm that earthwork and foundation requirements have been properly interpreted in the design and specifications. CGC should be retained to provide soil engineering services during excavation and subgrade preparation. This will allow us to observe that construction proceeds in compliance with the design concepts, specifications and recommendations, and also will allow design changes to be made in the event that subsurface conditions differ from those anticipated prior to the start of construction. CGC does not assume responsibility for compliance with the recommendations in this report unless we are retained to provide construction testing and observation services.

This report has been prepared in accordance with generally accepted soil and foundation engineering practices and no other warranties are expressed or implied. The opinions and recommendations submitted in this report are based on interpretation of the subsurface information revealed by the test borings indicated on the location plan. The report does not reflect potential variations in subsurface conditions between or beyond these borings. Therefore, variations in soil conditions can be expected between the boring locations and fluctuations of groundwater levels may occur with time. The nature and extent of the variations may not become evident until construction.

II. IMPORTANT INFORMATION ABOUT YOUR GEOTECHNICAL ENGINEERING REPORT

Subsurface problems are a principal cause of construction delays, cost overruns, claims, and disputes. While you cannot eliminate all such risks, you can manage them. The following information is provided to help.

Geotechnical engineers structure their services to meet the specific needs of their clients. A geotechnical engineering study conducted for a civil engineer may not fulfill the needs of a construction contractor or even another civil engineer. Because each geotechnical engineering study is unique, each geotechnical engineering report is unique, prepared *solely* for the client. *No one except you* should rely on your geotechnical engineering report without first conferring with the geotechnical engineer who prepared it. *And no one - not even you* - should apply the report for any purpose or project except the one originally contemplated.

READ THE FULL REPORT

Serious problems have occurred because those relying on a geotechnical engineering report did not read it all. Do not rely on an executive summary. Do not read selected elements only.

A GEOTECHNICAL ENGINEERING REPORT IS BASED ON A UNIQUE SET OF PROJECT-SPECIFIC FACTORS

Geotechnical engineers consider a number of unique, project-specific factors when establishing the scope of a study. Typical factors include: the client's goals, objectives, and risk management preferences; the general nature of the structure involved, its size, and configuration; the location of the structure on the site; and other planned or existing site improvements, such as access roads, parking lots, and underground utilities. Unless the geotechnical engineer who conducted the study specifically indicates otherwise, *do not rely on a geotechnical engineering report* that was:

- not prepared for you,
- not prepared for your project,
- not prepared for the specific site explored, or
- completed before important project changes were made.

Typical changes that can erode the reliability of an existing geotechnical report include those that affect:

- the function of the proposed structure, as when it's changed from a parking garage to an office building, or from a light industrial plant to a refrigerated warehouse,
- elevation, configuration, location, orientation, or weight of the proposed structure,
- composition of the design team, or project ownership.

As a general rule, *always* inform your geotechnical engineer of project changes - even minor ones - and request an assessment of their impact. *CGC cannot accept responsibility or liability for problems that occur because our reports do not consider developments of which we were not informed.*

SUBSURFACE CONDITIONS CAN CHANGE

A geotechnical engineering report is based on conditions that existed at the time the geotechnical engineer performed the study. *Do not rely on a geotechnical engineering report* whose adequacy may have been affected by: the passage of time; by man-made events, such as construction on or adjacent to the site; or by natural events, such as floods, earthquakes, or groundwater fluctuations. *Always* contact the geotechnical engineer before applying the report to determine if it is still reliable. A minor amount of additional testing or analysis could prevent major problems.

MOST GEOTECHNICAL FINDINGS ARE PROFESSIONAL OPINION

Site exploration identifies subsurface conditions only at those points where subsurface tests are conducted or samples are taken. Geotechnical engineers review field and laboratory data and then apply their professional judgement to render an opinion about subsurface conditions throughout the site. Actual subsurface conditions may differ - sometimes significantly - from those indicated in your report. Retaining the geotechnical engineer who

developed your report to provide construction observation is the most effective method of managing the risks associated with unanticipated conditions.

A REPORT'S RECOMMENDATIONS ARE NOT FINAL

Do not over-rely on the confirmation-dependent recommendations included in your report. *Those confirmation-dependent recommendations are not final*, because geotechnical engineers develop them principally from judgement and opinion. Geotechnical engineers can finalize their recommendations *only* by observing actual subsurface conditions revealed during construction. *CGC cannot assume responsibility or liability for the report's confirmation-dependent recommendations if we do not perform the geotechnical-construction observation required to confirm the recommendations' applicability.*

A GEOTECHNICAL ENGINEERING REPORT IS SUBJECT TO MISINTERPRETATION

Other design team members' misinterpretation of geotechnical engineering reports has resulted in costly problems. Confront that risk by having your geotechnical engineer confer with appropriate members of the design team after submitting the report. Also retain your geotechnical engineer to review pertinent elements of the design team's plans and specifications. Constructors can also misinterpret a geotechnical engineering report. Confront that risk by having CGC participate in prebid and preconstruction conferences, and by providing geotechnical construction observation.

DO NOT REDRAW THE ENGINEER'S LOGS

Geotechnical engineers prepare final boring and testing logs based upon their interpretation of field logs and laboratory data. To prevent errors or omissions, the logs included in a geotechnical engineering report should *never* be redrawn for inclusion in architectural or other design drawings. Only photographic or electronic reproduction is acceptable, *but recognize that separating logs from the report can elevate risk.*

GIVE CONSTRUCTORS A COMPLETE REPORT AND GUIDANCE

Some owners and design professionals mistakenly believe they can make constructors liable for unanticipated subsurface conditions by limiting what they provide for bid preparation. To help prevent costly problems, give constructors the complete geotechnical engineering report, *but* preface it with a clearly written letter of transmittal. In that letter, advise constructors that the report was not prepared for purposes of bid development and that the report's accuracy is limited; encourage them to confer with the geotechnical engineer who prepared the report (a modest fee may be required) and/or to conduct additional study to obtain the specific types of information they need or prefer. A prebid conference can also be valuable. *Be sure constructors have sufficient time to perform additional study.* Only then might you be in a position to give constructors the best information available to you, while requiring them to at least share some of the financial responsibilities stemming from unanticipated conditions.

READ RESPONSIBILITY PROVISIONS CLOSELY

Some clients, design professionals, and constructors do not recognize that geotechnical engineering is far less exact than other engineering

disciplines. This lack of understanding has created unrealistic expectations that have led to disappointments, claims, and disputes. To help reduce the risk of such outcomes, geotechnical engineers commonly include a variety of explanatory provisions in their reports. Sometimes labeled "limitations," many of these provisions indicate where geotechnical engineer's responsibilities begin and end, to help others recognize their own responsibilities and risks. *Read these provisions closely.* Ask questions. Your geotechnical engineer should respond fully and frankly.

ENVIRONMENTAL CONCERNS ARE NOT COVERED

The equipment, techniques, and personnel used to perform an *environmental* study differ significantly from those used to perform a *geotechnical* study. For that reason, a geotechnical engineering report does not usually relate any environmental findings, conclusions, or recommendations; e.g., about the likelihood of encountering underground storage tanks or regulated contaminants. *Unanticipated environmental problems have led to numerous project failures.* If you have not yet obtained your own environmental information, ask your geotechnical consultant for risk management guidance. *Do not rely on an environmental report prepared for someone else.*

OBTAIN PROFESSIONAL ASSISTANCE TO DEAL WITH MOLD


Diverse strategies can be applied during building design, construction, operation, and maintenance to prevent significant amounts of mold from growing on indoor surfaces. To be effective, all such strategies should be devised for the *express purpose* of mold prevention, integrated into a comprehensive plan, and executed with diligent oversight by a professional mold prevention consultant. Because just a small amount of water or moisture can lead to the development of severe mold infestations, many mold prevention strategies focus on keeping building surfaces dry. While groundwater, water infiltration, and similar issues may have been addressed as part of the geotechnical engineering study whose findings are conveyed in this report, the geotechnical engineer in charge of this project is not a mold prevention consultant; *none of the services performed in connection with the geotechnical engineer's study were designed or conducted for the purpose of mold prevention.* *Proper implementation of the recommendations conveyed in this report will not of itself be sufficient to prevent mold from growing in or on the structure involved.*

RELY ON YOUR GEOTECHNICAL ENGINEER FOR ADDITIONAL ASSISTANCE

Membership in the Geotechnical Business Council (GBC) of Geoprofessional Business Association exposes geotechnical engineers to a wide array of risk confrontation techniques that can be of genuine benefit for everyone involved with a construction project. Confer with CGC, a member of GBC, for more information.

Modified and reprinted with permission from:

Geotechnical Business Council
of the Geoprofessional Business Association
8811 Colesville Road, Suite G 106
Silver Spring, MD 20910

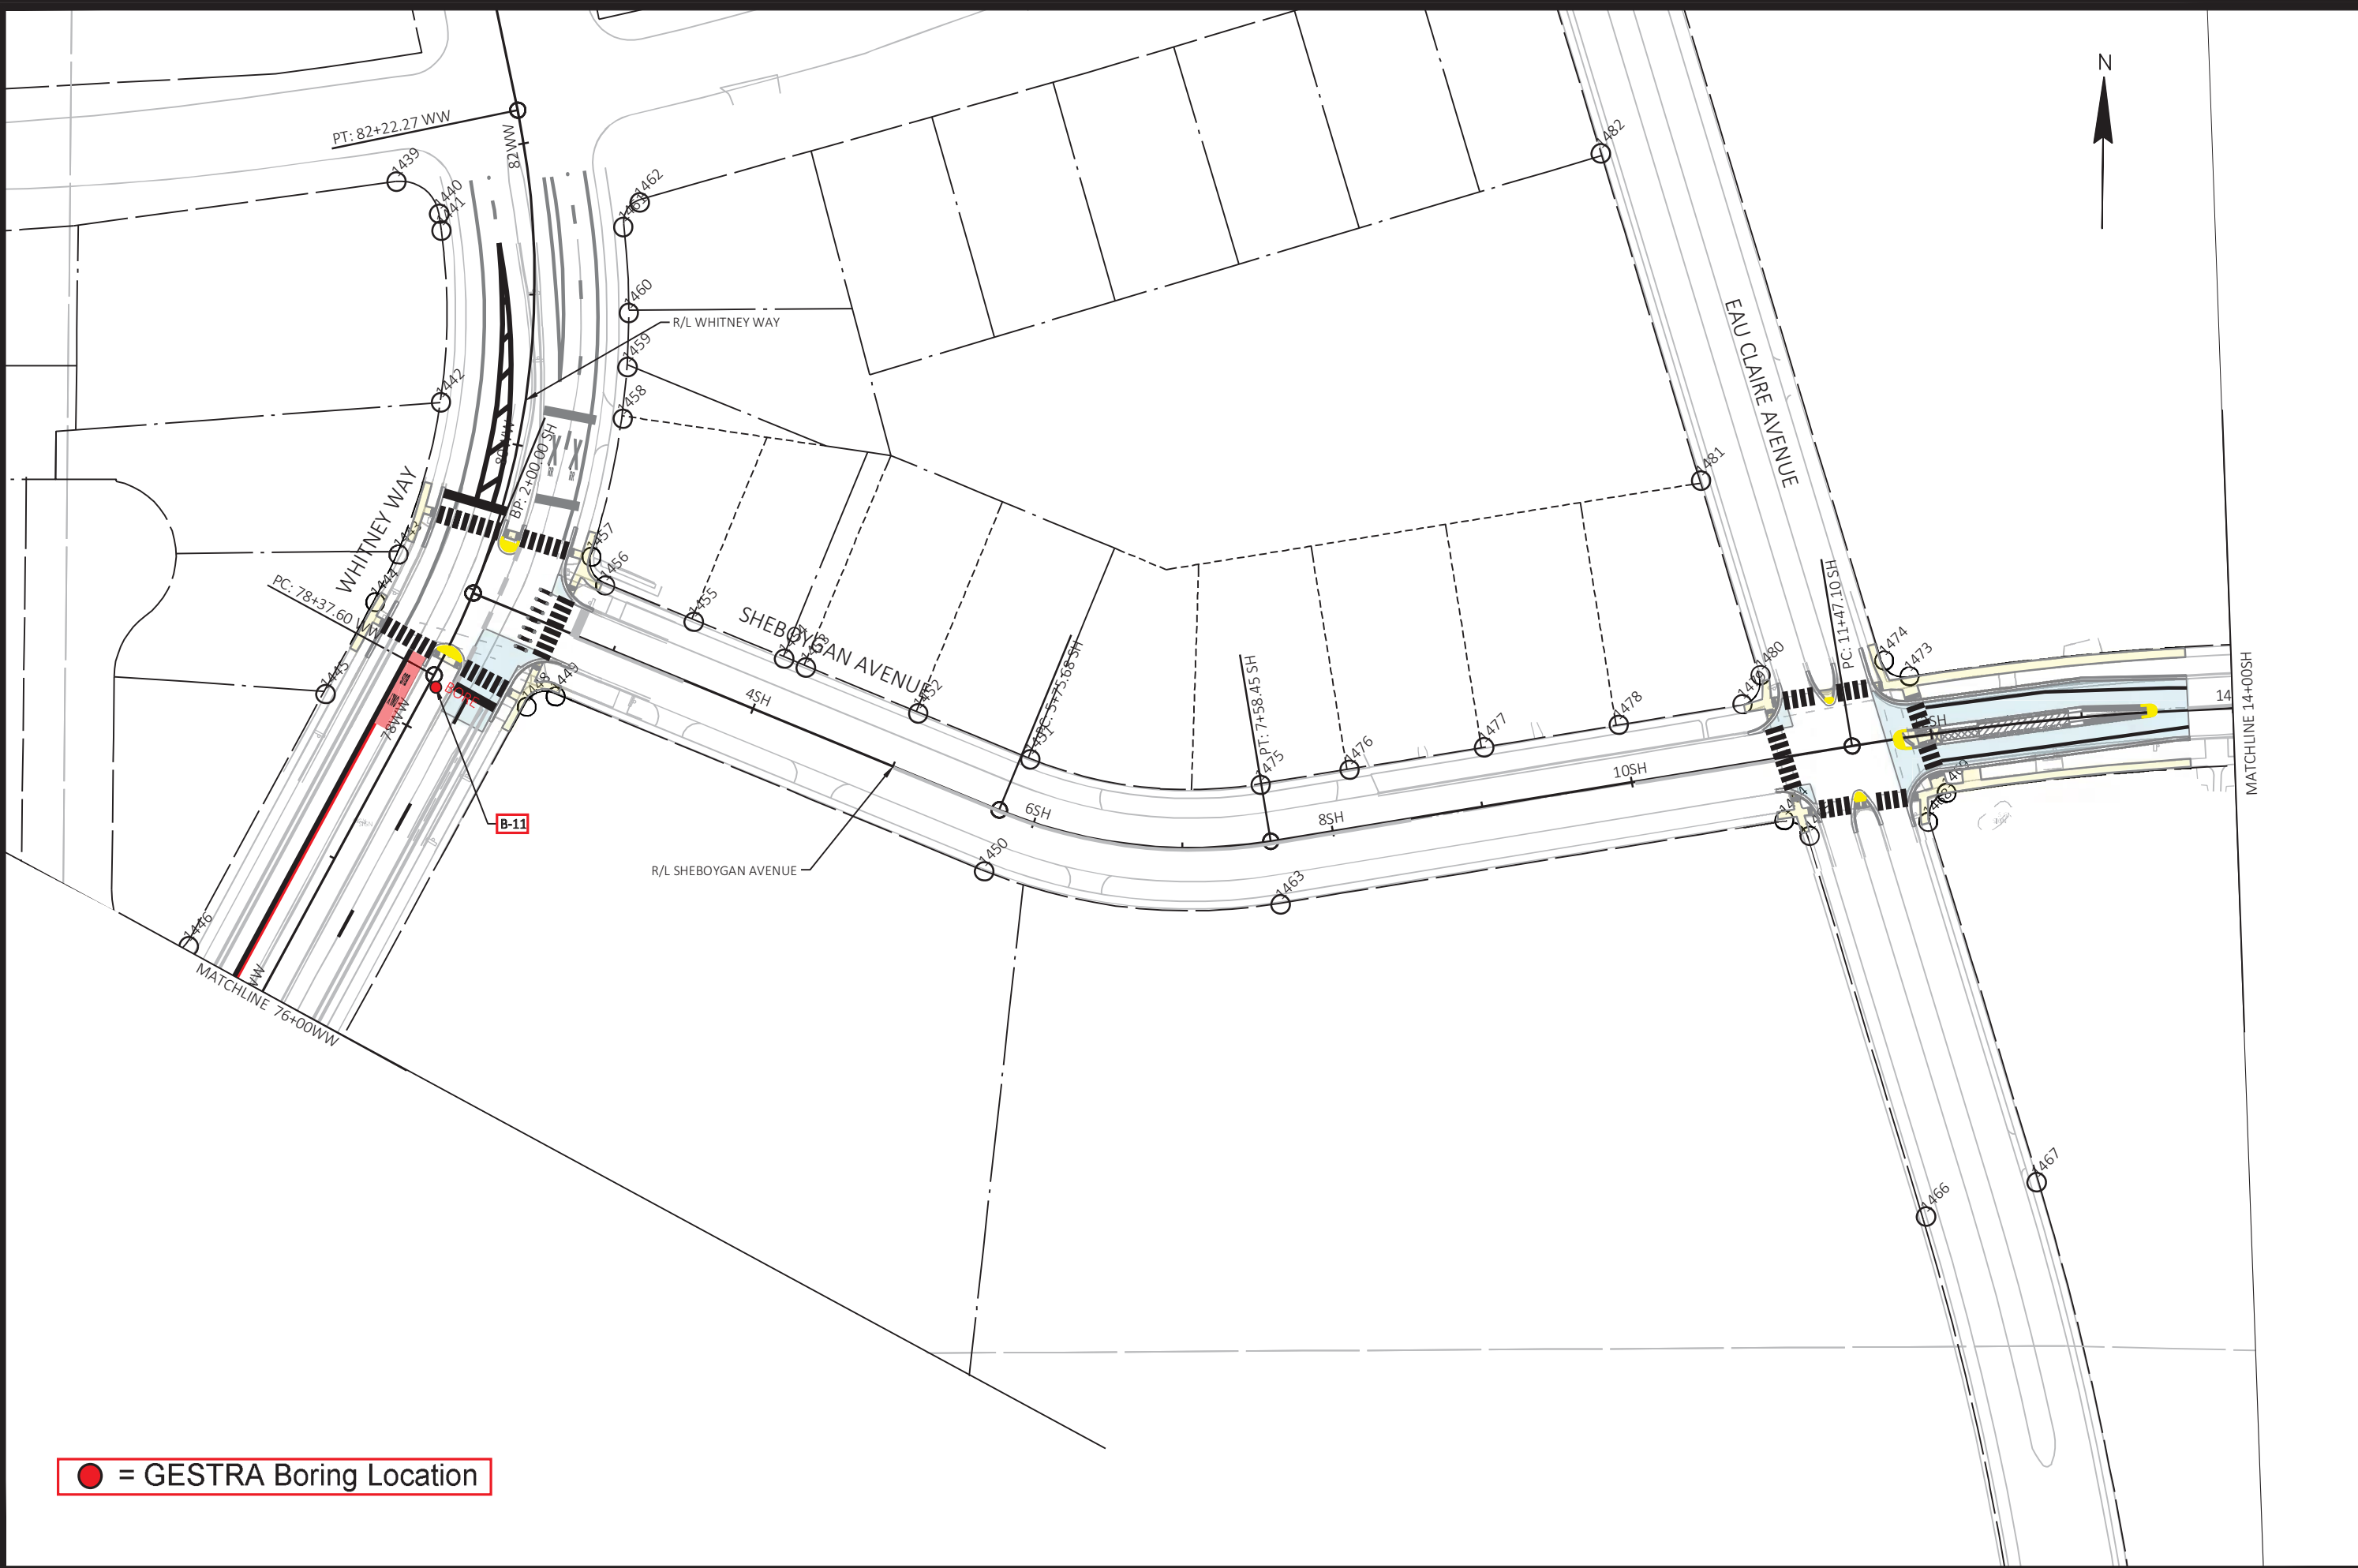

● = GestrA Boring Location

MARK	REVISION	DATE	BY
60631225P	Designed By: KL ENG	2022-04-06	

60631225P
 CITY OF MADISON, DANE COUNTY, WI
 CONTRACT NO: 60631225C

GEOTECHNICAL BORINGS
 BUS RAPID TRANSIT
 CITY OF MADISON



60631225P
 M17-W



SOIL BORING LOG

PAGE NUMBER

1 of 1

GESTRA Engineering Inc.
 2223 Industrial Drive
 Monona, WI 53713
 Phone: 608-222-9406, Fax: 608-222-9408

PROJECT NAME
Madison E-W BRT

DATE DRILLING STARTED

2/2/2022

BORING NUMBER

B-11

PROJECT LOCATION

Madison, WI

DATE DRILLING ENDED

2/2/2022

PROJECT NUMBER

M21068-10

DRILLING RIG

CME 75 (International)

BORING DRILLED BY

FIRM: GESTRA
 CREW CHIEF: D. Harris

FIELD LOG

J. Metzinger

NORTHING

482217

LAB LOG / QC

J. Metzinger/D. Dettmers

EASTING

798864

DRILLING METHOD

3 1/4" HSA

SURFACE ELEVATION

941.8 ft

Number and Type	Recovery (in)	Blow Counts	N - Value	Depth (ft) Elevation	Soil Description and Geological Origin for Each Major Unit	USCS Classification	Graphic	Well Diagram	Unconfined Comp. Strength (Q _u or Q _p) (tsf)	Liquid Limit	Plasticity Index	Moisture Content (%)	Comments
SS - 1	22	9 10 10 10	20	940.0	TOPSOIL (6-inches) 0.5 (941.3) LEAN CLAY WITH SAND, brown and dark brown, moist, trace gravel, trace organics, (FILL)								Estimated frost depth not recorded
SS - 2	11	5 5 5	10		Trace asphalt pieces in sample SS-2 2.7 (939.1) LEAN CLAY, brown, moist, very stiff to hard, trace sand			4.25				21	
SS - 3	16	3 4 6	10	5	With silt lenses in sample SS-3	CL		2.75				22.7	
SS - 4	15	2 7 10	17	935.0	6.4 (935.4) SANDY SILTY CLAY, brown, moist, very stiff, trace gravel With 2-inch very moist layer at 7.3 feet	CL-ML			16	4		11.2	Sample SS-4 disturbed; Unable to obtain Q _p
SS - 5	17	3 13 16	29	10	8 (933.8) SILTY SAND, light brown, moist, medium dense	SM							
SS - 6	21	3 8 16	24	930.0	8.8 (933) SILT WITH SAND, brown, moist, medium dense, trace gravel	SP-SM						9.4	
SS - 7	10	9 8 13	21	15	11.4 (930.4) SILTY CLAY, brown, moist, very stiff	CL-ML		3.00				9	
				14.1 (927.7)	With 1-inch silty sand layer at 12.2 feet								
				15	With 2-inch gravel layer at 12.2 feet								
				16	14.1 (927.7) SILT WITH SAND AND GRAVEL, light brown to brown, moist, medium dense	ML							
				16	16 (925.8) End of Boring at 16.0 ft.								
				20									
				920.0									
				25									
				915.0									

WATER & CAVE-IN OBSERVATION DATA

<input checked="" type="checkbox"/>	WATER ENCOUNTERED DURING DRILLING: NE ft.	<input checked="" type="checkbox"/>	CAVE DEPTH AT COMPLETION: NMR	WET <input type="checkbox"/>
<input checked="" type="checkbox"/>	WATER LEVEL AT COMPLETION: NMR		CAVE DEPTH AFTER 0 HOURS: NMR	DRY <input type="checkbox"/>
<input checked="" type="checkbox"/>	WATER LEVEL AFTER 0 HOURS: NMR			WET <input type="checkbox"/>
				DRY <input type="checkbox"/>

NOTE: Stratification lines between soil types represent the approximate boundary; gradual transition between in-situ soil layers should be expected.



GESTRA Engineering Inc.
2223 Industrial Drive
Monona, WI 53713
Phone: 608-222-9406, Fax: 608-222-9408

SOIL BORING LOG

PAGE NUMBER		1 of 1
BORING NUMBER	B-12	
PROJECT NUMBER	M21068-10	
DRILLING RIG	CME 75 (International)	
DRILLING METHOD	3 1/4" HSA	
SURFACE ELEVATION	942.4 ft	

PROJECT NAME	DATE DRILLING STARTED
Madison E-W BRT	2/2/2022
PROJECT LOCATION	DATE DRILLING ENDED
Madison, WI	2/2/2022


BORING DRILLED BY	FIELD LOG	NORTHING
FIRM: GESTRA CREW CHIEF: D. Harris	J. Metzinger	482309
	LAB LOG / QC	EASTING
	J. Metzinger/D. Dettmers	801772

Number and Type	Recovery (in)	Blow Counts	N - Value	Depth (ft) Elevation	Soil Description and Geological Origin for Each Major Unit	USCS Classification	Graphic	Well Diagram	Unconfined Comp. Strength (Q _u or Q _s) (tsf)	Liquid Limit	Plasticity Index	Moisture Content (%)	Comments
SS - 1	21	9 12 17 23	29		TOPSOIL (4-inches) 0.4 (942)								Estimated frost depth = 7 inches
				940.0	SILTY SAND, light brown to brown, moist, (FILL) 2.2 (940.2)								
SS - 2	18	4 6 4	10		CLAYEY SAND, brown, moist, with clay pieces (FILL) 4.4 (938)								
SS - 3	15	3 5 3	8	5	LEAN CLAY, brown, moist, very stiff	CL		2.50			24		
				935.0	SANDY LEAN CLAY, brown, moist, medium stiff 6.3 (936.1)	CL		0.50			20.9		
SS - 4	8	2 1 2	3										
SH - 5	23			10	SILTY SAND, brown, moist, loose, trace gravel 9.3 (933.1)						20.3		
SS - 6	15	2 3 5	8	930.0	Yellowish brown color at 12.8 feet	SM							
SS - 7	17	10 29 12	41	15	GRAVEL WITH SAND, dark gray, moist, dense 15.5 (926.9)	GP							
SS - 8	0	50/4"	R	20	Fine white powder in tip of split spoon of sample SS-8 19.8 (922.6) End of Boring at 19.8 ft.								Possible bedrock at 19.5 feet
				920.0									
				25									

WATER & CAVE-IN OBSERVATION DATA

WATER ENCOUNTERED DURING DRILLING: NE ft.	CAVE DEPTH AT COMPLETION: NMR	WET <input type="checkbox"/>
WATER LEVEL AT COMPLETION: NMR	CAVE DEPTH AFTER 0 HOURS: NMR	DRY <input type="checkbox"/>
WATER LEVEL AFTER 0 HOURS: NMR		WET <input type="checkbox"/>
		DRY <input type="checkbox"/>

NOTE: Stratification lines between soil types represent the approximate boundary; gradual transition between in-situ soil layers should be expected.

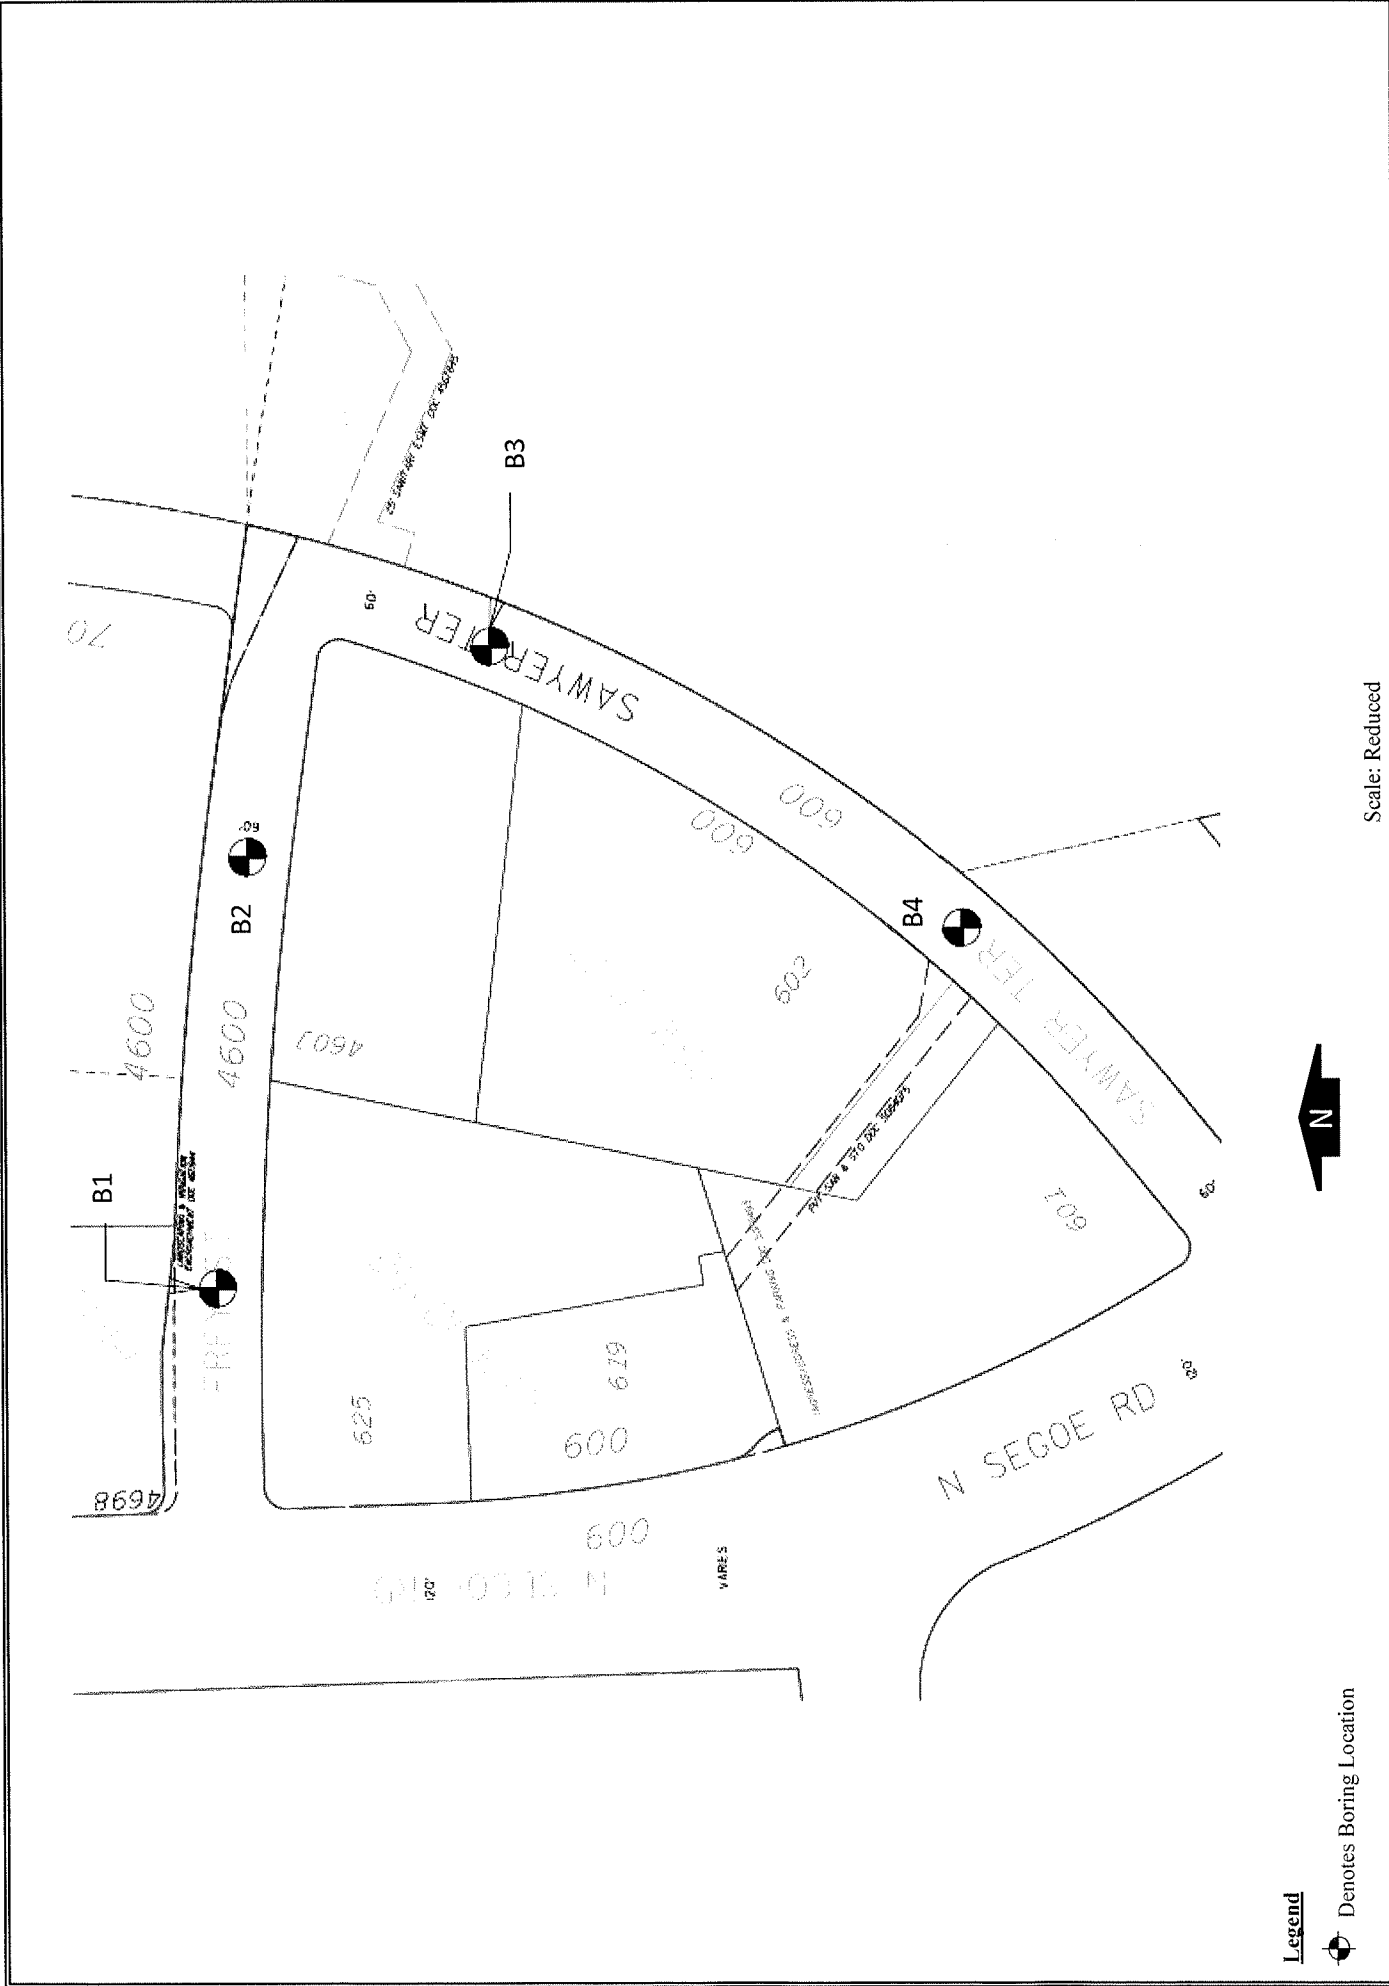

Legend

☉ Denotes Boring Location

Notes

1. Soil borings performed by Badger State Drilling in August 2017
2. Boring locations are approximate.

Scale: Reduced

CGC, Inc.	
Date: 9/2017	Soil Boring Location Plan
Job No.: C17051-24	Frey Street and Sawyer Terrace Madison, WI



LOG OF TEST BORING

Project Frey Street and Sawyer Terrace
Frey: 110'E of Segoe, 5'N of CL
 Location Madison, WI

Boring No. 1
 Surface Elevation (ft) 947±
 Job No. C17051-24
 Sheet 1 of 1

2921 Perry Street, Madison, WI 53713 (608) 288-4100, FAX (608) 288-7887

SAMPLE					VISUAL CLASSIFICATION and Remarks	SOIL PROPERTIES				
No.	TYPE	Rec (in.)	Moist	N		Depth (ft)	qu (qa) (tsf)	W	LL	PL
					5.5	5.5 in. Asphalt Pavement/9 in. Base Course				
1		14	M	23	7.5	Brown Fine to Medium SAND, Some Silt and Gravel, Scattered Cobbles and Boulders (SM)				
2		7	M	78/8"	5.5	Apparent Weathered to Competent Dolomitic Limestone Bedrock				
					5.5	End of Boring at 5.5 ft due to Auger Refusal on Apparent Competent Bedrock or Possible Boulder				
					5.5	Backfilled with Soil Cuttings and Asphalt Patch (N 43° 04.442', W 89° 27.385')				

WATER LEVEL OBSERVATIONS	GENERAL NOTES
While Drilling <input checked="" type="checkbox"/> <u>NW</u> Upon Completion of Drilling _____ Time After Drilling _____ Depth to Water _____ Depth to Cave in _____	Start <u>8/24/17</u> End <u>8/22/17</u> Driller <u>BSD</u> Chief <u>KD</u> Rig <u>CME-55</u> Logger <u>DB/MG</u> Editor <u>ESF</u> Drill Method <u>2.25" HSA; Autohammer</u>
The stratification lines represent the approximate boundary between soil types and the transition may be gradual.	



LOG OF TEST BORING

Project Frey Street and Sawyer Terrace
Frey: 150'W of Sawyer, 5'N of CL
 Location Madison, WI

Boring No. 2
 Surface Elevation (ft) 915±
 Job No. C17051-24
 Sheet 1 of 1

2921 Perry Street, Madison, WI 53713 (608) 288-4100, FAX (608) 288-7887

SAMPLE					VISUAL CLASSIFICATION and Remarks	SOIL PROPERTIES				
No.	DEPTH (ft)	Rec (in.)	Moist	N		Depth (ft)	qu (qa) (tsf)	W	LL	PL
					5 in. Asphalt Pavement/8 in. Base Course					
1		14	M	24	Medium Dense, Brown Fine to Medium SAND, Some Silt and Gravel, Scattered Cobbles and Boulders (SM)					
2		16	M	29						
3A 3B		18	M	34						
					Tan to White Weathered to Competent SANDSTONE BEDROCK					
4		18	M	36						
5		15	M	29						
					End of Boring at 15 ft					
					Backfilled with bentonite chips and asphalt patch (N 43° 04.449', W 89° 27.290')					

WATER LEVEL OBSERVATIONS

While Drilling NW Upon Completion of Drilling _____
 Time After Drilling _____
 Depth to Water _____
 Depth to Cave in _____

GENERAL NOTES

Start 8/24/17 End 8/22/17
 Driller BSD Chief KD Rig CME-55
 Logger DB/MG Editor ESF
 Drill Method 2.25" HSA; Autohammer

The stratification lines represent the approximate boundary between soil types and the transition may be gradual.



LOG OF TEST BORING

Project Frey Street and Sawyer Terrace
 Location Sawyer: 300'SW of Frey 8'SE of CL
Madison, WI

Boring No. 3
 Surface Elevation (ft) 919±
 Job No. C17051-24
 Sheet 1 of 1

2921 Perry Street, Madison, WI 53713 (608) 288-4100, FAX (608) 288-7887

SAMPLE					VISUAL CLASSIFICATION and Remarks	SOIL PROPERTIES				
No.	TYPE	Rec (in.)	Moist	N		Depth (ft)	qu (qa) (tsf)	W	LL	PL
					5	5 in. Asphalt Pavement/8 in. Base Course				
1		4	M	20	5	Medium Dense to Dense, Brown Fine to Medium SAND, Some Silt and Gravel, Scattered Cobbles and Boulders (SM) (Possible Fill to 3ft)				
2		18	M	15	5					
3		12	M	32	5					
4		16	M	24	5					
5		18	M	32	5					
					10	End of Boring at 15 ft Backfilled with bentonite chips and asphalt patch (N 43° 04.405', W 89° 27.279')				
					15					
					20					

WATER LEVEL OBSERVATIONS

While Drilling NW Upon Completion of Drilling _____
 Time After Drilling _____
 Depth to Water _____
 Depth to Cave in _____

GENERAL NOTES

Start 8/24/17 End 8/22/17
 Driller BSD Chief KD Rig CME-55
 Logger DB/MG Editor ESF
 Drill Method 2.25" HSA; Autohammer

The stratification lines represent the approximate boundary between soil types and the transition may be gradual.



LOG OF TEST BORING

Project Frey Street and Sawyer Terrace
Sawyer, 150'NE of Segoe, 10'E of CL
 Location Madison, WI

Boring No. 4
 Surface Elevation (ft) 926±
 Job No. C17051-24
 Sheet 1 of 1

2921 Perry Street, Madison, WI 53713 (608) 288-4100, FAX (608) 288-7887

SAMPLE					VISUAL CLASSIFICATION and Remarks	SOIL PROPERTIES				
No.	TYPE	Rec (in.)	Moist	N		Depth (ft)	qu (qa) (tsf)	W	LL	PL
					5	4.5 in. Asphalt Pavement/4 in. Base Course				
1		14	M	17	5	FILL: Medium Dense, Brown to Dark Brown Sand with Some Silt, Gravel and Clay, Occasional Cobbles				
2		0	M	21	5	Medium Dense to Very Dense, Brown Fine to Medium SAND, Some Silt and Gravel, Scattered Cobbles and Boulders (SM)				
3		16	M	16	5					
4		18	M	38	10					
5		12	M	85	15					
					15					
					20	End of Boring at 15 ft Backfilled with bentonite chips and asphalt patch (N 43° 04.346', W 89° 27.337')				

WATER LEVEL OBSERVATIONS	GENERAL NOTES
While Drilling <input checked="" type="checkbox"/> <u>NW</u> Upon Completion of Drilling _____ Time After Drilling _____ Depth to Water _____ Depth to Cave in _____	Start <u>8/24/17</u> End <u>8/22/17</u> Driller <u>BSD</u> Chief <u>KD</u> Rig <u>CME-55</u> Logger <u>DB/MG</u> Editor <u>ESF</u> Drill Method <u>2.25" HSA; Autohammer</u>
The stratification lines represent the approximate boundary between soil types and the transition may be gradual.	