

Contract Routing Form

ROUTING: Urgent Rush

printed on: 06/02/2020

Contract between: Proaxis LLC
and Dept. or Division: Engineering Division
Name/Phone Number:

Project: 2020 Parking Garage Maintenance

Contract No.: 8885
Enactment No.: RES-20-00403
Dollar Amount: 655,500.00

File No.: 60357
Enactment Date: 05/27/2020

(Please DATE before routing)

Signatures Required	Date Received	Date Signed
City Clerk	6-3-2020	6-3-2020
Director of Civil Rights	6-4-2020	6-4-2020
Risk Manager	6/5/2020	6/5/2020 RN
Finance Director	6/5/2020	6/9/2020
City Attorney	6/09/20	
Mayor	6-9-2020	6-9-2020

Please return signed Contracts to the City Clerk's Office
Room 103, City-County Building for filing.

Original + 2 Copies

06/02/2020 16:12:51 enjls - Bill Putnam 266-6528

Dis Rights: OK (N/A) Problem - Hold
 Prev Wage: AA / Agency (No/A)
 Contract Value: See above
 AA Plan: Approved
 Amendment / Addendum # -
 Type: POS / Dvlp / Sbdv / Gov't /
 Grant / PW / Goal / Loan / Agrmt



City of Madison

City of Madison
Madison, WI 53703
www.cityofmadison.com

Legislation Details (With Text)

File #: 60357 **Version:** 1 **Name:** Awarding Public Works Contract No. 8885, 2020 Parking Garage Maintenance.

Type: Resolution **Status:** Passed

File created: 4/28/2020 **In control:** Engineering Division

On agenda: 5/19/2020 **Final action:** 5/19/2020

Enactment date: 5/27/2020 **Enactment #:** RES-20-00403

Title: Awarding Public Works Contract No. 8885, 2020 Parking Garage Maintenance. (2nd & 4th ADs)

Sponsors: BOARD OF PUBLIC WORKS

Indexes:

Code sections:

Attachments: 1. Contract 8885.pdf, 2. 8885.pdf

Date	Ver.	Action By	Action	Result
5/19/2020	1	COMMON COUNCIL	Adopt	Pass
5/5/2020	1	COMMON COUNCIL	Refer to a future Meeting to Adopt	Pass
4/28/2020	1	Engineering Division	Referred for Introduction	

The 2020 Adopted Budget includes \$655,500 for parking garage maintenance costs. These funds are included in the Parking Utility purchased service budget. No additional appropriation is anticipated at this time. Awarding Public Works Contract No. 8885, 2020 Parking Garage Maintenance. (2nd & 4th ADs)
BE IT RESOLVED, that the following low bids for miscellaneous improvements be accepted and that the Mayor and City Clerk be and are hereby authorized and directed to enter into a contract with the low bidder contained herein, subject to the Contractor's compliance with Section 39.02 of the Madison General Ordinances concerning compliance with the Affirmative Action provisions **and subject to the Contractor's compliance with Section 33.07 of the Madison General Ordinances regarding Best Value Contracting:**

BE IT FURTHER RESOLVED, that the funds be encumbered to cover the cost of the projects contained herein.

See attached document (Contract No. 8885) for itemization of bids.

PROJECT _____ CONTRACTOR _____ AMOUNT OF BID _____

CONTRACT NO. 8885
2020 PARKING GARAGE MAINTENANCE

ProAxis LLC

\$421,904.55

Acct. No. 82145561-54210-00000 \$50,473.77
Contingency 8%± 4,037.90
Sub-Total \$54,511.67

Acct. No. 82145562-54210-00000 \$27,555.25
Contingency 8%± 2,204.42
Sub-Total \$29,759.67

Acct. No. 82145566-54210-00000 \$137,315.69
Contingency 8%± 10,985.26
Sub-Total \$148,300.95

Acct. No. 82145565-54210-00000 \$89,091.81
Contingency 8%± 7,127.34
Sub-Total \$96,219.15

Acct. No. 82145567-54210-00000 \$117,468.03
Contingency 8%± 9,397.44
Sub-Total \$126,865.47

GRAND TOTAL \$455,656.91

Jurisdiction: Wisconsin

Demographics

Company Name: West Bend Mutual Insurance Company
 SBS Company Number: 54218767
 Domicile Type: Domestic
 NAIC Group Number:
 Merger Flag: No

NAIC CoCode: 15350
 State of Domicile: Wisconsin
 Organization Type: Mutual

Short Name:
 FEIN: 39-0698170
 Country of Domicile: United States
 Date of Incorporation: 01/01/1894

Address

Business Address
 1900 S 18TH AVE
 WEST BEND, WI 53095
 United States

Mailing Address
 1900 S 18TH AVE
 WEST BEND, WI 53095
 United States

Statutory Home Office Address
 1900 S 18TH AVE
 WEST BEND, WI 53095
 United States

Main Administrative Office Address
 1900 S 18TH AVE
 WEST BEND, WI 53095
 United States

Phone, Email, Website

Phone Type	Number
Business Primary Phone	(262) 365-2512
Fax Phone	(262) 365-2770
Business Primary Phone	(262) 334-5571
Toll Free Phone	(800) 236-5010

Email
 No results found.

Website
 No results found.

Company Type

Company Type: Property and Casualty
 Status: Active
 Effective Date: 10/19/1961
 Issue Date: 05/01/1894
 Articles of Incorporation Received: No

Status Reason:
 Legacy State ID: 110833
 Approval Date:
 Article No:

Status Date: 05/01/1894
 Expiration Date:
 File Date:
 COA Number:

Appointments

Show 10 entries

Showing 1 to 2 of 6989 entries

Licensee Name	License Number	NPN	License Type	Line of Authority	Appointment Date	Effective Date	Expiration Date
PATRICK MCKENNA	650765	650765	Intermediary (Agent) Individual	Property	03/13/2008	02/13/2020	03/15/2021
PATRICK MCKENNA	650765	650765	Intermediary (Agent) Individual	Casualty	03/13/2008	02/13/2020	03/15/2021

[First](#)
[Previous](#)

[Next](#)
[Last](#)

Line Of Business

Line of Business	Citation Type	Effective Date
Aircraft	Aircraft	10/19/1961
Automobile	Automobile	10/19/1961
Disability Insurance	Disability Insurance	10/19/1961
Fidelity Insurance	Fidelity Insurance	10/19/1961
Fire, Inland Marine and Other Property Insurance	Fire, Inland Marine and Other Property Insurance	10/19/1961
Liability and Incidental Medical Expense Insurance (other than automobile)	Liability and Incidental Medical Expense Insurance (other than automobile)	10/19/1961
Miscellaneous	Miscellaneous	10/19/1961
Ocean Marine Insurance	Ocean Marine Insurance	10/19/1961
Surety Insurance	Surety Insurance	10/19/1961
Workers Compensation Insurance	Workers Compensation Insurance	10/19/1961

Contact

Contact Type	Preferred Name	Name	E-mail	Phone	Address
Registered Agent for Service of Process		CHRISTOPHER ZWYGART			Other WEST BEND MUTUAL INSURANCE CO 1900 S 18TH AVE WEST BEND, WI United States County 53095

Company Merger

No results found.

Name Change History

Previous Name

New Name

Effective Date

West Bend Mutual Insurance Company

\$421,904.55
ORIGINAL

BID OF PROAXIS LLC

2020

PROPOSAL, CONTRACT, BOND AND SPECIFICATIONS

FOR

2020 PARKING GARAGE MAINTENANCE

CONTRACT NO. 8885

MUNIS NO. 8214556X

IN

MADISON, DANE COUNTY, WISCONSIN

AWARDED BY THE COMMON COUNCIL

MADISON, WISCONSIN ON MAY 19, 2020

CITY ENGINEERING DIVISION
1600 EMIL STREET
MADISON, WISCONSIN 53713

<https://bidexpress.com/login>

**2020 PARKING GARAGE MAINTENANCE
CONTRACT NO. 8885**

INDEX

SECTION A: ADVERTISEMENT FOR BIDS AND INSTRUCTIONS TO BIDDERS	A-1
SECTION B: PROPOSAL SECTION	B-1
SECTION C: SMALL BUSINESS ENTERPRISE	C-1
SECTION D: SPECIAL PROVISIONS	D-1
SECTION E: BIDDER'S ACKNOWLEDGEMENT	E-1
SECTION F: BEST VALUE CONTRACTING	F-1
SECTION G: BID BOND	G-1
SECTION H: AGREEMENT	H-1
SECTION I: PAYMENT AND PERFORMANCE BOND	I-1

This Proposal, and Agreement have
been prepared by:

**CITY ENGINEERING DIVISION
CITY OF MADISON
MADISON, DANE COUNTY, WISCONSIN**



Sabrina J. Tolley
Assistant City Parking Utility Manager

SJT: wtp

SECTION A: ADVERTISEMENT FOR BIDS AND INSTRUCTIONS TO BIDDERS

REQUEST FOR BID FOR PUBLIC WORKS CONSTRUCTION CITY OF MADISON, WISCONSIN

A BEST VALUE CONTRACTING MUNICIPALITY

PROJECT NAME:	2020 PARKING GARAGE MAINTENANCE
CONTRACT NO.:	8885
SBE GOAL	9%
BID BOND	5%
SBE PRE BID MEETING (1:00 P.M.)	See Pre Bid meeting info below
PREQUALIFICATION APPLICATION DUE (2:00 P.M.)	4/16/2020
BID SUBMISSION (2:00 P.M.)	4/23/2020
BID OPEN (2:30 P.M.)	4/23/2020
PUBLISHED IN WSJ	4/9/2020 & 4/16/2020

SBE PRE BID MEETING: Small Business Enterprise Pre-Bid Meetings are not being held in person at this time. Contractors can schedule one-on-one phone calls with Juan Pablo Torres Meza in Affirmative Action to count towards good faith efforts. Juan Pablo can be reached at 608-261-9162 or by email, jtorresmeza@cityofmdison.com.

PREQUALIFICATION APPLICATION: Forms are available on our website, www.cityofmadison.com/business/pw/forms.cfm. If not currently prequalified in the categories listed in Section A, an amendment to your Prequalification will need to be submitted prior to the same due date. Postmark is not applicable.

BIDS TO BE SUBMITTED by hand to 1600 EMIL ST., MADISON, WI 53713 or online at www.bidexpress.com.

The process for submission of bids has not changed. Bids may be submitted on line through Bid Express or in person at 1600 Emil St. Please note that the doors at 1600 Emil St. are locked, but there is a sign with phone numbers on the door. Please call one of the numbers and staff will come to the door to get your bid. Until further notice, the bid openings will be closed to the public to support the guidance of social distancing as the City responds to responsively to COVID-19 impacts to services. The bids will be posted on line after the bid opening. If you have any questions, please call Alane Boutelle at 608-267-1197, or John Fahrney at 608-266-9091.

STANDARD SPECIFICATIONS

The City of Madison's Standard Specifications for Public Works Construction - 2020 Edition, as supplemented and amended from time to time, forms a part of these contract documents as if attached hereto.

These standard specifications are available on the City of Madison Public Works website, www.cityofmadison.com/Business/PW/specs.cfm.

The Contractor shall review these Specifications prior to preparation of proposals for the work to be done under this contract, with specific attention to Article 102, "BIDDING REQUIREMENTS AND CONDITIONS" and Article 103, "AWARD AND EXECUTION OF THE CONTRACT." For the convenience of the bidder, below are highlights of three subsections of the specifications.

SECTION 102.1: PRE-QUALIFICATION OF BIDDERS

In accordance with Wisconsin State Statutes 66.0901 (2) and (3), all bidders must submit to the Board of Public Works proof of responsibility on forms furnished by the City. The City requires that all bidders be qualified on a biennial basis.

Bidders must present satisfactory evidence that they have been regularly engaged in the type of work specified herein and they are fully prepared with necessary capital, materials, machinery and supervisory personnel to conduct the work to be contracted for to the satisfaction of the City. All bidders must be pre-qualified by the Board of Public Works for the type of construction on which they are bidding prior to the opening of the bid.

In accordance with Section 39.02(9)(a)l. of the General Ordinances, all bidders shall submit in writing to the Affirmative Action Division Manager of the City of Madison, a Certificate of Compliance or an Affirmative Action Plan at the same time or prior to the submission of the proof of responsibility forms.

The bidder shall be disqualified if the bidder fails to or refuses to, prior to opening of the bid, submit a Certificate of compliance, Affirmative Action Plan or Affirmative Action Data Update, as applicable, as defined by Section 39.02 of the General Ordinances (entitled Affirmative Action) and as required by Section 102.11 of the Standard Specifications.

SECTION 102.4 PROPOSAL

No bid will be accepted that does not contain an adequate or reasonable price for each and every item named in the Schedule of Unit Prices.

A lump sum bid for the work in accordance with the plans and specifications is required. The lump sum bid must be the same as the total amounts bid for the various items and it shall be inserted in the space provided.

All papers bound with or attached to the proposal form are considered a part thereof and must not be detached or altered when the proposal is submitted. The plans, specifications and other documents designated in the proposal form will be considered a part of the proposal whether attached or not.

A proposal submitted by an individual shall be signed by the bidder or by a duly authorized agent. A proposal submitted by a partnership shall be signed by a member/partner or by a duly authorized agent thereof. A proposal submitted by a corporation shall be signed by an authorized officer or duly authorized registered agent of such corporation, and the proposal shall show the name of the State under the laws of which such corporation was chartered. The required signatures shall in all cases appear in the space provided thereof on the proposal.

Each proposal shall be placed, together with the proposal guaranty, in a sealed envelope, so marked as to indicate name of project, the contract number or option to which it applies, and the name and address of the Contractor or submitted electronically through Bid Express (www.bidexpress.com). Proposals will be accepted at the location, the time and the date designated in the advertisement. Proposals received after the time and date designated will be returned to the bidder unopened.

SECTION 102.5: BID DEPOSIT (PROPOSAL GUARANTY)

All bids, sealed or electronic, must be accompanied with a Bid Bond (City of Madison form) equal to at least 5% of the bid or a Certificate of Annual/Biennial Bid Bond or certified check, payable to the City Treasurer. Bid deposit of the successful bidders shall be returned within forty-eight (48) hours following execution of the contract and bond as required.

MINOR DISCREPENCIES

Bidder is responsible for submitting all forms necessary for the City to determine compliance with State and City bidding requirements. Notwithstanding any language to the contrary contained herein, the City

may exercise its discretion to allow bidders to correct or supplement submissions after bid opening, if the minor discrepancy, bid irregularity or omission is insignificant and not one related to price, quality, quantity, time of completion or performance of the contract.

Bidders for this Contract(s) must be Pre-Qualified for at least one of the following type(s) of construction denoted by an

Building Demolition

- 101 Asbestos Removal
 120 House Mover

- 110 Building Demolition

Street, Utility and Site Construction

- 201 Asphalt Paving
 205 Blasting
 210 Boring/Pipe Jacking
 215 Concrete Paving
 220 Con. Sidewalk/Curb & Gutter/Misc. Flat Work
 221 Concrete Bases and Other Concrete Work
 222 Concrete Removal
 225 Dredging
 230 Fencing
 235 Fiber Optic Cable/Conduit Installation
 240 Grading and Earthwork
 241 Horizontal Saw Cutting of Sidewalk
 242 Infrared Seamless Patching
 245 Landscaping, Maintenance
 246 Ecological Restoration
 250 Landscaping, Site and Street
 251 Parking Ramp Maintenance
 252 Pavement Marking
 255 Pavement Sealcoating and Crack Sealing
 260 Petroleum Above/Below Ground Storage Tank Removal/Installation
 262 Playground Installer

- 265 Retaining Walls, Precast Modular Units
 270 Retaining Walls, Reinforced Concrete
 275 Sanitary, Storm Sewer and Water Main Construction
 276 Sawcutting
 280 Sewer Lateral Drain Cleaning/Internal TV Insp.
 285 Sewer Lining
 290 Sewer Pipe Bursting
 295 Soil Borings
 300 Soil Nailing
 305 Storm & Sanitary Sewer Laterals & Water Svc.
 310 Street Construction
 315 Street Lighting
 318 Tennis Court Resurfacing
 320 Traffic Signals
 325 Traffic Signing & Marking
 332 Tree pruning/removal
 333 Tree, pesticide treatment of
 335 Trucking
 340 Utility Transmission Lines including Natural Gas, Electrical & Communications
 399 Other_____

Bridge Construction

- 501 Bridge Construction and/or Repair

Building Construction

- 401 Floor Covering (including carpet, ceramic tile installation, rubber, VCT)
 402 Building Automation Systems
 403 Concrete
 404 Doors and Windows
 405 Electrical - Power, Lighting & Communications
 410 Elevator - Lifts
 412 Fire Suppression
 413 Furnishings - Furniture and Window Treatments
 415 General Building Construction, Equal or Less than \$250,000
 420 General Building Construction, \$250,000 to \$1,500,000
 425 General Building Construction, Over \$1,500,000
 428 Glass and/or Glazing
 429 Hazardous Material Removal
 430 Heating, Ventilating and Air Conditioning (HVAC)
 433 Insulation - Thermal
 435 Masonry/Tuck pointing

- 437 Metals
 440 Painting and Wallcovering
 445 Plumbing
 450 Pump Repair
 455 Pump Systems
 460 Roofing and Moisture Protection
 464 Tower Crane Operator
 461 Solar Photovoltaic/Hot Water Systems
 465 Soil/Groundwater Remediation
 466 Warning Sirens
 470 Water Supply Elevated Tanks
 475 Water Supply Wells
 480 Wood, Plastics & Composites - Structural & Architectural
 499 Other_____

State of Wisconsin Certifications

- 1 Class 5 Blaster - Blasting Operations and Activities 2500 feet and closer to inhabited buildings for quarries, open pits and road cuts.
 2 Class 6 Blaster - Blasting Operations and Activities 2500 feet and closer to inhabited buildings for trenches, site excavations, basements, underwater demolition, underground excavations, or structures 15 feet or less in height.
 3 Class 7 Blaster - Blasting Operations and Activities for structures greater than 15' in height, bridges, towers, and any of the objects or purposes listed as "Class 5 Blaster or Class 6 Blaster".
 4 Petroleum Above/Below Ground Storage Tank Removal and Installation (Attach copies of State Certifications.)
 5 Hazardous Material Removal (Contractor to be certified for asbestos and lead abatement per the Wisconsin Department of Health Services, Asbestos and Lead Section (A&LS).) See the following link for application: www.dhs.wisconsin.gov/Asbestos/Cert. State of Wisconsin Performance of Asbestos Abatement Certificate must be attached.
 6 Certification number as a Certified Arborist or Certified Tree Worker as administered by the International Society of Arboriculture
 7 Pesticide application (Certification for Commercial Applicator For Hire with the certification in the category of turf and landscape (3.0) and possess a current license issued by the DATCP)
 8 State of Wisconsin Master Plumbers License.

SECTION B: PROPOSAL

Please refer to the
Bid Express Website
at <https://bidexpress.com>
look up contract number
and go to
Section B: Proposal Page

You can access all City of Madison bid solicitations for FREE at www.bidexpress.com

Click on the "Register for Free" button and follow the instructions to register your company and yourself. You will be asked for a payment subscription preference, since you may wish to bid online someday. Simply choose the method to pay on a 'per bid' basis. This requires no payment until / unless you actually bid online. You can also choose the monthly subscription plan at this time. You will, however, be asked to provide payment information. Remember, you can change your preference at anytime. You will then be able to complete your free registration and have full access to the site. Your free access does not require completion of the 'Digital ID' process, so you will have instant access for viewing and downloading. To be prepared in case you ever do wish to bid online, you may wish to establish your digital ID also, since you cannot bid without a Digital ID.

If you have any problems with the free registration process, you can call the bidexpress help team, toll free at 1-888-352-2439 (option 1, option1).

SECTION C: SMALL BUSINESS ENTERPRISE

Instructions to Bidders City of Madison SBE Program Information

2 Small Business Enterprise (SBE) Program Information

2.1 Policy and Goal

The City of Madison reaffirms its policy of nondiscrimination in the conduct of City business by maintaining a procurement process which remains open to all who have the potential and ability to sell goods and services to the City. It is the policy of the City of Madison to allow Small Business Enterprises (SBE) maximum feasible opportunity to participate in City of Madison contracting. The bidder acknowledges that its bid has been submitted in accordance with the SBE program and is for the public's protection and welfare.

Please refer to the "ADVERTISEMENT FOR BIDS" for the goal for the utilization of SBEs on this project. SBEs may participate as subcontractors, vendors and/or suppliers, which provide a commercially useful function. The dollar value for SBE suppliers or 'materials only' vendors shall be discounted to 60% for purposes of meeting SBE goals.

A bidder which achieves or exceeds the SBE goal will be in compliance with the SBE requirements of this project. In the event that the bidder is unable to achieve the SBE goal, the bidder must demonstrate that a good faith effort to do so was made. Failure to either achieve the goal or demonstrate a good faith effort to do so will be grounds for the bidder being deemed a non-responsible contractor ineligible for award of this contract.

A bidder may count towards its attainment of the SBE goal only those expenditures to SBEs that perform a commercially useful function. For purposes of evaluating a bidder's responsiveness to the attainment of the SBE goal, the contract participation by an SBE is based on the percentage of the total base bid proposed by the Contractor. The total base bid price is inclusive of all addenda.

Work performed by an SBE firm in a particular transaction can be counted toward the goal only if it involves a commercially useful function. That is, in light of industry practices and other relevant considerations, does the SBE firm have a necessary and useful role in the transaction, of a kind for which there is a market outside the context of the SBE Program, or is the firm's role a superfluous step added in an attempt to obtain credit towards goals? If, in the judgment of the Affirmative Action Division, the SBE firm will not perform a commercially useful function in the transaction, no credit towards goals will be awarded.

The question of whether a firm is performing a commercially useful function is completely separate from the question of whether the firm is an eligible SBE. A firm is eligible if it meets the definitional criteria and ownership and control requirements, as set forth in the City of Madison's SBE Program.

If the City of Madison determines that the SBE firm is performing a commercially useful function, then the City of Madison must then decide what that function is. If the commercially useful function is that of an SBE vendor / supplier that regularly transacts business with the respective product, then the City of Madison will count 60% of the value of the product supplied toward SBE goals.

To be counted, the SBE vendor / supplier must be engaged in selling the product in question to the public. This is important in distinguishing an SBE vendor / supplier, which has a regular trade with a variety of customers, from a firm which performs supplier-like functions on an ad hoc basis or for only one or two contractors with whom it has a special relationship.

A supplier of bulk goods may qualify as an eligible SBE vendor / supplier if it either maintains an inventory or owns or operates distribution equipment. With respect to the distribution equipment; e.g., a fleet of trucks, the term "operates" is intended to cover a situation in which the supplier leases the equipment on a regular basis for its entire business. It is not intended to cover a situation in which the firm simply provides drivers for trucks owned or leased by another party; e.g., a prime contractor, or leases such a party's trucks on an ad hoc basis for a specific job.

If the commercially useful function being performed is not that of a qualified SBE vendor / supplier, but rather that of delivery of products, obtaining bonding or insurance, procurement of personnel, acting as a broker or manufacturer's representative in the procurement of supplies, facilities, or materials, etc., only the fees or commissions will apply towards the goal.

For example, a business that simply transfers title of a product from manufacturer to ultimate purchaser; e. g., a sales representative who re-invoices a steel product from the steel company to the Contractor, or a firm that puts a product into a container for delivery would not be considered a qualified SBE vendor / supplier. The Contractor would not receive credit based on a percentage of the cost of the product for working with such firms.

Concerning the use of services that help the Contractor obtain needed supplies, personnel, materials or equipment to perform a contract: only the fee received by the service provider will be counted toward the goal. For example, use of a SBE sales representative or distributor for a steel company, if performing a commercially useful function at all, would entitle the Contractor receiving the steel to count only the fee paid to the representative or distributor toward the goal. This provision would also govern fees for professional and other services obtained expressly and solely to perform work relating to a specific contract.

Concerning transportation or delivery services: if an SBE trucking company picks up a product from a manufacturer or a qualified vendor / supplier and delivers the product to the Contractor, the commercially useful function it is performing is not that of a supplier, but simply that of a transporter of goods. Unless the trucking company is itself the manufacturer or a qualified vendor / supplier in the product, credit cannot be given based on a percentage of the cost of the product. Rather, credit would be allowed for the cost of the transportation service.

The City is aware that the rule's language does not explicitly mention every kind of business that may contribute work on this project. In administering these programs, the City would, on a case-by-case basis, determine the appropriate counting formula to apply in a particular situation.

2.2 Contract Compliance

Questions concerning the SBE Program shall be directed to the Contract Compliance Officer of the City of Madison Department of Civil Rights, Affirmative Action Division, 210 Martin Luther King, Jr. Blvd., Room 523, Madison, WI 53703; telephone (608) 266-4910.

2.3 Certification of SBE by City of Madison

The Affirmative Action Division maintains a directory of SBEs which are currently certified as such by the City of Madison. Contact the Contract Compliance Officer as indicated in Section 2.2 to receive a copy of the SBE Directory or you may access the SBE Directory online at www.cityofmadison.com/civil-rights/contract-compliance/targeted-business-enterprise-programs/targeted-business-enterprise.

All contractors, subcontractors, vendors and suppliers seeking SBE status must complete and submit the **Targeted Business Certification Application** to the City of Madison Affirmative Action Division by the time and date established for receipt of bids. A copy of the Targeted Business Certification Application is available by contacting the Contract Compliance Officer at the address and telephone indicated in Section 2.2 or you may access the Targeted Business Certification Application online at www.cityofmadison.com/civil-rights/contract-compliance/targeted-business-enterprise-programs/targeted-business-enterprise. Submittal of the Targeted Business Certification Application by the time specified does not guarantee that the applicant will be certified as a SBE eligible to be utilized towards meeting the SBE goal for this project.

2.4 Small Business Enterprise Compliance Report

2.4.1 Good Faith Efforts

Bidders shall take all necessary affirmative steps to assure that SBEs are utilized when possible and that the established SBE goal for this project is achieved. A contractor who self performs a portion of the work, and is pre-qualified to perform that category of work, may subcontract that portion of the work, but shall not be required to do so. When a bidder is unable to achieve the established SBE goal, the bidder must demonstrate that a good faith effort to do so was made. Such a good faith effort should include the following:

- 2.4.1.1 Attendance at the pre-bid meeting.
- 2.4.1.2 Using the City of Madison's directory of certified SBEs to identify SBEs from which to solicit bids.
- 2.4.1.3 Assuring that SBEs are solicited whenever they are potential sources.
- 2.4.1.4 Referring prospective SBEs to the City of Madison Affirmative Action Division for certification.
- 2.4.1.5 Dividing total project requirements into smaller tasks and/or quantities, where economically feasible, to permit maximum feasible SBE participation.
- 2.4.1.6 Establishing delivery schedules, where requirements permit, which will encourage participation by SBEs.
- 2.4.1.7 Providing SBEs with specific information regarding the work to be performed.
- 2.4.1.8 Contacting SBEs in advance of the deadline to allow such businesses sufficient time to prepare a bid.
- 2.4.1.9 Utilizing the bid of a qualified and competent SBE when the bid of such a business is deemed reasonable (i.e. 5% above the lowest bidder), although not necessarily low.
- 2.4.1.10 Contacting SBEs which submit a bid, to inquire about the details of the bid and confirm that the scope of the work was interpreted as intended.
- 2.4.1.11 Completion of Cover Page (page C-6), Summary Sheet (page C-7) and SBE Contact Reports (pages C-8 and C9) if applicable.

2.4.2 Reporting SBE Utilization and Good Faith Efforts

The Small Business Enterprise Compliance Report is to be submitted by the bidder with the bid: This report is due by the specified bid closing time and date. Bids submitted without a completed SBE Compliance Report as outlined below may be deemed non-responsible and the bidder ineligible for award of this contract. Notwithstanding any language to the contrary contained herein, the City may exercise its discretion to allow bidders to correct or supplement submissions after bid opening, if the minor discrepancy, bid irregularity or omission is insignificant and not one related to price, quality, quantity, time of completion, performance of the contract, or percentage of SBE utilization.

2.4.2.1 If the Bidder meets or exceeds the goal established for SBE utilization, the Small Business Enterprise Compliance Report shall consist of the following:

- 2.4.2.1.1 **Cover Page**, Page C-6; and
- 2.4.2.1.2 **Summary Sheet**, C-7.

2.4.2.2 If the bidder does not meet the goal established for SBE utilization, the Small Business Enterprise Compliance Report shall consist of the following:

- 2.4.2.2.1 **Cover Page**, Page C-6;
- 2.4.2.2.2 **Summary Sheet**, C-7; and
- 2.4.2.2.3 **SBE Contact Report**, C-8 and C-9. (A separate Contact Report must be completed for each applicable SBE which is not utilized.)

2.5 Appeal Procedure

A bidder which does not achieve the established goal and is found non-responsible for failure to demonstrate a good faith effort to achieve such goal and subsequently denied eligibility for award of contract may appeal that decision to the Small Business Enterprises Appeals Committee. All appeals shall be made in writing, and shall be delivered to and received by the City Engineer no later than 4:30 PM on the third business day following the bidder's receipt of the written notification of ineligibility by the Affirmative Action Division Manager. Postmark not acceptable. The notice of appeal shall state the basis for the appeal of the decision of the Affirmative Action Division Manager. The Appeal shall take place in accordance with Madison General Ordinance 33.54.

2.6 SBE Requirements After Award of the Contract

The successful bidder shall identify SBE subcontractors, suppliers and vendors on the subcontractor list in accordance with the specifications. The Contractor shall submit a detailed explanation of any variances between the listing of SBE subcontractors, vendors and/or suppliers on the subcontractor list and the Contractor's SBE Compliance Report for SBE participation.

No change in SBE subcontractors, vendors and/or suppliers from those SBEs indicated in the SBE Compliance Report will be allowed without prior approval from the Engineer and the Affirmative Action Division. The contractor shall submit in writing to the City of Madison Affirmative Action Division a request to change any SBE citing specific reasons which necessitate such a change. The Affirmative Action Division will use a general test of reasonableness in approving or rejecting the contractor's request for change. If the request is approved, the Contractor will make every effort to utilize another SBE if available.

The City will monitor the project to ensure that the actual percentage commitment to SBE firms is carried out.

2.7 SBE Definition and Eligibility Guidelines

A Small Business Enterprise is a business concern awarded certification by the City of Madison. For the purposes of this program a Small Business Enterprise is defined as:

- A. An independent business operated under a single management. The business may not be a subsidiary of any other business and the stock or ownership may not be held by any individual or any business operating in the same or a similar field. In determining whether an entity qualifies as a SBE, the City shall consider all factors relevant to being an independent business including, but not limited to, the date the business was established, adequacy of its resources for the work in which it proposes to involve itself, the degree to which financial, equipment leasing and other relationships exist with other ineligible firms in the same or similar lines of work. SBE owner(s) shall enjoy the customary incidents of ownership and shall share in the risks and profits commensurate with their enjoyment interests, as demonstrated by an examination of the substance rather than form or arrangements that may be reflected in its ownership documents.
- B. A business that has averaged no more than \$4.0 million in annual gross receipts over the prior three year period and the principal owner(s) do not have a personal net worth in excess of \$1.32 million.

Firm and/or individuals that submit fraudulent documents/testimony may be barred from doing business with the City and/or forfeit existing contracts.

SBE certification is valid for one (1) year unless revoked.

SECTION D: SPECIAL PROVISIONS
2020 PARKING GARAGE MAINTENANCE
CONTRACT NO. 8885

It is the intent of these Special Provisions to set forth the final contractual intent as to the matter involved and shall prevail over the Standard Specifications and plans whenever in conflict therewith. In order that comparisons between the Special Provisions can be readily made, the numbering system for the Special Provisions is equivalent to that of the Specifications.

Whenever in these Specifications the term "Standard Specifications" appears, it shall be taken to refer to the City of Madison Standard Specifications for Public Works Construction and Supplements thereto.

SECTION 102.11: BEST VALUE CONTRACTING

This Contract shall be considered a Best Value Contract if the Contractor's bid is equal to or greater than \$63,500 for a single trade contract; or equal to or greater than \$311,500 for a multi-trade contract pursuant to MGO 33.07(7).

ARTICLE 109.2 PROSECUTION OF WORK

The Contractor is made aware that the start work date listed in the special provisions may be delayed, due to concerns and problems addressing the effects of COVID-19. This change is at the discretion of the Engineer.

TABLE OF CONTENTS
2020 PARKING GARAGE MAINTENANCE
CONTRACT NO. 8885

DIVISION 01 - GENERAL

GENERAL REQUIREMENTS 01 00 00
UNIT PRICES 01 22 00
QUANTITY SUMMARY 01 22 00 - 6

DIVISION 03 - CONCRETE

CONCRETE RESTORATION FOR PARKING STRUCTURES 03 01 07
STRUCTURAL CONCRETE FOR PARKING STRUCTURES 03 31 07
CRACK INJECTION REPAIRS FOR PARKING STRUCTURES 03 64 07

DIVISION 04 - MASONRY

MAINTENANCE OF MASONRY 04 01 01
MASONRY MORTARING AND GROUTING 04 05 14

DIVISION 05 - METALS

METAL FABRICATION 05 50 00

DIVISION 07 – THERMAL AND MOISTURE PROTECTION

TRAFFIC COATINGS 07 18 00
CLEAR PENETRATING SEALERS 07 19 00
WATER REPELLENTS FOR PARKING STRUCTURES 07 19 07
SHEET METAL FLASHING AND TRIM 07 62 00
JOINT PROTECTION FOR PARKING STRUCTURES 07 90 07
TRAFFIC JOINT EXPANSION ASSEMBLIES FOR PARKING STRUCTURES 07 95 07

DIVISION 09 - FINISHES

CLEANING AND REPAINTING STRUCTURAL STEEL 09 97 13

DRAWING LIST

CITY OF MADISON – 2020 PARKING GARAGE MAINTENANCE (48 SHEETS)

END OF SECTION

SECTION 01 00 00
GENERAL REQUIREMENTS

PART 1 - GENERAL

1.1 SECTION SUMMARY

- A. Section Includes:
1. Section Summary
 2. Work Covered by Contract Documents
 3. Contractor's Duties
 4. Contracts
 5. Time of Completion and Liquidated Damages
 6. Work Sequence
 7. Contractor Use of Public Rights-Of-Way
 8. Contractor Use of Premises
 9. Definitions
 10. Measurement of Quantities
 11. Project Meetings
 12. Job Site Administration
 13. Submittals
 14. Temporary Utilities
 15. Traffic/Dust/Debris
 16. Special Controls
 17. Parking
 18. Security
 19. Cleaning
 20. Project Closeout
 21. Record Drawings

1.2 WORK COVERED BY CONTRACT DOCUMENTS

- A. This work covers repairs at the Government East (GE), Capitol Square North (CSN), State Street Capitol (SSCo), State Street Campus-Lake (SSCL), State Street Campus-Frances (SSCF), and Overture Center (OC) parking ramps in Madison, Wisconsin. Work includes concrete repair of slabs, columns, and beams, joint repairs, sealant replacement at slab cracks and joints, expansion joint replacement, membrane repair and placement, grit-blast and paint steel and concrete, and repair cracked stair treads.
- B. The repair work to be done is shown on the plans/details and described in these specifications.
- C. Ramp construction:
1. Capitol Square North (CSN): post-tensioned cast-in-place concrete.
 2. Overture Center (OC) Ramp: post-tensioned cast-in-place concrete.
 3. State Street Campus Lake (SSCL): mild steel reinforced cast-in-place concrete.
 4. State Street Campus Frances (SSCF):
 - a. Post-tensioned cast-in-place concrete (levels 1-2)
 - b. Precast concrete (levels 3-5)

5. State Street Capitol (SSCo):
 - a. Mild steel reinforced cast-in-place concrete (levels 1-3)
 - b. Post-tensioned cast-in-place concrete (levels 4-6)

1.3 CONTRACTOR'S DUTIES

- A. Except as specifically noted, provide and pay for:
 1. Labor, materials, and equipment.
 2. Tools, construction equipment, and machinery.
 3. Water, heat, and utilities required for construction not part of the existing ramp system.
Other facilities and services necessary for proper execution and completion of work.
- B. Pay legally required sales, consumer and use taxes. Secure and pay for, as necessary for proper execution and completion of work and as applicable at time of receipt for bids:
 1. Permits
 2. Government fees
 3. Licenses
- C. Give required notices.
- D. Comply with codes, ordinances, rules, regulations, orders and other legal requirements of public authorities, which bear on performance of work.
- E. Contractor is responsible for complying with City Affirmative Action and Best Value Engineering requirements.
- F. Promptly submit written notice to Engineer of observed variance of Contract Documents from legal requirements. It is not Contractor's responsibility to make certain that drawings and specifications comply with codes and regulations.
- G. Appropriate modifications to Contract Documents will adjust necessary changes.
- H. Assume responsibility for work known to be contrary to such requirements, without notice.
- I. Enforce strict discipline and good order among employees. Do not employ on work, unfit persons or persons not skilled in assigned task.

1.4 CONTRACTS

- A. Construct work under a unit price contract with unit prices included to account for changes in the quantity of work from that estimated. Review proposal form for work to be completed as Lump Sum.

1.5 TIME OF COMPLETION AND LIQUIDATED DAMAGES

- A. Construction is anticipated to start on or before June 30, 2020, and to be completed by October 31, 2020.
- B. The successful Contractor must agree to commence work on a date to be specified in a written Notice to Proceed and to fully complete by dates specified.

- C. Liquidated damages for failure to complete construction by given date shall be as stated in the third paragraph of Section 109.9 of the City of Madison Standard Specifications for Public Works Construction – most current year.
- D. Completion shall include all construction as outlined in the plans and specifications as well as removal of all materials, debris, barricades, and other construction related items from the site.
- E. Final project closeout shall be completed within 30 days of the construction completion date for all work addressed above. Final project closeout shall include, but not be limited to, submittal of warranties, lien waivers, wage rate compliance affidavits, documents of completed work, and proper pay applications
- F. Each day shall be defined as a twenty-four (24) hour period beginning at 12:01 a.m.

1.6 WORK SEQUENCE

- A. The Contractor will be allowed 70 parking stalls out of service at each ramp for the work. This will include the top side of the deck being restored and the level below. The parking structure will be open during the weekends. Additional parking spaces may be made available upon request and will be reviewed on a case by case basis. The Contractor shall make as many spaces available as possible other than those designated for restoration.
- B. No parking or traffic will be allowed above areas being restored on the underside of the slab or below the areas being restored on the topside of the slab. This area will be included in the Contractor's work area. Contractor shall keep ramp attendant and cashier informed about the number of parking stalls out of service.
- C. Contractor shall conduct their work between the hours of 7:00 a.m. and 7:00 p.m. Monday through Friday unless written request for special circumstances is acceptable to the Owner. Contractor shall plan work and make request in writing at least seven days prior to deviation from normal.
- D. Concrete pours shall be scheduled between 9:00 a.m. and 2:30 p.m. to avoid conflicts with peak hour traffic. Contractor shall provide the Engineer and Owner with their schedule for concrete pours.
- E. Dust protection must be in place prior to beginning work; refer to Traffic/Dust/Debris section (1.15).
- F. Prior to the weekend, the Contractor shall clean the site adequately and secure equipment to prevent vandalism, personal injury, or theft.
- G. The Contractor will be asked to reduce the number and type of parking spaces out of service for Special Events dates. The City will provide the Contractor with a schedule of dates. These dates will include but not be limited to Art Fair on the Square, IronMan, Taste of Madison, Mad City Marathon, Maxwell Street Days, and Freakfest (Halloween).
- H. Prior to start of work, the Contractor shall survey the existing utilities within and around the structure. Existing utilities include electrical lighting and conduits, water piping including sprinklers, and mechanical duct work. Existing utilities that are broken shall be brought to the

attention of the Engineer. The Contractor at the Contractor's expense shall remove and/or protect in place existing utilities. Existing utilities damaged by the Contractor shall be replaced by the Contractor at the Contractor's expense.

- I. Prior to the start of work, the Contractor in the presence of the Engineer and Owner shall inspect the condition of the drains in areas affected by the Contractor's work to determine that they are clean and in proper working order. During and at the completion of the project, the drains shall be in similar condition and working order as observed in the initial inspection.

1.7 CONTRACTOR USE OF PUBLIC RIGHTS-OF-WAY

- A. The General Contractors proposed use of the site may require a Street Occupancy Permit.
- B. The General Contractor shall make application for a Street Occupancy Permit before proceeding with work in any public right-of-way. At the time of application for a Street Occupancy Certificate, the Contractor shall provide a drawing showing construction site fencing, construction entrances, proposed placement of equipment, and traffic routing.
- C. A copy of the Street Occupancy Permit shall be at the job site during working hours.
- D. Peak hour traffic flow in Madison occurs between the hours of 7:00 a.m. and 8:30 a.m. and between 3:30 p.m. and 5:30 p.m., Monday through Friday. During these hours work that will interfere with the flow of traffic shall not be permitted on or in the street governed by this permit.
- E. All signing or barricading shall be done in conformance with the Federal "Uniform Manual on Traffic Control Devices".
- F. All pavement markings removed, disturbed or damaged shall be restored or replaced, in kind, by the City at the expense of the City.
- G. For removal or replacement of traffic and parking signs, contact the City of Madison Traffic Engineering Field Operations, 1120 Sayle Street 266-4767, 8:00 a.m. - 4:00 p.m., 24 hours in advance of when you need the sign removed. This service is provided free of charge. If you remove the signs, you will be billed for reinstallation and any damage to the sign installation.
- H. NO MATERIALS shall be stored in the street or street right-of-way.
- I. A fence may be required around the occupancy area and the construction site depending on the Contractor's intended use. The occupancy area shall be considered part of the construction site. No stopping, standing or parking signs shall be installed, by the Contractor, on the fence surrounding the construction site.
- J. A clean, safe access route shall be provided to the parking ramp at all locations desired by the City of Madison, Parking Utility.
- K. "Sidewalk Closed Use Other Side" signs shall be installed at each end of the block when a portion of the block is closed to pedestrian traffic.

1.8 CONTRACTOR USE OF PREMISES

- A. Confine operations at the site to areas permitted by law, ordinance, permits, and contract documents.
- B. Do not unreasonably encumber site with materials and equipment.
- C. Do not load structure with weight that will endanger structure.
- D. Assume full responsibility for protection and safekeeping of products stored on the premises. Construction equipment, shoring, tools, etc., shall not be stored in areas of the Owner's continued use.
- E. Move any stored products which interfere with operations of Owner or other Contractor.
- F. There is no storage for materials outside of Contractor's work area.

1.9 DEFINITIONS

- A. CONTRACT DOCUMENTS - Contract documents for this project include but are not limited to:
 - 1. Specifications and Drawings for "City of Madison 2020 Parking Garage Maintenance".
 - 2. General Conditions, which are included in the Standard Specifications for Public Works Construction, most current year, of the City of Madison, Department of Public Works. The Standard Specifications described above are available online at <https://www.cityofmadison.com/business/pw/specs.cfm>
 - 3. Architectural and structural drawings for the original construction. Drawings are available for review at the City Department of Transportation office, Room 100, Madison Municipal Building, Madison, WI 53701.
- B. UNSOUND CONCRETE - Concrete which contains internal and/or surface cracking or loss of density, and which in the judgment of the Engineer is detrimental to the strength and serviceability of the structure. Unsound concrete is also associated with concrete surface spalling and crumbling, infiltration of moisture and salts, corrosion of reinforcement, rust staining, increased porosity, and reduced strength.
- C. DELAMINATION - Planar cracking of concrete usually initiated by bursting stresses due to expansion of corrosion by-products of embedded reinforcing.
- D. SOUND CONCRETE - Firm, dense, homogeneous concrete which contains in the judgment of the Engineer no significant detriments to its strength or serviceability.
- E. REMOVAL - Removal of unsound and sound concrete, epoxy patches and asphalt using chipping hammers or other means.
- F. SCARIFYING - The process of making numerous cuts into a concrete surface, which results in fracturing the cement paste and aggregate, exposing a new roughened surface free of contaminants.
- G. SLAB - Flat, horizontal or ramped layers of reinforced concrete which spans and is supported by columns, beams or walls.

- H. SUPPORT BARS - Reinforce bars used to support the main reinforcing bars and not shown on the original drawings as main reinforcing bars themselves.
- I. DRAWINGS - Graphical description of the work to be performed, designated.
- J. SPECIFICATIONS - Written description of the work to be performed, designated.

1.10 MEASUREMENT OF QUANTITIES

- A. Work to be performed on a unit price basis shall be measured according to the quantities described in the above work items. Payment will be made for work actually performed, based on quantities recorded by the Contractor and approved by the Engineer. Records described below shall be maintained using a Geographical Information System Database, referred to hereinafter as GIS, provided by the Engineer. Unless otherwise stated, the Engineer will verify the accuracy of the record by visual examination of the work performed and measuring the quantities with a measuring tape, wheel, or other appropriate device.
- B. The Contractor shall notify the Owner and the Engineer at once in writing of any unit price work that deviates materially from the prescribed basis for bidding and for which an adjustment in Unit Price is desired. The Contractor shall measure and quantify all such deviations, subject to the Engineer's verification, prior to any repair work which might make verification impossible. No adjustments in Unit Prices will be considered unless supporting field measurements are provided, and subject to the Owner's prior approval. Adjustments will only be considered if all repairs of a given type have been measured and all deviations, both plus and minus have been included in the determination of the average deviation from the Unit Price basis.
- C. Removal of top and underside of slab, beams, columns/walls, and joist stem concrete:
 - 1. The Contractor shall maintain a record of the location and quantity of concrete removed, identified by unit price item. This record shall be submitted to the Engineer on a weekly basis. Quantities shall be recorded digitally via GIS.
- D. Placing replacement and supplemental reinforcing:
 - 1. The Contractor shall maintain a record of the location and quantity of reinforcement placed. This record shall show the quantity and size placed. Replacement and supplemental reinforcement shall be documented in the existing GIS Repair Identifier (Point, Line or Area) for which the repair is performed. This record shall be submitted to the Engineer on a weekly basis via GIS.
- E. Installation of slab crack and joint sealant:
 - 1. The Contractor shall maintain a record of the location and quantity of cracks and joints sealed via GIS.
- F. Placement of Traffic Coatings:
 - 1. The Contractor shall maintain a record of the areas of traffic coating placement via GIS. This is to include areas receiving the Full Membrane System and those that receive the Wear Coat and Top Coat.

1.11 PROJECT MEETINGS

- A. Pre-Bid Meeting:

1. Refer to Section A: Advertisement for Bids and Instructions to Bidders
- B. Pre-Construction Meeting:
1. Soon after award of Contract and prior to the start of construction, each Prime Contractor shall attend a pre-construction conference with representatives of the Owner and Engineer.
 2. The Contractor shall have at the meeting responsible representatives from subcontractors who are to perform the work.
 3. The Contractor shall submit the following information at the Pre-Construction Meeting:
 - a. Construction Schedule
 - b. List of Sub-Contractors
 - c. Procedures for demolition
 - d. Procedures for dust control
 - e. Procedures for noise control
 4. The Engineer shall provide instruction of procedures for the usage of GIS.
 5. The Construction Schedule submitted by the Contractor shall describe in detail when each portion of the work is to be accomplished and subcontractors shall participate in the discussion. The Engineer will serve to interpret the Contract Documents should such questions arise. A representative of the Owner may also be present to discuss work to be completed by others in conjunction with this project and the Owner's partial occupancy and use of the garage during construction.
 6. Any other questions that the Contractor or subcontractors have about the work or its scheduling shall be raised at this meeting.
 7. Requirements for contract administration and construction operations will be defined for participants.
 8. Prepare in reproducible form approved by the Engineer and include:
 - a. Breakdown of work activities in categories approved by Engineer, segmented as necessary to allow close monitoring of progress of the work during construction.
 - b. Order of work necessary to meet Time for Completion.
 - c. Breakdown of the work of all Subcontractors scheduled in cooperation with the Contractor's work.
 - d. Signatures of all Contractors.
 - e. Space for the additional display of actual performance on the schedule.
 9. After necessary revisions and approval by the Engineer, provide two prints of project construction schedule to the Engineer.
 10. Time, date, and place of the meeting will be determined by the Engineer.
- C. Progress Meetings:
1. Bi-weekly project meetings will be held at the project site by the Engineer's representative and Owner's representative for the purpose of coordinating and expediting the Work progress.
 2. Attendance at project meetings by all Prime Contractors, or their authorized representative, is mandatory.
 3. Date and time of the meetings will be determined at the pre-construction meeting.
 4. Contractors shall give verbal reports of progress on the project, discuss the work schedule for the coming period and present all conflicts, discrepancies, or other difficulties for resolution.
 5. Upon request of the Engineer, the contractor shall update the schedule to reflect changes required by actual conditions and indicate actual work completed. Provide the Engineer with same number of copies as required for original submission.
 6. Show changes occurring since previous submission of schedule such as:

- a. Major changes in scope.
 - b. Activities modified since previous submission.
 - c. Revised projections of progress and completion.
 - d. Other identifiable changes.
7. Provide a narrative report as needed to define:
 - a. Problem areas, anticipated delays, and the impact on the schedule.
 - b. Corrective action recommended, and its effect.
 - c. The effect of changes in schedules of other Prime Contractors.
 8. Where work is not performed according to the Construction Schedule, a short narrative should be written by the contractor describing the cause of delay and intended action to remedy the delay.
 9. When the work performed is not meeting the construction schedule, the Engineer may request that the contractor increase the labor and equipment being furnished in order to meet the schedule. Should the contractor choose not to follow the engineer's request he shall provide a written submittal explaining how the schedule is to be met without an increase in labor and equipment.
 10. Meeting minutes will be distributed within two (2) business days of the meeting by the Engineer and will serve as the meeting agenda for the next progress meeting.

1.12 JOB SITE ADMINISTRATION

- A. The Contractor shall always have at the site of the work, while work is in progress, a superintendent or foreman having authority both to receive orders from the Engineer and to act for the Contractor.
- B. The Engineer will have a representative on-site eight (8) hours per week on average during progress of the work.
- C. The Engineer's inspections and project coordination shall take place between regular business hours of 7 a.m. to 5 p.m. The Contractor will take all necessary steps to allow the Engineer to carry out the Engineer's duties without interference by noise, dust, or other construction activities.

1.13 SUBMITTALS

- A. General:
 1. Refer to General Conditions for basic requirements for all submittals.
 2. Refer to technical specifications for all submittals required.
- B. Submittal Requirements:
 1. Project information shall be first sent to the Engineer.
 2. Schedule submittals at least 14 days before the time that reviewed and approved submittals will be needed.
 3. Accompany submittals with transmittal letter containing the date, project title and number, Contractor's name and address, the quantity of items submitted, notifications of any deviations from Contract Documents, the Section of Work and other pertinent data.
- C. Schedules:
 1. Refer to Project Meetings.

- D. Subcontractor and Materials List:
1. The Subcontractor and major suppliers list shall be submitted on or before the first pre-construction meeting.
 2. The Engineer will promptly review list and indicate in writing approval or disapproval of subcontractors and/or materials. Resubmit revised list, upon disapproval of any item, until such time as approval of all items has been obtained from the Engineer.
 3. Use of unspecified or unapproved materials and equipment will not be permitted.
- E. Schedule of Values:
1. Before the first Application for Payment, the Contractor shall submit to the Engineer a schedule of values of the various portions of the Work, including quantities if required by the Engineer, aggregating the total Contract Sum, divided to facilitate payments to Subcontractors.
 2. Prepare a schedule of values in such form and supported by such substantiating data as the Engineer may require. Each item in the schedule of values shall include its proper share of overhead and profit. This schedule, when approved by the Engineer, shall be used only as a basis for the Contractor's Applications for Payment.
- F. Material Safety Data Sheets:
1. Contractor shall submit Material Safety Data Sheets for all products (sealants, concrete, etc.) they intend to use on the project.
- G. Test Reports and Data:
1. Submit test reports and data where required by technical specifications. Results of testing, including concrete cylinder breaks, shall be submitted to the Contractor and the Engineer.
- H. Application for Payment:
1. For each progress payment (no more frequent than once a month) the Engineer shall supply a summary of completed repair items, by ramp, to the Contractor for the designated billing period as documented via GIS. A repair shall be considered complete when the Repair Identifier (Point, Line or Area) and "Quantity Installed" contained therein is approved by the Engineer. Work not complete at the time of the itemized Application for Payment submittal will not be included in that payment. Contractor shall use AIA Documents G702 and G703 Application and Certificate for Payment or similar.
- I. Record Drawings:
1. Usage of GIS by the Contractor for all repairs shall constitute a Record Drawing submission. Each Repair Identifier (Point, Line or Area) shall include, at a minimum, the quantity of repair completed and date of completion.
 2. At time of final acceptance and prior to final payment, all Repair Identifiers (Points, Lines or Areas) designated for repair shall be populated by the Contractor with the requisite information as stipulated by the Engineer.
- J. Guarantees, Warranties, and Certificates:
1. Submit all guarantees, warranties, and certificates to the Engineer prior to final payment.

1.14 TEMPORARY UTILITIES

- A. The Contractor shall arrange for, obtain and pay for all temporary utilities necessary to complete the work except as stated otherwise in these specifications.

- B. WATER: The Owner, during non-freezing conditions, will provide needed water for the Contractor's use. This shall consist of the existing water supply in the ramp. Water requirements beyond what is supplied in the garage shall be the responsibility of the Contractor and paid for by the Contractor. Water shall be used prudently. Connections are the responsibility of the Contractor.
 - 1. The Contractor shall not permit water to run uncontrolled off of their work site or be carried airborne off the site or onto vehicles and persons occupying part of the site. To prevent this, suitable enclosures shall be provided.
 - 2. The Contractor shall meet the DNR waste water regulations for construction site runoff requirements.
- C. ELECTRICAL AND LIGHTING: The Contractor shall provide all temporary electric power and connections necessary for the Contractor's work. The Contractor can use the existing 110/220 volt service in the ramp. The Owner will provide the existing lighting. Supplementary lighting, if necessary, shall be provided by the Contractor.
- D. DRAINS, SUMPS AND SEWERS: The Contractor shall not permit debris, or other deleterious contaminants to be washed down drains within the garage and be discharged into the City sewer system. The Contractor shall meet the DNR waste water regulations of 40 milligrams of solids per liter measured at the discharge from the sump pit. The Contractor shall provide filters, settling tanks or other methods necessary to meet these requirements.
- E. TELEPHONE: The Contractor shall provide temporary telephone service to the job site. This service shall consist of at least a cellular phone for the Contractor's purpose.
- F. TOILETS: The Contractor shall provide and maintain suitable, weather tight, sanitary toilet facilities for all workers during construction period. When toilet facilities are no longer required, promptly remove from site, disinfect, and clean or treat the area as required.
 - 1. The Contractor shall keep all toilet facilities clean and supplied with toilet tissue at all times. Maintain facilities in accordance with requirements of applicable building codes.
- G. PROJECT SIGN: No individual advertising signs, plaques or credits, temporary or permanent, will be permitted on the building or premises, except the name of each contractor on their office or material shed.
- H. EXPLOSIVES: Use of explosives, for any purpose, is prohibited.
- I. FIRST AID: The Contractor shall provide temporary first-aid facilities on the site.
- J. FIRE PROTECTION: The Contractor shall provide temporary fire protection as required by federal, state, and local laws and ordinances.

1.15 TRAFFIC/DUST/DEBRIS

- A. The Contractor shall provide personnel, signs, barricades, lights and warning devices to control the orderly flow of traffic, both inside and outside of the garage where needed, and prevent pedestrians and cars from entering areas of the Contractor's operations. The traffic devices shall meet the requirements of the U.S. Department of Transportation Manual on Uniform Traffic Control Devices.

- B. The Owner will continue to use the building during the renovation. The Contractor must schedule and arrange the work so as to maintain access to undisturbed parking areas. Short interruptions in traffic flow may be permitted but must be scheduled and written approval given by the Engineer seven (7) days prior to the planned interruption. During these interruptions, the Contractor shall provide personnel and signage to direct traffic within the structure.
- C. Traffic control signs may be necessary several bays removed from the actual work area to maintain an orderly flow of traffic. The Owner shall make the final determination as to the required limit of traffic control.
- D. The Contractor shall move these signs, barricades, lights and warning devices as necessary as the location of the work within the garage changes and previously worked-in areas are occupied by the Owner.
- E. Contractor will provide appropriate signage warning the public of the construction area and directing them to exits. They shall provide and maintain necessary walkway with appropriate protective railings and enclosures required to prevent bodily injury to the public and maintain normal public usage during course of construction.
- F. The General Contractor shall provide temporary barriers around areas of overhead removal to prevent damage or injury from flying debris associated with this work. Barriers shall consist of plywood screen walls or reinforced polyethylene extending from the top of floor to the underside of the floor above and supported by steel post shores or Ellis post shores.
- G. Where possible, hoses, electrical cords, etc. shall be located overhead. Whenever such items are located in traffic paths, plywood coverings with adequate signs shall be provided.
- H. General Contractor shall provide and maintain necessary safe passage through the areas being restored to prevent bodily injury to the public and to maintain normal public usage during course of construction. Engineer's approval required for all proposed temporary exit ways or walkways.
- I. The Contractor shall erect temporary enclosures around the area of work, including areas adjacent to stairwells, driving lanes, parapets, walkways, etc. The Contractor shall provide adequate protection to prevent damage or injury from flying debris associated with this work. Barriers shall consist of plywood screen walls or reinforced polyethylene extending from the top of floor to the underside of the floor above and supported by steel post shores or Ellis post shores.
- J. Dust protection is required around work area and shall be fastened tight to the floor and ceiling above. Flexible duct work or similar shall be used in addition to fans to vent work areas to the outside. Exhaust air shall be filtered, and filters maintained to prevent escaping dust. Dust protection must be in place prior to any concrete removal.
- K. The Contractor shall be responsible for maintaining any means of egress required by governing codes, for the continued use of the parking facility. Enclosures which limit the means of egress from the structure shall have provisions for emergency egress through the partitions.
- L. Dust filters shall be erected to limit dust being carried from the site. Contractor shall use crack router with vacuum attachment to eliminate dust from this process. Water shall be used during concrete removal, sawing, etc. to hold down dust.

- M. Removal areas need to be covered during times contractor is not present to prevent pedestrians from entering Contractor's area of work. Removal areas in public pathways shall be covered with steel plates.
- N. The Contractor shall maintain access to undisturbed parking areas throughout the concrete restoration and membrane placement.
- O. All Contractors shall comply with applicable OSHA regulations.
- P. All plastic sheeting shall be new or like new with no holes or rips that will allow the escape of dust. Plastic sheeting shall be replaced when it becomes torn.
- Q. All plastic sheeting shall conform to NFPA 701.

1.16 SPECIAL CONTROLS

- A. **NOISE CONTROL:** Contractor shall confine hours of work from 7:00 a.m. to 7:00 p.m. Monday through Friday except holidays. Noise levels shall be held to a minimum at all times considering the nature of the work and are subject to City ordinance.
 - 1. Contractor shall erect noise control around work areas for primary goal of minimizing construction work noise affecting the parking attendant's booth. Noise control shall consist of insulating blankets, batt insulation, or other similar means. Noise control shall be erected along edge of work area directly in line with attendant booths and shall return along the work area a distance sufficient in controlling the construction noise.
 - 2. The Contractor shall erect sound barriers around all equipment including air compressors that will sit outside the ramp.
- B. **SPECIAL RESPONSIBILITIES:** The Contractor shall be responsible for damages to vehicles in or near the garage, resulting from their operations. The Contractor shall settle claims within 30 days of receipt of claim.
- C. **POLLUTION CONTROL:** All internal combustion engines used in the Contractor's work and operating in a fixed location while running shall have their exhaust piped to the outside of the building and directed away from this building or any adjacent structures so as to prevent accumulation of fumes or carbon stains on the surfaces of the structure.
 - 1. Compressors may be located on the roof level of the ramp. Care shall be taken to prevent the exhaust from entering the attendant booth air intake ducts.
 - 2. Place plywood or other suitable material below compressors to protect the substrate from grease, oil, and other debris.

1.17 PARKING

- A. Parking of vehicles and equipment required for construction purposes shall be in the Contractor's designated work areas. No parking will be provided for employees of any Contractor on site. Any vehicle in the parking ramp not parked within the construction area, which are required for this project, will be charged for parking.
- B. All Contractors and their employees shall cooperate with the General Contractor and others in the parking of vehicles to avoid interference with normal construction activities.

- C. Do not obstruct existing service drives and parking areas outside the Contractor's work area with equipment, materials and/or vehicles. Keep accessible for Owner's use at all times.

1.18 SECURITY

- A. The Contractor shall provide for the security of materials and equipment stored at the site. Material and equipment shall not be stored in areas which the Owner continues to use. The Contractor may store equipment and materials in areas in which the Contractor is working; otherwise they shall be removed from the site.

1.19 CLEANING

A. General:

1. Each Contractor shall keep premises free of accumulation of surplus materials and debris resulting from their operations and the operations of Subcontractors.
 - a. Do not throw debris from ramp.
 - b. Remove all debris from premises.
 - c. No burning of debris on premises allowed.
 - d. Do not use Owner's dump containers.
2. At a minimum, remove debris dumpster weekly and additionally as required by the Engineer. Keep interior of ramp free at all times of unattended combustible debris.
3. Drive lanes, adjacent to work area, shall be cleaned daily to eliminate airborne dust.
4. Remove all tools, equipment, scaffolding and temporary facilities immediately when no longer required for execution of the work.
5. The Contractor shall "broom clean" all floors within and adjacent to work areas as construction progresses to eliminate dirt and trash accumulation and maintain proper project cleanliness. Stair towers and areas of pedestrian traffic flow shall be "broom-clean" daily. Unless work area is secured against entry by pedestrians, all rubble shall be removed from ramp surface and all open holes shall be covered with steel plates.

B. Safety Requirements:

1. Store volatile wastes in covered metal containers and remove from premises daily.
2. Prevent accumulation of wastes which create hazardous conditions.
3. Provide adequate ventilation during use of volatile or noxious substances.
4. Conduct cleaning and disposal operations to comply with local ordinances and anti-pollution laws.
5. Do not burn or bury waste materials on the project site.
6. Do not dispose of volatile wastes such as mineral spirits, oil, or paint thinner in storm and sanitary drains.

C. Materials:

1. Use only cleaning materials recommended by manufacturer of surface to be cleaned.
2. Use cleaning materials only on surfaces recommended by cleaning material manufacturer.

D. Submittals:

1. Submit plan for disposal of waste.

E. Cleaning During Construction:

1. Execute cleaning to ensure that building, grounds, and public properties are maintained free from accumulation of waste materials.

2. Wet down dry materials to lay dust and prevent blowing dust.
3. At daily intervals during progress of work, clean site and public properties, and dispose of waste materials. Prior to any removal, the Contractor shall submit their plan for confining, collecting, and disposal of waste material as a result of the Contractor's removal operations.
4. Provide on-site dump container for collection of waste materials. Contractor shall coordinate with Owner for location of dumpster.
5. Remove waste materials in a controlled manner with as few handlings as possible. Do not drop or throw materials from heights.
6. Schedule cleaning operations so that dust and other contaminants resulting from the cleaning process will not fall on wet, newly painted surfaces or adjacent parked cars.

F. Final Cleaning:

1. Immediately prior to final inspection, the Contractor shall clean all surfaces to condition acceptable for immediate occupancy by the Owner and remove all foreign matter from all finished items.
2. The Contractor shall leave all work clean in all respects, ready for use and occupancy by the Owner without additional work.
3. Employ experienced workers, or professional cleaners, for final cleaning.
4. In preparation of substantial completion or occupancy, conduct final inspection of sight exposed interior and exterior surfaces, and of concealed spaces.
5. Repair, patch, and touch up marred surfaces to specified finish, to match adjacent surfaces.
6. Water blast and broom clean to remove dust and debris from paved surfaces, walls, ceilings and stairs. Hand wash with rags, sponges or equivalent, all railings, pipes, windows, door frames, light fixtures, etc. and rinse, from within work areas and other areas affected by construction. If dust protection is not erected and maintained to prevent dust and debris from being tracked through the structure, the Contractor will be required to perform final cleaning procedures throughout the structure from the top level to the basement.
7. Remove debris from drains and sumps and check that drains are again operable.

1.20 PROJECT CLOSEOUT

A. Completion:

1. All work shall be complete when written notice requesting final inspection is submitted to the Engineer.

B. Guarantees, Bonds, and Affidavits:

1. Required prior to final payment is made. Submit all required written documents including guarantees, bonds, and affidavits.
2. Guarantees shall extend the full period of the required guarantee period after:
 - a. Replacement of work found defective during guarantee period at any time after completion.
 - b. Repair of inoperative items or adjustments to proper working condition of items not operating properly at time of inspection at completion.
 - c. Completion of work not completed at time of completion.
3. Items of equipment or material bearing a guarantee of the manufacturer or supplier longer than that described in the City of Madison Standard Specifications for Public Works Construction – most current year, shall not serve to release the manufacturer or supplier from their obligation to repair or replace such items within the limits of their guarantee after expiration of guarantees required by these specifications.

1.21 RECORD DRAWINGS

A. Required prior to final payment is made.

PART 2 - PRODUCTS (Not Used)

PART 3 - EXECUTION (Not Used)

END OF SECTION

SECTION 01 22 00

UNIT PRICES

PART 1 - GENERAL

1.1 PAYMENT

- A. Work is to be paid for on Unit Price basis and bid on estimated quantities. These work items are to be installed and completed per specifications and as shown on drawings.

1.2 MEASUREMENT OF QUANTITIES

- A. Refer to General Requirements for complete information.
- B. Work to be performed on unit price basis shall be measured according to quantities described above. Payment will be made for work actually performed, based on quantities recorded by Contractor and approved by Engineer. Records described below shall be maintained using a Geographical Information System Database, referred to hereinafter as GIS, provided by the Engineer. Unless otherwise stated, Engineer will verify accuracy of record by visual examination of work performed and measuring quantities with measuring wheel and tape measure.
- C. Contractor shall notify Owner and Engineer at once in writing of any unit price work that deviates materially from prescribed basis for bidding and for which adjustment in Unit Price is desired. Contractor shall measure and quantify all such deviations, subject to Engineer's verification, prior to any repair work which might make verification impossible. No adjustments in Unit Prices will be considered unless supporting field measurements are provided, and subject to Owner's prior approval. Adjustments will only be considered if all repairs of given type have been measured and all deviations, both plus and minus have been included in determination of average deviation from Unit Price basis.

Item	Type of Work	Unit Price
1	<u>Membrane Repair (Top/Wear)</u> including surface preparation of existing membrane system. Work includes placement of wear coat and top coat membrane over existing areas with exposed membrane (base coat) and areas with heavily worn or weathered membrane. Epoxy required to fill depressions at risk of collection of water is included. Refer to specification section 07 18 00. Payment is based on area of membrane installed.	\$/Sq. Ft.
2	<u>Membrane Repair (Full)</u> including surface preparation of existing membrane and exposed concrete surfaces at existing and new concrete patch areas. Work shall include surface preparation, primer, base coat, wear coat, and top coat. Refer to specification section 07 18 00. Payment is based on area of membrane installed.	\$/Sq. Ft.
3	<u>Concrete Vertical Surface Spall Repair</u> including removal of concrete, grit-blasting of newly exposed concrete surface and reinforcing steel, coating of exposed reinforcement, and placing pre-packaged concrete fill. Refer to Detail B4/S502, C5/S503, D5/S503, and specification sections 03 01 07 and 03 31 07. Payment is based on exposed surface area of concrete placed.	\$/Sq. Ft.

4	<u>Concrete Surface Spall Repair</u> including removal of concrete to an estimated variable depth of 1” to 5” from top of slab, grit-blasting of the newly exposed concrete surface and reinforcing steel coating of exposed reinforcement, and placing “ready- mix” concrete fill (pre-packaged concrete at Contractor’s option). Refer to detail A5/S502 and specification sections 03 01 07 and 03 31 07. Payment is based on area of concrete placed at top surface of slab.	\$/Sq. Ft.
5	<u>Overhead Surface Spall Repair</u> including removal of concrete, grit-blasting of newly exposed concrete surface and reinforcing steel coating of exposed reinforcement, and placing pre-packaged concrete fill. Refer to detail B5/S502 and B4/S502 and specification sections 03 01 07 and 03 31 07. Payment is based on exposed area of concrete placed.	\$/Sq. Ft.
6	<u>Stair Spall Repair</u> of parking structures. Work will include restoration at designated stair treads, installation of hairpins, resetting rail posts and casting replacement concrete at stair tread. Refer to Detail A6/S504 and specification sections 03 01 07 and 03 31 07. Payment is based on area of work completed.	\$/Sq. Ft.
7	<u>Concrete Joist Spall Repair</u> including removal of concrete, grit-blasting of newly exposed steel, coating of exposed reinforcement, and placing pre-packaged or shotcrete concrete fill. Refer to Detail A5/S505 and specification sections 03 01 07 and 03 31 07. Payment is based on area of concrete placed.	\$/Sq. Ft.
8	<u>Concrete Beam/Column/Wall Crack Repair</u> including epoxy injection of concrete cracks and removal/grinding flush of epoxy injection ports. Refer to specification section 03 64 07. Payment is based on linear footage of crack injected with epoxy.	\$/Lin. Ft.
9	<u>Concrete Slab Crack Repair</u> including grinding crack and joint edges, installing backer rod or bond breaker tape, and installing sealant. Refer to Detail B5/S504 and specification sections 07 90 07. Payment is based on length of sealant installed.	\$/Lin. Ft.
10	<u>CMU Crack Repair</u> including removal, replacement and tooling of masonry mortar joints. Refer to specification sections 04 01 01 and 04 05 14. Payment is based on linear footage of masonry joints repaired.	\$/Lin. Ft.
11	<u>Replace Compression Joint with Sealant/Backer Rod</u> placement including removal of existing material from designated joints, grinding joint edges clean, and installing new backer rod with sealant. Refer to specification section 07 90 07. Payment is based on length of sealant installed.	\$/Lin. Ft.

12	<u>Replace Expansion Joint</u> Work will consist of chipping out existing joint including angles flanking slab separation, placing concrete to form new block out, and placing new joint seal system. Refer to detail B6/S504 and specification sections 03 01 07, 03 31 07 and 07 95 07. Payment is based on length of expansion joint slab system installed.	\$/Lin. Ft.
13	<u>Replace Expansion Joint - 4" Polyurethane Seal with EJ with Nosing</u> including removal of existing expansion joint seal, replace/rebuild epoxy block outs, replace epoxy nosing and remove traffic plates and install new expansion joint. Refer to details B6/S504 and C5/S504, and specification sections 03 01 07, 03 31 07 and 07 95 07. Payment is based on length of expansion joint installed.	\$/Lin. Ft.
14	<u>Replace Expansion Joint – 8" Polyurethane Seal with EJ with Nosing</u> including removal of existing expansion joint seal, replace/rebuild epoxy block outs, replace epoxy nosing and remove traffic plates and install new expansion joint. Refer to details B6/S504 and C5/S504, and specification sections 03 01 07, 03 31 07 and 07 95 07. Payment is based on length of expansion joint seal installed.	\$/Lin. Ft.
15	<u>Steel Cleaning/Painting</u> including all preparation, grit-blasting to near white conditions, priming, and painting as outlined in specification section 09 97 13. Payment is based on area of steel surface painted.	\$/Sq. Ft.
16	<u>Remove and Replace Existing Sealant</u> removal of existing sealant from cracks and joints, grinding crack and joint edges, and installing new sealant with backer rod as required. Joint width varies. Refer to specification 07 90 07. Payment is based on length of sealant installed.	\$/Lin. Ft.
17	<u>Precast Shear Connector Repair</u> including the removal and replacement of existing sealant and rewelding of existing or new plate. Refer to detail C6/S505 and specification section 09 97 13 and 07 90 07. Payment is based on each connection repaired with sealant reinstalled.	\$/Item
18	<u>Overhead Concrete Demolition Only</u> including removal of loose concrete areas on the underside of the slab and beams at designated areas to the depth of the encased reinforcing steel. All loose material within the removal area shall be removed to prevent concrete from falling in an unintended manner. Cleaning exposed reinforcing steel is required. Refer to specification section 03 01 07. Concrete will not be replaced at the knockdown removal locations. Payment is based on area of concrete removal.	\$/Sq. Ft.
19	<u>Silane Sealer</u> including necessary surface preparation of concrete slabs or double tees and application of sealer at State Street Frances. Refer to specification section 07 19 00. Payment is lump sum.	Lump Sum

20	<u>Exposed Steel Reinforcing</u> including removal of existing visible corrosion by grit-blasting and painting of exposed steel with galvanic paint. Refer to specification section 03 01 07. Payment is based on linear footage of steel painted.	\$/Lin. Ft.
21	<u>Brick Masonry Repair</u> including removal and replacement of damaged brick masonry and mortar joints to match existing brick aesthetics. A limited quantity of reclaimed brick for Capitol Square North work is available from the owner but requires cleaning. Refer to specification sections 04 01 01 and 04 05 14. Payment is based on area of brick and mortar joints installed.	\$/Sq. Ft.
22	<u>Brick Masonry Sealing (CSN)</u> including necessary surface preparation of brick exterior, application of approved brick sealing product to all exposed exterior faces, and cleaning of adjacent glass windows (both sides). Payment is based on only area of brick and mortar joints sealed.	\$/Sq. Ft.
24	<u>Steel Anchor Repair</u> including removal of existing anchor, drilling and epoxying of new steel anchor. Payment is based on number of steel anchors installed.	\$/Item
25	<u>Top of Column Sealing (CSN)</u> including necessary surface preparation of concrete and application of approved concrete sealer. Refer to specification section 07 19 00. Payment is based on area of concrete sealed.	\$/Sq. Ft.
26	<u>Stainless Steel Flashing Over Occupied Space (CSN)</u> including forming and installing stainless steel sheet flashing. Refer to detail C5/S505 and specification section 07 62 00. Payment is based on linear footage of flashing installed.	\$/Lin. Ft.
27	<u>Expansion Joint Replacement with Resloping (SSCo)</u> including demolition of existing expansion joint, rebuilding of slab edge, painting of exposed reinforcing steel, surface preparation of existing concrete, placement of new concrete/repair material, installation of new compression seal expansion joint. Refer to detail A6/S501 and specification sections 03 01 07, 03 31 07, 07 18 00, and 07 95 07. Payment is lump sum.	Lump Sum
28	<u>Pour Strip Replacement (CSN)</u> including demolition of existing pour strip, grit blasting and painting of exposed steel angles, forming of new pour strip, placement of rebar, surface preparation of existing concrete, finishing of new concrete, installation of compression seal expansion joint, installation of sealant joint and installation of Kelmar membrane system. Refer to detail C6/S501 and specification sections 03 01 07, 03 31 07, 07 18 00, 07 90 07, 07 95 07, and 09 97 13. Payment is lump sum.	Lump Sum
29	<u>Tapered Column Repair (SSCo)</u> including removal of concrete, grit-blasting of newly exposed concrete surface and existing reinforcing steel, installing new epoxy-coated reinforcing and placing pre-packaged concrete fill. New concrete on column surfaces to be painted at State Street Capitol Parking Garage. Refer to Detail A6/S505 and specification sections 03 01 07 and 03 31 07. Payment is based on each column repaired and painted.	\$/Item

PART 2 - PRODUCTS (Not Used)

PART 3 - EXECUTION (Not Used)

END OF SECTION

2020 Parking Garage Maintenance

01 22 00 - 5

Unit Prices

Contract No. 8885

© 2020 – Graef-USA Inc.

2019-5035.00

QUANTITY SUMMARY

PAY ITEM	X - X UNIT DESCRIPTION	DETAIL REFERENCE	UNITS	SSL QUANTITY	SSF QUANTITY	SSCO QUANTITY	CSN QUANTITY	OC QUANTITY	TOTAL QUANTITY
1	MEMBRANE REPAIR (TOP/WEAR)	N/A	SF	8360	0	0	5000	0	13300
2	MEMBRANE REPAIR (FULL)	N/A	SF	186	0	0	446	0	632
3	CONCRETE VERTICAL SURFACE SPALL REPAIR	C5/S503 D5/S503 B4/S502	SF	264	38	71	36	11	419
4	CONCRETE SLAB SPALL REPAIR	A5/S502	SF	160	36	179	57	30	462
5	OVERHEAD SURFACE SPALL REPAIR	B5/S502 B4/S502	SF	292	51	529	3	38	913
6	STAIR SPALL REPAIR	A6/S504	SF	0	4	19	0	1	24
7	CONCRETE JOIST SPALL REPAIR	A5/S505	SF	201	0	0	0	0	201
8	CONCRETE BEAM/COLUMN/WALL CRACK REPAIR	N/A	LF	9	0	0	0	0	9
9	CONCRETE SLAB CRACK REPAIR	B5/S504	LF	71	102	575	0	0	748
10	CMU CRACK REPAIR	N/A	LF	0	0	0	0	126	126
11	REPLACE COMPRESSION JOINT WITH SEALANT/BACKER ROD	N/A	LF	195	0	0	0	0	195
12	REPLACE EXPANSION JOINT	B6/S504	LF	50	0	0	0	0	50
13	REPLACE 4" POLYURETHANE SEAL WITH EJ WITH NOSING	B6/S504 C5/S504	LF	0	0	0	0	44	44
14	REPLACE 8" POLYURETHANE SEAL WITH EJ WITH NOSING	B6/S504 C5/S504	LF	50	0	0	0	116	166
15	STEEL CLEANING/PAINTING	N/A	SF	0	4	36	0	47	87
16	REMOVE AND REPLACE EXISTING SEALANT	N/A	LF	0	520	2696	50	197	3465
17	PRECAST SHEAR CONNECTOR REPAIR	C6/S505	ITEM	0	30	0	0	0	30
18	OVERHEAD CONCRETE DEMOLITION ONLY	N/A	SF	0	0	3	1	0	4
19	SILANE SEALER	N/A	LS	0	1	0	0	0	1
20	EXPOSED STEEL REINFORCING	N/A	LF	92	4	12	1	30	139
21	BRICK MASONRY REPAIR	N/A	SF	0	0	0	16	8	24
22	BRICK MASONRY SEALING (CSN)	N/A	SF	0	0	0	1200	0	1200
24	STEEL ANCHOR REPAIR	N/A	ITEM	8	2	0	8	0	18
25	TOP OF COLUMN SEALING (CSN)	N/A	SF	0	0	0	480	0	480
26	STAINLESS STEEL FLASHING OVER OCCUPIED SPACE (CSN)	C5/S505	LF	0	0	0	20	0	20
27	EXPANSION JOINT REPLACEMENT WITH RESLOPING (SSCO)	A6/S501	LS	0	0	1	0	0	1
28	POUR STRIP REPLACEMENT (CSN)	C6/S501	LS	0	0	1	0	0	1
29	TAPERED COLUMN REPAIR (SSCO)	A6/S505	ITEM	0	0	11	0	0	11

2020 Parking Garage Maintenance

01 22 00-6

Unit Prices

Contract No. 8885

© 2020 – Graef-USA Inc.

2019-5035.00

SECTION 03 01 07
CONCRETE RESTORATION FOR PARKING STRUCTURES

PART 1 - GENERAL

1.1 SUMMARY

A. Section Includes:

1. Concrete surface repair.
2. Include materials, labor, services and incidentals necessary for completion of this Section of Work.
3. Include the removal of unsound concrete, examination of exposed reinforcing, grit-blasting of acceptable reinforcing, replacement of unacceptable reinforcing with new, and cleaning of the newly exposed underlying sound concrete prior to casting new fill concrete.
4. Grit-blasting of exposed reinforcing steel and concrete surfaces is not required with Hydro-demolition concrete removal option. Concrete and steel surfaces shall be thoroughly cleaned of all slurry and residue following removal, prior to application of rebar coating and bonding agent.
5. The removal work shall be carried out in a manner so as to create a minimum disturbance with the continued use of the parking structure.
6. Warning: Concrete slabs at Capitol Square North and the Overture Center Ramps are reinforced with post-tensioned (P/T) tendons. The lower two structured levels of State Street Campus – Frances and top three levels of State Street Capitol are also P/T reinforced. Contractor shall locate P/T tendons prior to removal of concrete. Contractor shall exercise extreme caution when chipping so as not to damage nor displace P/T tendons or anchorages. Any damage shall be repaired at Contractor's expense.

B. Related Sections:

1. Applicable provisions of Division 01 – General Requirements shall govern all work under this Section.
2. Section 03 15 07 – Vehicular Traffic Expansion Joint Assemblies for Parking Structures.
3. Section 03 31 07 – Structural Concrete for Parking Structures.
4. Section 03 64 07 – Crack Injection Repairs for Parking Structures.
5. Section 07 14 07 – Fluid-Applied Waterproofing for Parking Structures.
6. Section 07 19 07 – Water Repellents for Parking Structures.
7. Section 07 90 07 – Joint Protection for Parking Structures.

1.2 MEASUREMENT AND PAYMENT

- A. Engineer shall locate and mark all areas of delamination to be repaired.
- B. Contractor to document size of repair and when repair is complete, using an online database provided by Engineer.
- C. Engineer to approve extents of concrete removal prior to Contractor installing repair materials.
- D. Online database shall be used as a record for payments.

- E. Repair Surface:
 - 1. Basis of Measurement: Reference the specific repair detail on the Drawings. Measurement shall be made by the square foot.
 - 2. Basis of Payment: Includes surface preparation, forming if necessary, concrete repair, finishing, and curing.
- F. For concrete spall repair quantities, reference Bid Form.

1.3 REFERENCES

- A. ASTM International (ASTM):
 - 1. ASTM A82 - Standard Specification for Steel Wire, Plain, for Concrete Reinforcement.
 - 2. ASTM A615 - Standard Specification for Deformed and Plain Carbon-Steel Bars for Concrete Reinforcement.
 - 3. ASTM A996 - Standard Specification for Rail-Steel and Axle-Steel Deformed Bars for Concrete Reinforcement.
 - 4. ASTM C33 - Standard Specification for Concrete Aggregates.
 - 5. ASTM C109 - Standard Test Method for Compressive Strength of Hydraulic Cement Mortars (Using 2-in. Cube Specimens).
 - 6. ASTM C150 - Standard Specification for Portland Cement.
 - 7. ASTM C260 - Standard Specification for Air-Entraining Admixtures for Concrete.
 - 8. ASTM C293 - Standard Test Method for Flexural Strength of Concrete (Using Simple Beam with Center-Point Loading).
 - 9. ASTM C404 - Standard Specification for Aggregates for Masonry Grout.
- B. American Welding Society (AWS):
 - 1. AWS D1.4 - Structural Welding Code - Reinforcing Steel.

1.4 SUBMITTALS

- A. Division 01 – General Requirements: Submittal procedures.
- B. Product Data: Submit product standards, physical and chemical characteristics, technical specifications, limitations, maintenance instructions, and general recommendations regarding each material.
- C. Manufacturer’s Instructions: Submit manufacturer’s instructions for preparation, mixing, placing, and curing.

1.5 CLOSEOUT SUBMITTALS

- A. Division 01 – General Requirements: Closeout procedures.
- B. Division 01 – General Requirements - Project Record Documents: Using an online database to record actual locations and quantities of structural repairs.
- C. Division 01 – General Requirements - Operation and Maintenance Data: Procedures for submittals.

1.6 QUALITY ASSURANCE

- A. Manufacturer: Company specializing in manufacturing products specified in this section with minimum five (5) years documented experience.
- B. Contractor: Company specializing in concrete repair with minimum five (5) years documented experience and approved by manufacturer.
- C. Source Limitations: For repair products, obtain each color, grade, finish, type, and variety of product from single source and from single manufacturer with resources to provide products of consistent quality in appearance and physical properties.
- D. Mock-Up: Provide a mock-up for evaluation of surface preparation techniques and application workmanship.
 - 1. Finish areas designated by Engineer.
 - 2. Do not proceed with remaining work until workmanship is approved by Engineer.
 - 3. Refinish mock-up area as required to produce acceptable work.

1.7 PRE-INSTALLATION MEETINGS

- A. A pre-construction meeting is required with Contractor in order to coordinate work schedule and inspection required by Engineer.

1.8 DELIVERY, STORAGE, AND HANDLING

- A. Division 01 - General Requirements: Product storage and handling requirements.
- B. Comply with instructions for storage, shelf life limitations, and handling.

1.9 EXISTING CONDITIONS

- A. Conduct demolition to minimize interference with adjacent building areas. Maintain protected egress and access at all times.
- B. Provide, erect, and maintain temporary barriers and security devices.

PART 2 - PRODUCTS

2.1 HORIZONTAL REPAIR MORTAR

- A. Flowable structural-repair concrete with integral corrosion inhibitor.
 - 1. MasterEmaco S 466 CI by BASF
 - 2. SikaTop 111 Plus by Sika
 - 3. Eucocrete Supreme by The Euclid Chemical Company
 - 4. Or approved equal.

2.2 OVERHEAD AND VERTICAL REPAIR MORTARS

- A. One-component, shrinkage-compensated, fiber-reinforced product that contains an integral corrosion inhibitor.
 - 1. MasterEmaco S 488 CI by BASF
 - 2. SikeTop 123 Plus by Sika
 - 3. Duraltop Gel by The Euclid Chemical Company
 - 4. Or approved equal with corrosion inhibitor.

2.3 REBAR PRIMER AND BONDING AGENT

- A. Water-based epoxy-cementitious bonding agent and rebar coating.
 - 1. MasterEmaco P 124 by BASF
 - 2. Sika Armatec 110 EpoCem by Sika
 - 3. Duralprep AC by The Euclid Chemical Company
 - 4. Or approved equal.

2.4 REINFORCEMENT MATERIALS

- A. Reinforcing Steel: ASTM A615, 60 ksi yield grade billet-steel deformed bars, epoxy coated finish.
- B. Stirrup Steel: ASTM A82, epoxy coated finish.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Division 01 - General Requirements: Administrative requirements for coordination and project conditions.
- B. Verify surfaces are ready to receive work.
- C. Beginning of installation means acceptance of existing surfaces.

3.2 PREPARATION

- A. Prior to removal, the Contractor shall submit the Contractor's plan for confining dust and water run-off, collecting and disposal of broken concrete, steel reinforcement and other waste material as a result of the Contractor's removal operations. This plan shall be submitted to the Engineer and the Owner prior to start of construction. Dumpster location shall be coordinated with the Engineer and the Owner. Stockpiling of removal debris within parking garage is not allowed unless authorized and coordinated with the Engineer.
- B. Shore the structure as required. Shoring design, supply, and installation is the responsibility of the Contractor.

- C. Contractor responsible for removing and reinstalling or protection in place of mechanical, electrical, and plumbing utilities including electrical lighting and conduits as required for repair work.
- D. At slab areas with a membrane, place plywood protection on the topside of slab for overhead concrete removal above to prevent damage to the membrane floor coating.
- E. Delaminated areas which require removal of unsound concrete will be identified and marked by the Engineer. The unsound concrete shall be removed by chipping to sound concrete. The marking by the Engineer in the field does not guarantee that unsound concrete is not present in areas beyond those marked. Additional concrete removal may be required after the Contractor's initial removal. The Engineer will review the removal areas prior to concrete replacement.
- F. Use hammers of 15 pounds or less for concrete removal, unless approved in advance by Engineer.
- G. Remove concrete in an area extending slightly beyond outer boundary of unsound concrete.
- H. Edges of removed area shall not be feathered, but shall be undercut sawed to a minimum depth of 3/4-inch for topside spall repairs.
- I. Edges of underside and vertical spalls shall be undercut sawed to a minimum depth of 1/2-inch when prepackaged patching material is used.
- J. During removals, care shall be exercised to avoid damaging exposed steel, breaking its bond to surrounding concrete, and/or cracking adjacent sound concrete.
- K. Pneumatic tools should not be placed in direct contact with reinforcing steel.
- L. Contractor shall be responsible for the labor and material costs to replace reinforcement or to provide supplemental reinforcement when excessive damage to existing reinforcement is caused by careless operation of Contractor's tools.
- M. Following the initial removal of concrete and visual location of P/T tendons (at OC, CSN, and SSCF) in area of patch, perimeter of removal area shall be saw cut to square the area of removal prior to placing new concrete.
- N. During the chipping process in deteriorated concrete areas, care shall be exercised to avoid cracking of the underlying sound concrete.
- O. During removal of the unsound concrete, if more than half of the reinforcing bar diameter is exposed or if the bar is not firmly bonded to the surrounding concrete, or if the bar is corroded, then the remaining concrete around the bar shall be removed. The clearance between the bar and the concrete shall be minimum of 3/4". Support bars for the main reinforcing steel shall not be exposed provided there is no corrosion on these bars.
- P. The newly exposed sound concrete shall be cleaned by blowing away loose material with a deep grit-blast, with chipping hammer removal option, followed by cleaning with a compressed air jet.

- Q. As a precautionary safety measure, the area directly below areas being repaired shall be closed until concrete demolition work is completed.
- R. The Engineer shall be allowed 24 hours for the inspection of properly prepared concrete surfaces and reinforcement, before the scheduled concrete placement.

3.3 REINFORCEMENT CLEANING AND REPLACEMENT

- A. Exposed reinforcing shall be thoroughly cleaned by grit-blasting, to remove rust and unsound concrete with chipping hammer removal option.
- B. Bars that are damaged or that have lost more than 10 percent of their original area at any point along the length shall be considered unacceptable and shall be removed and replaced with an equivalent new bar of equal length at the Engineer's direction. No. 8 bars and smaller that have lost between 5 percent and 10 percent of their original area at any point can be blast cleaned and reused as long as a new full length #4 bar is used as supplemental steel next to the old cleaned bar at the Engineer's direction.
- C. Exposed or supplemental reinforcing bars shall be no closer than 3/4" measured radially from existing concrete. The elevation of exposed or supplemental reinforcing shall be maintained at the original height.
- D. Where portions of reinforcing bars are exposed, the Engineer will determine if the embedded portion of the bar is soundly bonded to the remaining concrete. If, in the Engineer's judgment, the bar is not soundly bonded, the Contractor shall remove concrete around and under the bar for a length as determined by the Engineer.
- E. Install additional reinforcing bars as detailed.
- F. Drill and epoxy in dowels as detailed.
- G. Cleaned reinforcing shall be coated with protective rebar primer prior to casting new concrete.
- H. Engineer shall be allowed inspection of properly placed patch.

3.4 APPLICATION - CEMENTITIOUS MORTAR

- A. Apply brush coating of slurry mix to damp concrete surfaces. Provide full surface coverage.
- B. Apply cementitious mortar by steel trowel to fill patch area in accordance with manufacturer's instructions.
- C. Damp cure cementitious mortar for two (2) days.

3.5 CLEAN-UP

- A. Remove demolished materials from site as work progresses. Upon completion of work, leave areas of work in clean condition.

B. Debris shall not be flushed down the existing floor drains.

END OF SECTION

SECTION 03 31 07

STRUCTURAL CONCRETE FOR PARKING STRUCTURES

PART 1 - GENERAL

1.1 SUMMARY

- A. Section Includes:
 - 1. Structural Concrete.
 - 2. Admixtures.
 - 3. Curing and Treatment Requirements.
 - 4. Floor flatness and levelness.
 - 5. Formwork, shoring, bracing, and anchorage.
 - 6. Concrete reinforcement and accessories.

- B. Work Installed but Furnished Under Other Sections:
 - 1. Division 04 – Masonry: Masonry accessories attached to formwork.
 - 2. Division 05 – Metals: Metal fabrications attached to formwork.
 - 3. Division 07 – Thermal and Moisture Protection: Flashing reglets attached to formwork.

- C. Related Sections:
 - 1. Applicable provisions of Division 01 – General Requirements shall govern all work under this Section.
 - 2. Section 03 38 00 – Post-Tensioned Concrete.
 - 3. Section 03 64 07 – Crack Injection Repairs for Parking Structures.
 - 4. Section 07 14 07 – Fluid-Applied Waterproofing for Parking Structures.
 - 5. Section 07 19 07 – Water Repellents for Parking Structures.
 - 6. Section 07 90 07 – Joint Protection for Parking Structures.
 - 7. Section 07 95 07 – Traffic Joint Expansion Assemblies for Parking Structures.

1.2 MEASUREMENT AND PAYMENT

- A. See bid form.

1.3 REFERENCES

- A. Incorporated Guides and References:
 - 1. American Concrete Institute (ACI):
 - a. ACI 302.1R – Guide for Concrete Floor and Slab Construction.
 - b. ACI 304R – Guide for Measuring, Mixing, Transporting and Placing Concrete.
 - c. ACI 304.2R - Placing Concrete by Pumping Methods.
 - d. ACI 305R - Hot Weather Concreting.
 - e. ACI 309R – Guide for the Consolidation of Concrete.
 - f. ACI 347 – Guide to Formwork for Concrete.
 - g. ACI SP-66 – ACI Detailing Manual.
 - h. ACI 362.1 – Guide for the design an construction of durable concrete parking structures.

B. Specifications:

1. American Concrete Institute (ACI):
 - a. ACI 117 - Specifications for Tolerances for Concrete Construction and Materials.
 - b. ACI 301 - Specifications for Structural Concrete.
 - c. ACI 303.1 – Specification for Cast-In-Place Architectural Concrete.
 - d. ACI 306.1 – Specification for Cold Weather Concreting.
 - e. ACI 308.1 – Specification for Curing Concrete.
 - f. ACI 315 - Details and Detailing of Concrete Reinforcement.
 - g. ACI 318 - Building Code Requirements for Structural Concrete and Commentary.
2. ASTM International (ASTM):
 - a. ASTM A497 – Standard Specification for Steel Welded Wire Reinforcement, Deformed, for Concrete.
 - b. ASTM A615 – Standard Specification for Deformed and Plain Carbon-Steel Bars for Concrete Reinforcement.
 - c. ASTM A704 – Standard Specification for Welded Steel Plain Bar or Rod Mats for Concrete Reinforcement.
 - d. ASTM A706 – Standard Specification for Low-Alloy Steel Deformed and Plain Bars for Concrete Reinforcement.
 - e. ASTM A767 – Standard Specification for Zinc-Coated (Galvanized) Steel Bars for Concrete Reinforcement.
 - f. ASTM A775 – Standard Specification for Epoxy-Coated Steel Reinforcing Bars.
 - g. ASTM A884 – Standard Specification for Epoxy-Coated Steel Wire and Welded Wire Reinforcement.
 - h. ASTM A934 – Standard Specification for Epoxy-Coated Prefabricated Steel Reinforcing Bars.
 - i. ASTM A1064 - Standard Specification for Steel Wire and Welded Wire Reinforcement, Plain and Deformed, for Concrete.
 - j. ASTM C33 – Standard Specification for Concrete Aggregates.
 - k. ASTM C94 – Standard Specification for Ready-Mixed Concrete.
 - l. ASTM C150 – Standard Specification for Portland Cement.
 - m. ASTM C157 – Standard Test Method for Length Change of Hardened Hydraulic – Cement Mortar and Concrete.
 - n. ASTM C260 – Standard Specification for Air-Entraining Admixtures for Concrete.
 - o. ASTM C494 – Standard Specification for Chemical Admixtures for Concrete.
 - p. ASTM C618 – Standard Specification for Coal Fly Ash and Raw or Calcined Natural Pozzolan for use in Concrete.
 - q. ASTM C989 – Standard Specification for Slag Cement for Use in Concrete and Mortars.
 - r. ASTM C1116 – Standard Specification for Fiber-Reinforced Concrete.
 - s. ASTM C1202 – Standard Test Method for Electrical Indication of Concrete’s Ability to Resist Chloride Ion Penetration.
 - t. ASTM C1240 – Standard Specification for Silica Fume Used in Cementitious Mixtures.
 - u. ASTM C1602 – Standard Specification for Mixing Water Used in the Production of Hydraulic Cement Concrete.
 - v. ASTM D1751 – Standard Specification for Preformed Expansion Joint Filler for Concrete Paving and Structural Construction (Non-extruding and Resilient Bituminous Types).
 - w. ASTM D3963 – Standard Specification for Fabrication and Jobsite Handling of Epoxy-Coated Steel Reinforcing Bars.

- x. ASTM E1155 – Standard Test Method for Determining F_F Floor Flatness and F_L Floor Levelness Numbers.
- y. ASTM E1643 – Standard Practice for Selection, Design, Installation, and Inspection of Water Vapor Retarders Used in Contact with Earth or Granular Fill Under Concrete Slabs.
- z. ASTM E1745 – Standard Specification for Water Vapor Retarders Used in Contact with Soil or Granular Fill Under Concrete Slabs.

1.4 SUBMITTALS

- A. Submit proposed mix design of each class of concrete to Engineer not later than 10 days after Notice to Proceed or 15 days prior to the first concrete placement, whichever comes first.
- B. Provide test mix results for all concrete use for parking structure slabs, beams and columns. Must include ASTM C1202 and C157.
- C. Submit shop drawings of reinforcing steel under provisions of Division 01 – General Requirements.
 - 1. Initial submittal of reinforcement shop drawings shall be complete. No partial submittals will be accepted.
 - 2. Indicate reinforcement sizes, spacings, locations and quantities of reinforcing steel, and wire reinforcement, bending and cutting schedules, splicing, supporting and spacing devices.
- D. Material Certificates: For each of the following, signed by the manufacturers:
 - 1. Cementitious materials.
 - 2. Admixtures.
 - 3. Waterstops.
 - 4. Curing compounds.
 - 5. Bonding agents.
 - 6. Vapor retarders.

1.5 REGULATORY REQUIREMENTS

- A. Conform to requirements of local, state and federal rules and regulations applicable to Work and Project location.

1.6 ENVIRONMENTAL REQUIREMENTS

- A. Cold Weather Concreting
 - 1. Placement and curing of concrete where (1) average daily temperature for three consecutive days is less than 40 degrees F, and (2) air temperature is not greater than 50 degrees F for more than one-half of a 24-hour period from midnight to midnight shall be in accordance with ACI 306.1.
- B. Hot Weather Concreting
 - 1. Placement and curing of concrete subject to a combination of (1) rising air temperature (generally greater than 75 degrees F) and (2) wind and low relative humidity shall be in accordance with ACI 305R.

2. Contractor shall provide plan for minimizing exposure of concrete to adverse conditions due to combinations of high air temperature, direct sunlight, drying winds, and high concrete temperature.
3. Protect concrete from rapid temperature drop.
4. Pre-wet subgrade and forms.

PART 2 - PRODUCTS

2.1 FORM MATERIALS

- A. Plywood Forms: Douglas Fir or Spruce-Pine-Fir species: Sound, undamaged sheets with clean true edges, exterior glue, facing material to provide finish specified.
- B. Lumber: Douglas Fir or Spruce species; construction grade or better; with grade stamp clearly visible.
- C. Preformed Steel Wall Forms: Minimum 16 gage thick, Vertically and horizontally matched, tight fitting, stiffened to support weight of concrete without deflection detrimental to tolerances and surface appearance.
- D. Tubular Column Type: Round, spirally wound laminated fiber material; inside surface treated with release agent.
- E. Form Ties For Exposed Surfaces: Plastic cone snap ties with 1-inch outside diameter by 1-inch (nominal) long cones, with no metal within 1-inch of concrete face after removal;
 1. Manufacturers:
 - a. Advance Concrete Formwork, Inc.
 - b. Dayton Superior.
 - c. Symons - A Dayton Superior Company.
 - d. Williams Form Engineering Corporation.
 - e. Substitutions: As approved by Engineer.
- F. Form Ties For Hidden Surfaces: Metal spreader type, removable to a depth of 1-inch from concrete face;
 1. Manufacturers:
 - a. Advance Concrete Formwork, Inc.
 - b. Dayton Superior.
 - c. Williams Form Engineering Corporation.
 - d. Substitutions: As approved by [Engineer] [Engineer/Architect].
 2. Contractor shall use formwork, form components and accessories provided by a single manufacturer. Intermixing of formwork, components and accessories shall not be allowed.

2.2 SHORING

- A. Include materials, labor, services and incidentals necessary for completion of shoring.
- B. Shoring shall be designed by Contractor to temporarily support members whose support is to be removed by partial demolition and concrete removal.

- C. The Contractor shall submit to Engineer, a record of reference elevations of shored members at various stages as described below.
- D. Contractor shall obtain reference elevations of members supported by shoring prior to concrete removal, during concrete removal, after concrete removal, during and after concrete replacement, and after shoring removal.
- E. When reference elevations indicate unanticipated movements, shoring shall be adjusted to minimize adverse effects of that movement.
- F. Shores supporting vertical loads shall be adjustable through positive means, such as by adjustable screw jacks, in order to compensate for elastic shortening of shores during loading and other effects.
- G. Shores shall be effectively cross braced to prevent buckling failure of individual members and overall shoring stability failure.
- H. Shores shall be provided to carry full weight of floor system for entire bay in which work is being performed. Shores shall be in place prior to removal of unsound slab concrete and shall be supported on 1 structural level or to grade.
- I. Shores shall be installed snug, plumb and square.
- J. Shores shall be adjusted as required during progress of work as indicated by movements measured during relative elevation surveys of shored members.
- K. Shores shall only be removed when compressive strength results of replacement concrete reaches 75 percent of its specified 28-day strength. If Contractor chooses to have supplemental strength tests, it shall be the responsibility of the Contractor to make and pay for costs of these tests. Supplemental cylinders shall be stored on the structure in vicinity of the area they represent and shall be cured in the same manner as that portion of the structure.
- L. Shores that have been removed shall not be stored in such a manner that they interfere with Owner's continued use of the structure. If shoring is not to be used within the structure it shall be removed from the structure or stored in the area in which Contractor is working.

2.3 REINFORCING STEEL

- A. Reinforcing Steel of Parking Structure: A615, 60ksi yield grade carbon steel deformed bars; epoxy coated in accordance to ASTM A775 finish.
- B. Welded Steel Wire Reinforcement: Deformed type, ASTM A497; in flat sheets; uncoated, finish.
- C. Reinforcement Supports: Bolsters, chairs, spacers, and other devices for spacing, supporting, and fastening reinforcing bars, welded wire fabric, and dowels in place. Manufacture bar supports according to CRSI's "Manual of Standard Practice" from steel wire, plastic, or precast concrete of greater compressive strength than concrete.

2.4 FIBER REINFORCEMENT

- A. Synthetic Macro Fibers: Synthetic macro fibers engineered and designed for use in concrete, complying with ASTM C1116, Type III.
 - 1. Manufacturers – Macro Fibers:
 - a. The Euclid Chemical Company - TUF-STRAND SF
 - b. Propex Concrete Systems Corporation - Fibermesh 650
 - c. W. R. Grace & Co., Construction Products Division - STRUX 90/40
 - d. Substitutions: As approved by Engineer.

2.5 CONCRETE MATERIALS

- A. Cementitious Materials
 - 1. Portland Cement: ASTM C150, gray color, Type I except as specified below.
 - 2. Fly Ash: ASTM C618, Class C.
 - 3. Ground Granulated Blast Furnace Slag: ASTM C989, Grade 100 or 120.
 - 4. Silica Fume: ASTM C1240.
- B. Fine and Coarse Aggregates: ASTM C33.
- C. Water: ASTM C1602, clean and not detrimental to concrete.

2.6 ADMIXTURES

- A. Admixtures to be used in the concrete mixture shall be submitted to the Engineer for approval as part of the mixture design.
- B. Chemical admixtures shall be in accordance with ASTM C494.
- C. Admixtures shall be used in accordance with manufacturer's written recommendations.
- D. Admixtures containing chlorides, sulfides, or nitrides are not permitted.
- E. Admixtures permitted shall be supplied by a single manufacturer for project.
- F. Air Entrainment Admixture: ASTM C260;
 - 1. Manufacturers:
 - a. Axim Italcementi Group.
 - b. BASF Admixtures, Inc.
 - c. Grace Construction Products.
 - d. The Euclid Chemical Company.
 - e. Substitutions: As approved by Engineer.
- G. Corrosion Inhibiting Admixture;
 - 1. Manufacturers:
 - a. W.R. Grace – Type: DCI Corrosion Inhibitor. Dosage rate 3 gallons per cubic yard.
 - b. Master Builders – Type: Rheocrete CNI. Dosage rate 3 gallons per cubic yard.
 - c. Axim Concrete Technologies – Type: Cateol 1000 CN-CI. Dosage rate 3 gallons per cubic yard.
 - d. Cortec Corporation – Type: MCI 2005NS. Dosage rate 1.5 pints per cubic yard.

- e. Substitutions: As approved by Engineer.

2.7 ACCESSORIES

- A. Vapor Retarder: ASTM E1745; Class C, 10 mil minimum thickness, water vapor permeance rating of 0.050 perms or less;
 - 1. Manufacturers:
 - a. Americover - Vapor Block VB 10.
 - b. Fortifiber - Moistop Ultra 10.
 - c. Stego Industries - Stego Wrap 10-mil.
 - d. W.R. Meadows - Perminator.
 - e. Substitutions: As approved by Engineer.
- B. Joint Filler: ASTM D1751, Bituminous fiber, 1/2-inch wide by depth of concrete less 1/8-inch.
- C. Form Release Agent: Colorless material which will not stain concrete, absorb moisture or impair natural bonding or color characteristics of coating, intended for use on concrete;
 - 1. Manufacturers:
 - a. BASF Construction Chemicals, LLC - Building Systems: Castoff.
 - b. Dayton Superior - Clean Strip Ultra (J-3).
 - c. W.R. Meadows - Duogard.
 - d. Substitutions: As approved by Engineer/Architect.

2.8 CURING AND TREATMENT MATERIALS

- A. Water: Potable and clean.
- B. Burlap shall be clean, evenly woven, free of encrusted concrete or other contaminating materials, and shall be reasonably free of cuts, tears, broken or missing areas.

2.9 CONCRETE MIXTURE

- A. Prepare design mixtures for each type and strength of concrete, proportioned on the basis of laboratory trial mixture of field test data, or both, according to ACI 301.
- B. Limit cementitious materials to values indicated in ACI table 4.2.3. Indicate compliance in proposed design.
- C. In designing the concrete mixtures used in the parking slabs, ramps and columns, beams and walls supporting such slabs conform to the recommendations of ACI 362 1.R, unless otherwise shown on the drawings or specified herein.
- D. Limit water-soluble, chloride-ion content in hardened concrete to values indicated in ACI 318, Table 4.4.1. Indicate compliance in the proposed mix designs.
- E. Mix concrete in accordance with ASTM C94.
- F. Concrete mix designs shall be designed and submitted in accordance with Division 01 and included as part of cost of this Work.

- G. Mix designs shall be prepared by a qualified agency acceptable to Engineer. One (1) copy of mix designs shall be submitted for Engineer's review prior to placing any concrete.
- H. Mix design shall indicate brands, types, and quantities of admixtures included, compressive strength, slump, sieve analysis for fine and coarse aggregate, quantities of all ingredients, type and brand of cement, source of aggregate, whether fine aggregate is natural or manufactured.
- I. Design of mix shall assure placing and finishing characteristics that meet Project requirements.
- J. Mix designs contained in the Schedule of Mixes may be modified and submitted to Engineer for approval, by use of mid or high range water reducing admixtures to control slumps required for pumping of concrete. Strength, placing and finishing requirements shall be maintained.
- K. Concrete mixtures placed directly over vapor retarders shall be designed to have low shrinkage characteristics and designed to minimize slab curling.
- L. Initial and final set times of concrete mix designs shall be coordinated between the contractor and concrete supplier.

2.10 SCHEDULE OF MIXES

- A. Footings, Pile Caps: Proportion normal-weight concrete mix as follows:
 - 1. Compressive Strength (28 Days): 4000 psi.
 - 2. Maximum Aggregate Size: 1-1/2 inches.
 - 3. Maximum Water-Cement Ratio: 0.50.
- B. Foundation Walls, Grade Beams: Proportion normal-weight concrete mix as follows:
 - 1. Compressive Strength (28 Days): 4000 psi.
 - 2. Maximum Aggregate Size: 3/4 - inch.
 - 3. Air Entrainment: 6 percent air content is required with an acceptable air content of plus or minus 1.5 percent.
- C. Parking Slab on Grade, Equipment Pads: Proportion normal-weight concrete mix as follows:
 - 1. Compressive Strength (28 Days): 3000 psi.
 - 2. Maximum Aggregate Size: 3/4 - inch.
 - 3. Maximum Slump (Inch): 3
 - 4. Maximum Water-Cement Ratio: 0.50.
 - 5. Air Entrainment: 6 percent air content is required with an acceptable air content of plus or minus 1.5 percent.
- D. Stair Pans and Landings: Proportion normal-weight concrete mix as follows:
 - 1. Compressive Strength (28 Days): 3000 psi.
 - 2. Maximum Aggregate Size: 3/8 - inch.
 - 3. Maximum Slump (Inch): 3
 - 4. Maximum Water-Cement Ratio: 0.50.
- E. Parking Structure - Columns: Proportion normal-weight concrete mix as follows:
 - 1. Compressive Strength (28 Days): 6000 psi.
 - 2. Maximum Aggregate Size: 3/4 - inch.

3. Air Entrainment: 6 percent air content is required with an acceptable air content of plus or minus 1.5 percent.
 4. Maximum Water-Cement Ratio: 0.42.
 5. Corrosion Inhibitor
- F. Parking Structure – Elevated Slabs, Joists, Beams, Elevated Barrier Walls: Proportion normal-weight concrete mix as follows:
1. Compressive Strength (28 Days): 6000 psi.
 2. Maximum Aggregate Size: 3/4 - inch.
 3. Air Entrainment: A minimum of six (6) percent air content is required with acceptable range of air content is plus or minus 1.5 percent.
 4. Maximum Water-Cement Ratio: 0.40.
 5. Flyash Content: Minimum 50 lbs./yd, Maximum 100 lbs./yd.
 6. Slag Content: Minimum 50 lbs./yd, Maximum 100 lbs./yd.
 7. Silica Fume Content: Minimum 0 lbs./yd, Maximum as approved by Engineer.
 8. Maximum Chloride Absorption per ASTM C1202: 1500 coulombs.
 9. Corrosion Inhibitor
 10. Shrinkage shall not exceed 0.04% per ASTM C157 at 28 days.

PART 3 - EXECUTION

3.1 FORMWORK

- A. Design, erect, shore, brace, and maintain formwork, according to ACI 301, to support vertical, lateral, static, and dynamic loads, and construction loads that might be applied, until concrete structure can support such loads.
- B. Construct formwork so concrete members and structures are of size, shape, alignment, elevation, and position indicated, within tolerance limits stated below.
- C. Verify lines, levels, and measurement before proceeding with formwork.
- D. Earth forms are not permitted.
- E. Align form joints.
- F. Do not apply form release agent where concrete surfaces receive special finishes or applied coatings which may be affected by agent.
- G. Coordinate work of other Sections in forming and setting openings, slots, recesses, chases, sleeves, bolts, anchors, and other inserts.
- H. Provide 3/4" x 3/4" chamfer strips for all exposed concrete corners of formwork.
- I. Use mechanical rebar splicers and anchors in order to reduce congestion.

3.2 REINFORCEMENT

- A. Place, support, and secure reinforcement against displacement.

- B. Locate reinforcing splices as shown on Drawings.
- C. Cut ends of epoxy coated rebars shall be coated with epoxy material equivalent to factory coating.
- D. Damage to rebar coating as a result of bending shall be repaired with equivalent coating.

3.3 VAPOR RETARDERS

- A. Vapor retarders shall be provided where slabs will receive vapor-sensitive floor coverings or in humidity-controlled areas or as indicated on drawings.
 - 1. Install vapor retarders directly under concrete slab-on-ground at areas with vapor-sensitive floor coverings and where subgrade granular material is subject to future moisture infiltration.
 - 2. Where subgrade material is dry, and will not be subject to future moisture infiltration and where humidity will be controlled, place the vapor retarder beneath the dry granular material and the concrete slab-on-ground directly on the dry granular material.
- B. Installation of Water Vapor Retarders shall be in accordance with ASTM E1643.
- C. Edges shall be lapped six (6) inches and sealed.
- D. Contractor is responsible for maintaining conditions to provide a dry subgrade material where the slab is cast on top of granular material.
- E. Contractor is responsible for maintaining a puncture free vapor retarder. Any punctures shall be sealed appropriately to prevent vapor transmission.
- F. Do not disturb vapor retarder while placing reinforcement.

3.4 PLACING CONCRETE

- A. Notify Engineer a minimum of 48 hours prior to commencement of concreting operations.
- B. Failure to notify Engineer may result in rejection of concrete placed without observation.
- C. Place concrete in accordance with ACI 301.
- D. Place pumped concrete in accordance with ACI 304.2R. Line coating mix to initiate pumping shall not be used in pour but shall be wasted.
- E. Ensure reinforcement and embedded items are not disturbed during concrete placement.
- F. Concrete with excessive honeycomb or embedded debris shall be rejected and replaced at no cost to OWNER.
- G. Application of surface retarders and sawcutting of joints shall be planned in advance.
- H. Immediately after placement, protect concrete from premature drying, excessively hot or cold temperatures and mechanical injury.

- I. Placing During Hot Weather:
 - 1. Place concrete during hot weather conditions in accordance with ACI 305R.
- J. Placing During Cold Weather:
 - 1. Place concrete during cold weather conditions in accordance with ACI 306.1.
- K. Maintain concrete with minimal moisture loss at relatively constant temperature for period necessary for hydration of cement and hardening of concrete.

3.5 FLOOR SLABS - GROUND

- A. Place floor slabs-on-ground with contraction and construction joints as indicated on Drawings.
- B. Saw cut contraction joints as soon as possible, without raveling, after placement of concrete, but within 24 hours.
- C. Cut slabs with 3/16-inch thick blade, cutting one-fourth depth of slab thickness.
- D. Separate slabs on fill from vertical surfaces with a joint filler.
- E. Extend joint filler from bottom of slab to within 1/8-inch of finished slab surface.
- F. Parking shall be floated and broom finished in accordance with ACI 302.1R. Immediately after finishing, begin curing.
- G. Commercial and security office floor finish shall be single toweled.

3.6 FLOOR CURING AND TREATMENT

- A. Wet burlap curing shall begin promptly to prevent drying of concrete. Moist curing shall continue for seven (7) days after placing.
- B. Do not allow concrete to cool rapidly.
- C. Keep forms covered and burlap continually moist during the first seven (7) days of the curing period.
- D. Verify compatibility of floor treatment materials with mastics and finish materials to be applied to floor.
- E. Provide a moist cure for a full seven (7) days through the use of burlap. Material shall completely cover the concrete surface and shall be weighted down to prevent shifting due to wind or other factors.

3.7 REPAIR OF VERTICAL SURFACE DEFECTS

- A. Upon stripping of forms, vertical surfaces shall be inspected for defects caused by surface air voids, honeycombing, form tie holes, peeling, and fins.

- B. Surface air voids shall be repaired with a unit packaged mixture of sand and cement mixed on job site with water and a unit of acrylic. Mixture shall be brushed uniformly on to surface and into voids. Where surface is to be exposed, surface finish of repair shall match adjacent surface. Final appearance of exposed concrete shall be approved by Engineer and Owner.
- C. Honeycombed and other defective concrete shall be removed down to sound concrete and patched to match adjacent surfaces.

3.8 FINISHING OF FORMED SURFACES

- A. After removal of forms and repair of defects, surfaces of concrete shall be given finishes specified below.
- B. When finish is to match a sample furnished to Contractor, sample finish shall be reproduced on an area at least 100 square feet in size in an inconspicuous location designated by Engineer prior to application in the specified area. Application of finish shall not be made until approved by Engineer.
- C. Rough Form Finish: Surface left with texture imparted by forms; form facing material not specified; tie holes and defects shall be patched; fins exceeding 1/4-inch shall be chipped or rubbed off.
- D. Smooth Form Finish: Surface produced by form facing material shall be a smooth, hard, uniform texture on concrete; forms may be plywood, tempered form grade hardboard, metal, plastic, paper or other acceptable material capable of producing finish; arrangement of facing material shall be orderly and symmetrical with number of seams kept to practical minimum; forms supported to prevent deflection and to maintain tolerances; tie holes and defects shall be patched; all fins shall be removed.
- E. Tops of walls or buttresses, horizontal offsets, and similar unformed surfaces occurring adjacent to formed surfaces shall be struck smooth after concrete is placed and shall be floated to a texture reasonably consistent with that of formed surface.
- F. Final finish on formed surfaces shall continue uniformly across unformed surfaces.
- G. Where a schedule of finishes is not included in this Section, or finishes are not shown on Drawings, the following finishes shall be used as applicable: Rough Form Finish for all concrete surfaces not exposed to public view; Smooth Form Finish with Grout Cleaned Finish for all concrete surfaces exposed to public view.

3.9 TOLERANCES

- A. All tolerances for concrete work shall be in accordance with ACI 117.

3.10 FIELD QUALITY CONTROL

- A. Testing and analysis of concrete shall be performed under provisions of Division 01.
- B. Testing firm will cast test cylinders and perform slump and air entrainment tests in accordance with ACI 301.

- C. Three concrete test cylinders shall be cast from each increment of 100 cubic yards of each class of concrete placed each day or from each placement of each class if less than 100 cubic yards.
- D. During hot or cold weather, as defined in Section 1.6, one additional test cylinder shall be cast from each increment of 100 cubic yards of each class of concrete placed each day or from each pour of each class if less than 100 cubic yards and be cured on site under same conditions as concrete it represents.
- E. One slump test will be taken for each set of tests cylinders cast and whenever consistency of concrete appears to vary.
- F. No water may be added to the concrete at the site unless pre-approved in writing by the Engineer for that specific mix. If pre-approved, the mix ticket must state how much water may be added.

3.11 PREPARATION OF EXISTING WORK

- A. Drill holes in existing concrete, insert steel dowels and pack with non-shrink grout where new concrete is doweled to existing concrete work.
- B. Prior to placement of new concrete clean with steel brush and apply bonding agent in accordance with manufacturer's instructions.

END OF SECTION

SECTION 03 64 07
CRACK INJECTION REPAIRS FOR PARKING STRUCTURES

PART 1 - GENERAL

1.1 SUMMARY

- A. Section Includes:
1. Crack repair, crack waterproofing, and void filling in concrete members by pressure injection of flexible epoxies.
 2. Section also includes conducting tests to confirm the success of the repair performed.
 3. Cleaning concrete surfaces at cracks to be injected.
 4. Sealing the exterior surface of the crack and installing injection ports.
 5. Injection of the specified materials into cracks in concrete beams and slabs on all areas of the structure.
 6. See Bid Form for quantities. Payment shall be by linear foot of crack injected.
- B. Related Sections:
1. Applicable provisions of Division 01 – General Requirements shall govern all Work under this section.
 2. Section 03 01 07 – Concrete Restoration for Parking Structures.
 3. Section 03 15 07 – Vehicular Traffic Expansion Joint Assemblies for Parking Structures.
 4. Section 03 31 07 – Structural Concrete for Parking Structures.
 5. Section 07 14 07 – Fluid-Applied Waterproofing for Parking Structures.
 6. Section 07 19 07 – Water Repellents for Parking Structures.
 7. Section 07 90 07 – Joint Protection for Parking Structures.

1.2 REFERENCES

- A. ASTM International (ASTM):
1. ASTM C42 - Standard Test Method for Obtaining and Testing Drilled Cores and Sawed Beams of Concrete.
 2. ASTM D412 – Standard Test Methods for Vulcanized Rubber and Thermoplastic Elastomers - Tension.
 3. ASTM C321 – Standard Test Method for Bond Strength of Chemical Resistant Mortars.
 4. ASTM C881 – Standard Specification for Epoxy Resin Base Bonding Systems for Concrete.
 5. ASTM C882 – Standard Test Method for Bond Strength of Epoxy Resin Systems used with Concrete by Slant Shear.
 6. ASTM D570 – Standard Test Method for Water Absorption of Plastics.
 7. ASTM D638 – Standard Test Method for Tensile Properties of Plastics.
 8. ASTM D648 – Standard Test Method for Deflection Temperature of Plastics Under Flexural Load in the Edgewise Position.
 9. ASTM D695 – Standard Test Method for Compressive Properties of Rigid Plastics.
 10. ASTM D732 – Standard Test Method for Shear Strength of Plastics by Punch Tool.
 11. ASTM D790 – Standard Test Methods for Flexural Properties of Unreinforced and Reinforced Plastics and Electrical Insulating Materials.
 12. ASTM D2240 – Standard Test Method for Rubber Property - Durometer Hardness.

1.3 SUBMITTALS

- A. Division 01 – General Requirements: Submittal procedures.
- B. Product Data: Submit product data including characteristics, limitations, and identify dissolving solvents, fuels and potential destructive compounds.
- C. Manufacturer’s Installation Instructions: Submit special environmental requirements to install the Product. Submit statement of procedures, and description of equipment and injection method to be used prior to commencing work.
- D. Material Safety Data Sheets: Submit Material Safety Data Sheets for all materials to be used. Contractor shall include his proposed safety procedures for handling and storage of these materials.

1.4 QUALIFICATIONS

- A. Manufacturer: Company specializing in manufacturing products specified in this Section with minimum five (5) years documented experience.
- B. Applicator: Company specializing in performing Work of this Section with minimum five (5) years documented experience approved by manufacturer.

1.5 PRE-INSTALLATION MEETING

- A. Division 01 - General Requirements: Pre-installation meeting.
- B. Convene minimum one week prior to commencing Work of this Section.

1.6 DELIVERY, STORAGE, AND HANDLING

- A. Division 01 - General Requirements: Product storage and handling requirements.
- B. Maintain ambient storage temperature of between 45 and 65 degrees F in accordance with manufacturer’s written instructions.
- C. Keep away from heat, fire, and open flame.

1.7 ENVIRONMENTAL REQUIREMENTS

- A. Division 01 - General Requirements: Product environmental requirements.
- B. Do not install materials when temperature is below 50 degrees F or above 90 degrees F.
- C. Maintain this temperature range, 24 hours before, during, and 24 hours after installation.
- D. Restrict traffic from area where materials are being installed or are curing.

1.8 WARRANTY

- A. Division 01 – General Requirements: Product warranties and product bonds.
- B. Contractor shall furnish a three year written warranty agreeing to re-inject all cracks which fail to adhere to the surfaces of crack.

PART 2 - PRODUCTS

2.1 INJECTION MATERIALS

- A. Epoxy:
 - 1. The injection resin shall be a two-component, low viscosity, structural epoxy adhesive designed for pressure injection grouting. The injection resin shall meet or exceed the provisions of ASTM C881, Type IV, Grade 1.
 - 2. Epoxy shall be resistant to water and moisture when cured, shall be able to gel and cure to strength in the presence of moisture, and shall have sufficient working life to permit progressive injection procedures without premature blocking of the crack or the injection ports.
 - 3. The injection resin shall be supplied by BASF or Sika.
 - 4. Substitutions: Not Permitted.

2.2 SURFACE SEAL MATERIALS

- A. Surface Seal:
 - 1. The surface seal shall be a mixed epoxy resin adhesive.
 - 2. The surface seal shall have adequate strength to hold the injection ports in place and shall be capable of withstanding the pressure during adhesive injection and cure.
 - 3. The surface seal shall be capable of being removed without undue alteration of the concrete substrate surface.
 - 4. The surface seal shall be supplied by BASF or Sika.
 - 5. Substitutions: Not Permitted.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Division 01 - General Requirements: Coordination and project conditions.
- B. Verify substrate is ready to receive work, surface is clean, dry and free of substances which could affect bond of surface seal.
- C. Do not begin work until concrete substrate has cured 28 days, minimum.
- D. Prior to the performance of any work, this Contractor shall mark all cracks that require repair.

- E. The Engineer shall inspect the marked surfaces to verify adequacy and completeness prior to the performance of any work.

3.2 PREPARATION

- A. Clean concrete surfaces adjacent to cracks of dust, dirt, oil, efflorescence, paint, or other contamination which may prevent bonding of surface seal material.
- B. Wire brush surfaces and clean using water, acid, or sandblasting as appropriate. Rinse the surface and allow to dry.
- C. Provide temporary entry ports located on the crack surface.
- D. Space the entry ports to accomplish movement of injection fluids between adjacent portions, but not greater than the depth of the crack to be filled or the thickness of the concrete member.
- E. Provide temporary surface seal material at the concrete crack face between and around the entry ports. Surface seal shall act to arrest the extrusion of injection materials.
- F. Surface seal may need to be applied to both surfaces on cracks that pass through the concrete member. Allow the surface seal to completely cure before beginning the epoxy injection.
- G. Protect adjacent surfaces.

3.3 EPOXY INJECTION

- A. Inject epoxy into prepared entry ports using sufficient pressure and equipment appropriate for this application to insure 95 percent (minimum) penetration of cracks.
- B. Injection shall begin at the lowest entry port and continue until the adhesive emerges from the two adjacent entry ports.
- C. Seal the injection port and transfer injection to the adjacent entry port.
- D. Continue the process of injection from port to port until the entire crack is filled.
- E. After the crack has been completely filled, permit the adhesive to cure.
- F. After the adhesive has cured, remove the surface seal and temporary ports as well as any adhesive runs or spills from the concrete surface.
- G. Clean the surfaces adjacent to the repair and blend the finish to match adjacent concrete surfaces.

3.4 PROTECTION OF INSTALLED CONSTRUCTION

- A. Division 01 - General Requirements: Protecting installed construction.
- B. Do not permit traffic over repaired areas until the injection adhesive has cured.

END OF SECTION

2020 Parking Garage Maintenance

03 64 07 - 5

**Crack Injection Repairs for
Parking Structures**

Contract No. 8885

© 2020 – Graef-USA Inc.

2019-5035.00

SECTION 04 01 01

MAINTENANCE OF MASONRY

PART 1 - GENERAL

1.1 SUMMARY

A. Section Includes:

1. Water cleaning of brick surfaces.
2. Replacement of brick units.
3. Repair of damaged masonry.

B. Related Sections:

1. Applicable provisions of Division 01 – General Requirements shall govern all work under this Section.
2. Section 04 05 14 - Masonry Mortaring and Grouting.
3. Section 07 19 01 – Clear Penetrating Sealers.
4. Section 07 19 07 - Water Repellents for Parking Structures.
5. Section 07 90 00 - Joint Protection for Parking Structures.

1.2 REFERENCES

A. American Concrete Institute (ACI):

1. ACI 530 - Building Code Requirements for Masonry Structures.
2. ACI 530.1 - Specifications for Masonry Structures.

1.3 QUALITY ASSURANCE

- ###### A. Perform Work in accordance with ACI 530 and ACI 530.1 requirements.

1.4 QUALIFICATIONS

- ###### A. Manufacturer: Company specializing in manufacturing products specified in this section with minimum five (5) years experience.
- ###### B. Installer: Company specializing in performing Work of this section with minimum five (5) years experience.

1.5 MOCKUP

- ###### A. Division 01 – General Requirements: Mockup requirements.
- ###### B. Clean a wall panel, 10 x 10 ft to determine extent of cleaning cleaning methods and cleaning products.
- ###### C. Repeat, using same cleaning methods until acceptable.

- D. Locate where directed by Engineer.
- E. Acceptable panel will become standard for work of this section.

1.6 DELIVERY, STORAGE, AND HANDLING

- A. Division 01 – General Requirements: Product storage and handling requirements.
- B. Store mortar ingredients in manufacturer's packaging, or when delivered loose, with adequate weatherproof covering.

1.7 ENVIRONMENTAL REQUIREMENTS

- A. Cold Weather Requirements: In accordance with ACI 530.1 when ambient temperature or temperature of masonry units is less than 40 degrees F.
- B. Hot Weather Requirements: In accordance with ACI 530.1 when ambient temperature is greater than 100 degrees F or ambient temperature is greater than 90 degrees F with wind velocity greater than eight (8) mph.

PART 2 - PRODUCTS

2.1 COMPONENTS

- A. Cleaning Agent: Detergent type.
- B. Clay Brick: Owner has supply of salvaged brick for this work.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Verify surfaces to be cleaned are ready for work of this section.

3.2 PREPARATION

- A. Protect elements surrounding work of this section from damage or disfiguration.
- B. Immediately remove stains, efflorescence, or other excess resulting from work of this section.
- C. Construct barriers to close off occupied areas.

3.3 INSTALLATION

- A. Rebuilding:
 - 1. Cut out damaged and deteriorated masonry with care in manner to prevent damage to adjacent remaining materials.
 - 2. Support brick structure in advance of cutting out units to maintain stability of remaining materials.

3. Cut away loose or unsound adjoining masonry stone and mortar as directed by Engineer to provide firm and solid bearing for new work.
 4. Build in new masonry units following procedures for new work specified in Section 04 05 14 – Masonry Mortaring and Grouting.
 5. Mortar Mix: Colored and proportioned to match existing work.
 6. Install built in masonry work to match and align with existing, with joints and coursing true and level, faces plumb and in line. Build in openings, accessories and fittings.
- B. Repointing:
1. Cut out loose or disintegrated mortar in joints to minimum 1/2 inch depth or until sound mortar is reached.
 2. Utilize power tools only after test cuts determine no damage to masonry units results.
 3. Do not damage masonry units.
 4. When cutting is complete, remove dust and loose material by brushing.
 5. Premoisten joint and apply mortar specified in Section 04 05 14 – Masonry Mortaring and Grouting. Pack tightly in maximum 1/4 inch layers. Form smooth, compact concave joint to match existing.
 6. Moist cure for 72 hours.
- C. Cleaning Existing Masonry
1. High Pressure Cold Water: Cold water blast brick masonry surfaces at specified locations, providing uniform finish.

3.4 CLEANING

- A. Division 01 – General Requirements: Final cleaning.
- B. As work proceeds and on completion, remove excess mortar, smears, droppings.
- C. Clean surrounding surfaces.

END OF SECTION

SECTION 04 05 14
MASONRY MORTARING AND GROUTING

PART 1 - GENERAL

1.1 SUMMARY

- A. Section includes mortar for masonry.
- B. Related Sections:
 - 1. Applicable provisions of Division 01 – General Requirements shall govern all work under this Section.
 - 2. Section 04 01 01 - Maintenance of Masonry: Bedding and pointing mortar for masonry restoration work.

1.2 UNIT PRICE - MEASUREMENT AND PAYMENT

- A. See bid form.

1.3 REFERENCES

- A. American Concrete Institute (ACI):
 - 1. ACI 530 - Building Code Requirements for Masonry Structures.
 - 2. ACI 530.1 - Specifications for Masonry Structures.
- B. ASTM International (ASTM):
 - 1. ASTM C5 - Standard Specification for Quicklime for Structural Purposes.
 - 2. ASTM C91 - Standard Specification for Masonry Cement.
 - 3. ASTM C144 - Standard Specification for Aggregate for Masonry Mortar.
 - 4. ASTM C150 - Standard Specification for Portland Cement.
 - 5. ASTM C270 - Standard Specification for Mortar for Unit Masonry.
 - 6. ASTM C387 - Standard Specification for Packaged, Dry, Combined Materials for Mortar and Concrete.
 - 7. ASTM C476 - Standard Specification for Grout for Masonry.

1.4 SUBMITTALS

- A. Division 01 – General Requirements: Submittal requirements.
- B. Samples: Submit two samples of mortar, illustrating mortar color and color range.
- C. Design Data: Submit design mix when Property specification of ASTM C270 is to be used, required environmental conditions, and admixture limitations.
- D. Test Reports:
 - 1. Submit reports on mortar indicating conformance of mortar to property requirements of ASTM C270.

- E. Manufacturer's Installation Instructions: Submit manufacturer's installation instructions.
- F. Manufacturer's Certificate: Certify products meet or exceed specified requirements.

1.5 QUALITY ASSURANCE

- A. Perform Work in accordance with ACI 530 and ACI 530.1.

1.6 ENVIRONMENTAL REQUIREMENTS

- A. Division 01 – General Requirements.
- B. Cold Weather Requirements: In accordance with ACI 530.1 when ambient temperature or temperature of masonry units is less than 40 degrees F.
- C. Hot Weather Requirements: In accordance with ACI 530.1 when ambient temperature is greater than 100 degrees F or ambient temperature is greater than 90 degrees F with wind velocity greater than 8 mph.

PART 2 - PRODUCTS

2.1 COMPONENTS

- A. Premix Mortar: ASTM C387/C387M, Type S, with color to match existing mortar.
- B. Water: Clean and potable.
- C. Mortar Color: Match existing.
- D. Calcium chloride is not permitted.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Division 01 – General Requirements: Coordination and project conditions.

3.2 INSTALLATION

- A. Install mortar.

3.3 FIELD QUALITY CONTROL

- A. Division 01 – General Requirements: Field inspecting, testing, adjusting, and balancing.
- B. Establishing Mortar Mix: In accordance with ASTM C270.

END OF SECTION

SECTION 05 50 00
METAL FABRICATIONS

PART 1 - GENERAL

1.1 SUMMARY

- A. Section includes shop fabricated metal items as follows:
 - 1. Structural supports for miscellaneous attachments.
- B. Related Sections:
 - 1. Applicable provisions of Division 01 – General Requirements shall govern all work under this Section.

1.2 REFERENCES

- A. ASTM International (ASTM):
 - 1. ASTM A36 - Standard Specification for Carbon Structural Steel.
 - 2. ASTM A53 - Standard Specification for Pipe, Steel, Black and Hot-Dipped, Zinc-Coated, Welded and Seamless.
 - 3. ASTM A123 - Standard Specification for Zinc (Hot-Dip Galvanized) Coatings on Iron and Steel Products.
 - 4. ASTM A153 - Standard Specification for Zinc Coating (Hot-Dip) on Iron and Steel Hardware.
 - 5. ASTM A240 - Standard Specification for Chromium and Chromium-Nickel Stainless Steel Plate, Sheet, and Strip for Pressure Vessels and for General Applications.
 - 6. ASTM A269 - Standard Specification for Seamless and Welded Austenitic Stainless Steel Tubing for General Service
 - 7. ASTM A276 - Standard Specification for Stainless Steel Bars and Shapes.
 - 8. ASTM A653 - Standard Specification for Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy-Coated (Galvannealed) by the Hot-Dip Process
 - 9. ASTM A992 - Standard Specification for Structural Steel Shapes.
- B. American Welding Society (AWS):
 - 1. AWS A2.4 - Standard Symbols for Welding, Brazing, and Nondestructive Examination.
 - 2. AWS D1.1 - Structural Welding Code - Steel.
 - 3. AWS D1.6 - Structural Welding Code - Stainless Steel.
- C. The Society for Protective Coatings (SSPC):
 - 1. SSPC - Steel Structures Painting Manual.
 - 2. SSPC SP 1 - Solvent Cleaning.
 - 3. SSPC SP 10 - Near-White Blast Cleaning.
 - 4. SSPC Paint 15 - Steel Joist Shop Paint.
 - 5. SSPC Paint 20 - Zinc-Rich Primers (Type I - Inorganic and Type II - Organic).

1.3 SUBMITTALS

- A. Division 01 – General Requirements: Submittal requirements.

- B. Shop Drawings: Indicate profiles, sizes, connection attachments, reinforcing, anchorage, size and type of fasteners, and accessories. Include erection drawings, elevations, and details where applicable. Indicate welded connections using standard AWS A2.0 welding symbols. Indicate net weld lengths.
- C. Welders Certificates: Certify welders employed on the Work, verifying AWS qualification within previous 12 months.

1.4 SUSTAINABLE DESIGN SUBMITTALS

- A. Division 01 – General Requirements: Requirements for sustainable design submittals.

1.5 QUALITY ASSURANCE

- A. Finish joints in accordance with NOMMA Guideline 1.

1.6 DELIVERY, STORAGE, AND HANDLING

- A. Division 01 – General Requirements: Product storage and handling requirements.
- B. Accept metal fabrications on site in labeled shipments. Inspect for damage.
- C. Protect metal fabrications from damage by exposure to weather.

1.7 FIELD MEASUREMENTS

- A. Verify field measurements are as indicated on shop drawings.

PART 2 - PRODUCTS

2.1 MATERIALS - STEEL

- A. Structural W-Shapes: ASTM A992.
- B. Channels and Angles: ASTM A36.
- C. Steel Plate: ASTM A36.
- D. Hollow Structural Sections: ASTM A500, Grade B.
- E. Sheet Steel: ASTM A653, Grade 33 Structural Quality, galvanized with G90 coating class.
- F. Bolts: ASTM A325; Type 1.
 - 1. Finish: Hot dipped galvanized.
- G. Nuts: ASTM A563 heavy hex type.
 - 1. Finish: Hot dipped galvanized.]
- H. Washers: ASTM F436; Type 1.
 - 1. Finish: Hot dipped galvanized.

- I. Welding Materials: AWS D1.1; type required for materials being welded.
- J. Touch-Up Primer for Galvanized Surfaces: SSPC Paint 20 Type I Inorganic.

2.2 MATERIALS - STAINLESS STEEL

- A. Bars and Shapes: ASTM A276; Type 302.
- B. Tubing: ASTM A269; Type 304.
- C. Plate, Sheet and Strip: ASTM A240 OR ASTM A666; Type 302.
- D. Bolts, Nuts, and Washers: ASTM A354.
- E. Welding Materials: AWS D1.6; type required for materials being welded.

2.3 BOLLARDS

- A. Bollards: Steel pipe, concrete filled, crowned cap, six (6) inches diameter, length as indicated on Drawings; galvanized.
- B. Concrete Fill: 3,000 psi as specified in Section 03 31 00 – Structural Concrete.
- C. Anchors: Concealed type as indicated on Drawings.

2.4 FABRICATION

- A. Fit and shop assemble items in largest practical sections, for delivery to site.
- B. Fabricate items with joints tightly fitted and secured.
- C. Exposed Welded Joints: NOMMA Guideline 1 Joint Finish.
- D. Exposed Mechanical Fastenings: Flush countersunk screws or bolts; unobtrusively located; consistent with design of component, except where specifically noted otherwise.
- E. Supply components required for anchorage of fabrications. Fabricate anchors and related components of same material and finish as fabrication, except where specifically noted otherwise.

2.5 FACTORY APPLIED FINISHES - STEEL

- A. Prepare surfaces to be primed in accordance with SSPC SP 2.
- B. Galvanizing: ASTM A123; hot dip galvanize after fabrication.
- C. Galvanizing for Fasteners, Connectors, and Anchors:
 - 1. Hot-Dipped Galvanizing: ASTM A153.
 - 2. Mechanical Galvanizing: ASTM B695; Class 50 minimum.

2.6 FACTORY APPLIED FINISHES - STAINLESS STEEL

- A. Satin Polished Finish: Number 4, satin directional polish parallel with long dimension of finished face.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Division 01 – General Requirements: Coordination and project conditions.
- B. Verify field conditions are acceptable and are ready to receive Work.

3.2 INSTALLATION

- A. Install items plumb and level, accurately fitted, free from distortion or defects.
- B. Make provisions for erection stresses. Install temporary bracing to maintain alignment, until permanent bracing and attachments are installed.
- C. Field weld components indicated on Drawings.
- D. Perform field welding in accordance with AWS D1.1.
- E. Obtain approval of [Engineer] [Engineer/Architect] prior to site cutting or making adjustments not scheduled.
- F. After erection, touch up welds, abrasions, and damaged finishes with prime paint or galvanizing repair paint to match shop finishes.

3.3 ERECTION TOLERANCES

- A. Division 01 – General Requirements: Tolerances.

3.4 FIELD QUALITY CONTROL

- A. Welding: Inspect welds in accordance with AWS D1.1.

END OF SECTION

SECTION 07 18 00
TRAFFIC COATINGS

PART 1 - GENERAL

1.1 SUMMARY

- A. Section includes fluid applied membrane coating.
- B. Related Sections:
 - 1. Applicable provisions of Division 01 – General Requirements shall govern all work under this Section.
 - 2. Section 07 90 07 - Joint Protection for Parking Structures: Joint between traffic membrane and membrane termination.
 - 3. Section 07 95 07 – Traffic Joint Expansion Assemblies for Parking Structures.

1.2 REFERENCES

- A. ASTM International (ASTM):
 - 1. ASTM D412 - Standard Test Methods for Vulcanized Rubber and Thermoplastic Elastomers-Tension.
 - 2. ASTM D903 - Standard Test Method for Peel or Stripping Strength of Adhesive Bonds.
 - 3. ASTM D1044 - Standard Test Method for Resistance of Transparent Plastics to Surface Abrasion.
 - 4. ASTM E84 - Standard Test Method for Surface Burning Characteristics of Building Materials.
 - 5. ASTM E96 - Standard Test Methods for Water Vapor Transmission of Materials.

1.3 SUBMITTALS

- A. Division 01 – General Requirements: Submittal procedures.
- B. Product Data: Submit product characteristics, limitations, and identify dissolving solvents, fuels, and potential destructive compounds.
- C. Submit stepped sample of coating system applied to ¼” x 6” x 6” plywood or similar rigid base showing each component for each duty grade to be applied. Sample shall be noted with component mil thicknesses and aggregate size and manufacturer. Also submit sample of aggregate to be used.
- D. Manufacturer's Installation Instructions: Submit special environmental conditions required to install the Product and potential incompatibilities with adjacent materials.
- E. Applicator's License Certificate
 - 1. Submit copy of 'Certificate of License' issued to system applicator by traffic coating manufacturer.

1.4 CLOSEOUT SUBMITTALS

- A. Division 01 – General Requirements: Closeout procedures.
- B. Maintenance Manual
 - 1. Upon completion of work required by this Section, submit maintenance manual, identified with project name, location and date; type of coating system applied and surface to which system was applied, including sketches where necessary. Include recommendations for periodic inspections, care and maintenance and snow removal guideline. Identify common causes of damage with instructions for temporary patching until permanent repair can be made.
- C. Warranty
 - 1. Installer shall review surface condition of slab prior to the installation of traffic coating system. Written notice shall be provided to Engineer stating any condition which will impair performance of traffic coating system, including compatibility with existing traffic coating were present. Installation of traffic coating system shall constitute acceptance of surface by Installer.
 - 2. Completed installation shall be guaranteed jointly and severally on a single document, by traffic coating manufacturer and applicator, against defects of materials and workmanship for a period of 5 years. Warranty shall cover delamination of system from substrate and degradation of waterproofing ability.
 - 3. Installer and manufacturer shall provide labor and materials to repair deficiencies or defects which develop due to normal use. Snowplows, abrasive maintenance equipment, and vandalism are not normal traffic use and are exempt from the warranty.

1.5 QUALIFICATIONS

- A. Manufacturer: Company specializing in manufacturing products specified in this section with minimum five (5) years documented experience.
- B. Applicator: Company specializing in performing Work of this section with minimum five (5) years documented experience.

1.6 MOCKUP

- A. Division 01 – General Requirements: Requirements for mockup.
- B. Construct mockup panel, 10' feet long by 10' feet wide, including membrane system applied to representative substrate.
- C. Locate where directed by Engineer.
- D. Incorporate accepted mockup as part of Work.

1.7 PRE-INSTALLATION MEETINGS

- A. Division 01 – General Requirements: Pre-installation meeting.

- B. A pre-construction meeting is required with Contractor in order to coordinate work schedule and inspection required by Engineer. Stepped sample of coating system shall be reviewed and agreed to for surface texture. Approved surface texture shall be used throughout. Areas deemed to vary from sample shall be recoated at no additional cost. These primarily are areas devoid of surface aggregates that present a slippery surface when wet.
- C. Convene minimum one (1) week prior to commencing work of this section.

1.8 APPLICATOR QUALIFICATIONS

- A. System applicator shall be licensed or trained to install selected traffic coating system and shall have experience in application of fluid applied deck coatings. Contractor or their subcontractor shall submit qualifications to A/E showing traffic coating applicator has experience in installing specified traffic coating. Traffic coating applicator shall have completed a minimum of 200,000 sq. ft. of traffic coating application. Qualifications shall consist of a minimum of five (5) projects completed within the past 5 years using traffic coating Contractor proposes to install for this Project. List shall include name of project, location, areas of product application, and contact person with phone number. Projects listed shall be a minimum of 10,000 sq. ft. per project listed.

1.9 DELIVERY, STORAGE, AND HANDLING

- A. Division 01 – General Requirements: Product storage and handling requirements.
- B. Maintain ambient storage temperature of 55 degrees F.

1.10 ENVIRONMENTAL REQUIREMENTS

- A. Division 01 – General Requirements: Environmental requirements.
- B. Do not install materials when temperature is below 50 degrees F or above 90 degrees F.
- C. Maintain this temperature range, 24 hours before, during and 72 hours after application.
- D. Restrict traffic from area where materials are being installed or are curing.
- E. Rain shall not be anticipated within 8 hours of application.
- F. Substrate surface temperatures shall be above 40 deg F and lower than 110 deg F. Proper notices shall be given prior to start of membrane application.
- G. Proper notices shall be given prior to start of membrane installation.
- H. Positive ventilation for interior applications is to be continuously supplied throughout application period and 8 hours after. Installer is responsible for fume control. Air intakes for buildings are to be protected against infiltration of fumes into ventilation systems.

1.11 WARRANTY

- A. Division 01 – General Requirements: Product warranties and product bonds.

- B. Furnish five (5) year manufacturer warranty coverage for delamination of system from substrate, degradation of waterproofing ability and [_____].

PART 2 - PRODUCTS

2.1 TRAFFIC MEMBRANE

- A. Components shall be products of selected traffic coating system or shall be certified as compatible with components produced by system manufacturer.
- B. Traffic coating system shall be a fully adhered, fluid applied, traffic bearing, elastomeric membrane system. System shall be capable of preventing infiltration of water, salts, gasoline and other fluids into concrete.
- C. Installer shall not change traffic coating system after selection of system has been made without approval of A/E.
- D. Installer shall verify slab surface condition prior to installation of system. Areas of heavy wear or slab irregularities shall be filled prior to traffic coating placement to assure a level, uniform surface. This shall be done according to membrane manufacturers recommendations.
- E. Areas identified having a topping system shall be manufacturer's heavy-duty system. These systems shall consist of a primer, base coat or membrane, wear coat and topcoat.
- F. Wear coats are to be saturated with aggregate.
- G. Material thicknesses are wet film thicknesses. Thickness listed for wear coat does not include aggregate.
- H. Approved traffic coating systems include systems described for Full System replacement. At placement for worn membrane the replacement will consist of wear coat and finish or top coat:
 - 1. Overture Center Ramp, State Street Campus - Lake and Frances, and State Street Capitol:
 - a. "MasterSeal Traffic 2500 - Heavy Duty Traffic System" by BASF. System shall consist of primer, base coat, intermediate coat, and finish coat. Total wet film thickness shall be 50 mils exclusive of aggregate. Thickness does not include primer. Color: Grey.
 - b. Requests for substitutions will be considered in accordance with the submittals of Section 0100 00 - General Requirements.
 - 2. Capitol Square North Ramp:
 - a. "Kelmar FWC III - Exposure 3" by Technical Barrier Systems. System shall consist of primer, base coat, wear coat, and finish coat. Total wet film thickness shall be 71 mils exclusive of aggregate. Thickness does not include primer. Color: Black.
 - b. Requests for substitutions will be considered in accordance with the submittals of Section 0100 00 - General Requirements.
- I. Where lapping onto existing traffic coating, new traffic coating shall be compatible and match existing. Contractor shall perform "pull off" bond test or similar to prove compatibility with existing.
- J. Color:

1. Topcoat color varies and shall match existing.
- K. Installer shall furnish related materials required for crack repair, cant sealant, overbanding and flashing per system manufacturers' requirements to achieve a complete waterproof system.

PART 3 - EXECUTION

3.1 GENERAL

- A. Work shall be performed in accordance with manufacturer's specifications.

3.2 CONDITION OF SURFACES

- A. Before coating work is commenced, top surface of slab shall be shot-blasted to remove laitance concrete from existing, replaced, or new concrete slab. Areas of worn or heavily weathered membrane to receive a new wear coat shall also be shot-blasted prior to application. Surfaces shall be cleaned with oil free compressed air jet following shot-blasting.
- B. Concrete slabs shall be prepared using a shot-blast machine followed by cleaning with a compressed air jet. Prepared concrete shall have a surface profile of CSP 3-4 (Concrete Surface Preparation 3-4 as established by International Concrete Repair Institute #310.2-1997). Surface appearance shall be verified and approved by Owner and Engineer prior to sealer application. Note: CSP 3-4 is the typical deck coating MFG. recommendation ICRI #310.2-1997 is the new designation.
- C. Areas inaccessible to shot-blast machine shall be grit-blasted to achieve CSP 1 surface profile.
- D. Additional cleaning to remove deposits, which hinder bond of traffic coating to concrete surface, shall be done by traffic coating applicator as part of application with no additional cost to Owner.
- E. Remove foreign projections on deck by grinding or other suitable methods.
- F. Honeycomb, voids, deteriorated, or unsound concrete shall be repaired to produce a sound, uniform surface in accordance with Engineer's recommendations and as shown on Drawings.
- G. Concrete surfaces shall be visibly dry and pass a 4-hour rubber mat test (no condensation) prior to application of coating system. Mat shall be black and taped to deck on edges.
- H. Verify curing methods used for concrete are compatible with surface requirements for coating system.
- I. Top surfaces of substrates other than concrete shall be treated as required by traffic coating manufacturer.
- J. Commencement of coating installation implies acceptance of top surface of substrate area only, as suitable to accept traffic coating. Responsibility for other aspects of substrate shall be responsibility of others.

3.3 PREPARATION

- A. Rout or sawcut cracks exceeding 1/16 inch in width and fill with sealant as detailed.
- B. Traffic coating system shall bridge cracks that open up in substrate up to 1/16 inch in width maximum. Acceptable width of caulked joints is per system manufacturers' specification.
- C. Fill expansion, control and construction joints to be overcoated by deck coating with sealant. Joints larger than 1 inch shall be reviewed with traffic coating system specification.
- D. Protect adjacent surfaces with drop cloths or masking tape as required.

3.4 FLASHINGS

- A. At projections through deck coatings where projections are structurally and rigidly connected to substrate, such as posts, vents, pipes, stanchions, railings, rigidly connected wall/slab intersections and similar connected items having limited movement, provide a bead of sealant. Tool sealant to form a cant and allow to cure before overcoating. Tooled sealant shall be overlain with a fluid applied integral membrane flashing.
- B. At locations of potential high movement such as wall/slab intersections which are not structurally and rigidly connected, provide sheet flashing or reinforce coating with uncoated, woven fiberglass cloth. Where sheet flashings are used, they shall be free or unbonded to substrate near meeting angle but shall be fully bonded away from meeting angle. Do not use precured sheet flashings over expansion joints in horizontal surfaces.

3.5 PRIMER

- A. Prime concrete, masonry and metal surfaces at manufacturers recommended rate. Concrete primer shall be compatible for use intended. Note traffic coating on horizontal surface shall be placed on concrete while vertical placement may be on concrete or brick.

3.6 DETAIL WORK

- A. Apply non flowing type coating over flashings (sheet flashings, sealant cants and rigid corners). Extend coating beyond flashing out onto adjacent deck surface and extend above top of flashing and terminate in a straight line. Use masking tape.
- B. Apply non-flowing type detail coats over cracks, construction joints, cant joints, patch perimeters, etc. Detail coats shall be included in deck coating cost.
- C. Allow detail work to cure prior to installation of coating system.

3.7 BASE COAT

- A. In areas identified by Project Drawings to receive full system membrane traffic coating, apply coating material at film thickness specified. Extend coating over fluid applied flashings and detail coatings.
- B. Allow to cure per by manufacturers requirements.

- C. Areas designated to receive membrane wear coat and top coat placement will not need base coat application.

3.8 WEAR COAT

- A. Apply wear coating material at thickness specified to horizontal areas indicated on Project Drawings to receive traffic coating. Vertical surface will not receive a wear coat.
- B. While coating is still fluid, uniformly broadcast aggregate over surface. Aggregate to be applied to saturation for wear coat.
- C. Allow to cure per manufacturers requirements.
- D. Remove excess aggregate from deck surface by manual sweeping or mechanical vacuum, followed by air blast.
- E. Wear coat will be applied at locations designated to receive full system membrane and wear coat and top coat placement.

3.9 TOP COAT

- A. Apply a top coat of material as recommended by manufacturer, to encapsulate top layer of aggregate. Application of top coat is not to eliminate non-slip surface texture of membrane system in place.
- B. Allow finished installation to cure per manufacturer before permitting traffic on surfaces.
- C. Top coat will be applied at locations designated to receive full system membrane and wear coat and top coat placement.

3.10 CLEANING

- A. Clean stains from adjacent surfaces per manufacturer's instructions.
- B. Note: When using solvents for cleanup, extinguish sources of ignition in the area and observe proper precautionary measures for handling materials.
- C. Remove foreign matter from finished coating surfaces.

3.11 MAINTENANCE

- A. Damaged surfaces may be cleaned and have liquid coating and grit applied to match surrounding surface. Where a regular maintenance and cleaning program is required, surfaces may be washed with commercial detergents or chlorinated solvents.

3.12 PROTECTION OF INSTALLED CONSTRUCTION

- A. Division 01 – General Requirements: Protecting installed construction.
- B. Do not permit traffic over unprotected surfaces.

END OF SECTION

2020 Parking Garage Maintenance

07 18 00 - 8

Traffic Coatings

Contract No. 8885

© 2020 – Graef-USA Inc.

2019-5035.00

SECTION 07 19 00
CLEAR PENETRATING SEALERS

PART 1 - GENERAL

1.1 SUMMARY

- A. Section Includes:
1. Installation of CLEAR PENETRATING SEALER on masonry surfaces indicated on drawings, consisting of preparation of existing and new surfaces and clearing of glass.

1.2 REFERENCES

- A. Related Sections:
1. Section 04 10 00 – Masonry Restoration and Cleaning.
 2. Section 07 90 07 – Joint Protection for Parking Structures.
- B. ASTM International (ASTM):
1. ASTM C 140 - Methods for Sampling and Testing Concrete Masonry Units
 2. ASTM E 96 - Test Methods for Water Vapor Transmission of Materials
 3. ASTM E 514 - Standard Test Method for Water Penetration and Leakage Through Masonry
 4. ASTM G 53 - Standard Practice for Operating Light- and Water-Exposure Apparatus for Exposure of Nonmetallic Materials.

1.3 SYSTEM DESCRIPTION

- A. Product provided by this Section CLEAR PENETRATING SEALER is a concentrated, water dilutable, VOC compliant, breathable, water repellent protectant and will not harm vegetation and glass.

1.4 UNIT PRICE

- A. Paid on square footage of masonry only (not glass).
- B. Cleaning of interior and exterior of the glass shall be included.

1.5 SUBMITTALS

- A. General: Submit in accordance with Division 01.
- B. Product Data: Submit manufacturer's product literature and installation instructions.
- C. Warranty: Submit a sample warranty identifying the terms and conditions stated in Section 1.7.

1.6 QUALITY ASSURANCE

- A. Applicator Qualifications: Applicator shall be experienced in applying the same or similar materials and shall be specifically approved in writing by the membrane manufacturer.

- B. Regulatory Requirements: Comply with applicable codes, regulations, ordinances, and laws regarding use and application of products that contain volatile organic compounds (VOC).

1.7 WARRANTY

- A. Special Warranty: Provide for correcting failure of water repellent treatment to resist penetration of water.
 - 1. Warranty Period: Five years.

1.8 DELIVERY, STORAGE, AND HANDLING

- A. Deliver materials to project site in original, factory-sealed, unopened containers bearing manufacturer's name and label intact and legible with following information.
 - 1. Name of material.
 - 2. Manufacturer's stock number and date of manufacture.
 - 3. Material safety data sheet.
- B. Store material under shaded area away from direct sunlight between 40°F to 110°F. Keep away from heat, ignition/sparks and from rain/standing water. Prevent the product from freezing. Keep the container of CLEAR PENETRATING SEALER tightly closed after every withdrawal (product can start reacting with moisture in the ambient air) when not in use.

1.9 PROJECT CONDITIONS

- A. Do not apply CLEAR PENETRATING SEALER when temperatures are expected to fall below 45° F within 12 hours or when rain is expected within 4 hours following the application.
- B. Warn personnel against contact of material eyes. Wear applicable protective clothing and respiratory protection gear.
- C. Maintain work area in a neat and orderly condition, removing empty containers, rags, and rubbish daily from the site.

PART 2 - PRODUCTS

2.1 PRODUCTS

A. MATERIALS

- 1. CLEAR PENETRATING SEALER: Shall be breathable, water-based, VOC compliant, penetrating sealer which reacts chemically with the substrate to form a long-lasting, water-repellant surface.
 - a. Clear, non-yellowing water repellent treatment shall not alter appearance, color, or texture of substrate under any lighting conditions.
 - b. Shall be compatible with glass and protection not required.
 - c. Shall be compatible with landscaping/vegetation and protection not required.
 - d. Shall be compatible with sealants and joint sealers and protection not required.

B. MANUFACTURERS

- 1. Sika – Sikagard Natural Look Clear Sealer.

2. BASF – MasterProtect H177.
3. Euclid – Weather Guard.

2.2 ACCESSORY PRODUCTS

- A. Potable water: use clean potable water to mix with CLEAR PENETRATING SEALER.

PART 3 - EXECUTION

3.1 INSPECTION

- A. Before any waterproofing work is started the waterproofing applicator shall thoroughly examine all surfaces for any deficiencies.

3.2 PREPARATION

1. Field Sample:
 - a. Install at Project site or pre-selected area of building an area for field sample, as directed by Engineer.
 - 1) Provide mock-up of at least 25 square feet to include surface preparation, sealant joint, and juncture details and allow for evaluation of repellent performance and finish.
 - 2) Apply material in accordance with manufacturer's written application instructions.
 - b. Manufacturer's representative or designated representative will review technical aspects; surface preparation, application, and workmanship.
 - c. Field sample will be standard for judging workmanship on remainder of Project.
 - d. Maintain field sample during construction for workmanship comparison.
 - e. Obtain Engineer's approval of field sample before start of material application, including approval of aesthetics, color, texture and appearance.
- B. Surface Preparation: Prepare substrates in accordance with CLEAR PENETRATING SEALER manufacturer's recommendations.
 1. Clean surfaces of dust, dirt and foreign matter detrimental to proper installation of water repellent treatment by grinding and clean the dust using a non-compressed air blower or industrial vacuum cleaner followed by high pressure water-jet cleaning.

3.3 APPLICATION

- A. Apply per manufacturer's requirements.

3.4 CLEANING

- A. Clean interior and exterior of glass of stair shaft that clear penetrating sealer is applied.
- B. Use a product containing nonionic for glass cleaning.

END OF SECTION

SECTION 07 19 07
WATER REPELLENTS FOR PARKING STRUCTURES

PART 1 - GENERAL

1.1 SUMMARY

- A. Section Includes:
 - 1. Water repellent coating applied to concrete surfaces.
- B. Related Sections:
 - 1. Applicable provisions of Division 01 shall govern all work under this Section.
 - 2. Section 03 31 07 - Structural Concrete for Parking Structures: Concrete surfaces.
 - 3. Section 07 90 07 - Joint Protection for Parking Structures.

1.2 REFERENCES

- A. ASTM International (ASTM):
 - 1. ASTM D1653 - Standard Test Method for Water Vapor Transmission of Organic Coating Films.
 - 2. ASTM G154 - Standard Practice for Operating Fluorescent Light Apparatus for UV Exposure of Nonmetallic Materials.

1.3 SYSTEM DESCRIPTION

- A. Applied Penetrant: Material to restrict moisture absorption in material being treated as recommended by manufacturer for specific substrate.

1.4 SUBMITTALS

- A. Division 01 – General Requirements: Submittal procedures.
- B. Product Data: Submit details of product description, tests performed, limitations to coating, and chemical properties including percentage of solids.
- C. Manufacturer's Installation Instructions: Submit special procedures and conditions requiring special attention, and cautionary procedures required during application.
- D. Manufacturer's Certificate: Certify products meet or exceed specified requirements.

1.5 QUALIFICATIONS

- A. Manufacturer: Company specializing in manufacturing products specified in this section with minimum five (5) years documented experience.
- B. Applicator: Company specializing in performing Work of this section with minimum five (5) years documented experience.

1.6 DELIVERY, STORAGE, AND HANDLING

- A. Division 01 – General Requirements: Product storage and handling requirements.
- B. Protect coating liquid from freezing.

1.7 ENVIRONMENTAL REQUIREMENTS

- A. Division 01 – General Requirements: Environmental requirements.
- B. Do not apply coating when surface temperature is lower than 50 degrees F or higher than 100 degrees F.
- C. Do not apply coating when wind velocity exceeds manufacturer recommendations.

1.8 WARRANTY

- A. Division 01 – General Requirements: Product warranties and product bonds.
- B. Furnish five (5) year manufacturer warranty for water repellents.

PART 2 - PRODUCTS

2.1 WATER REPELLENTS

- A. Manufacturers:
 - 1. BASF Building Systems: Series: MasterProtect H400.
 - 2. Substitutions: In accordance with Division 01 – General Requirements.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Division 01 – General Requirements: Coordination and project conditions.
- B. Verify joint sealants are installed and cured.
- C. Verify surfaces to be coated are dry, clean, and free of efflorescence, oil, or other matter detrimental to application of coating.

3.2 PREPARATION

- A. Delay Work until concrete substrate is cured minimum of 30 days.
- B. Remove loose particles and foreign matter.
- C. Remove oil or foreign substance with chemical solvent which will not affect coating.

D. Pressure wash and rinse surfaces with water and let dry per manufacturers requirements.

3.3 APPLICATION

A. Apply at rate of 250 sq.ft/gallon by airless spray.

B. Apply in one continuous, uniform coat.

C. Allow to soak in and broom out puddles.

3.4 PROTECTION OF INSTALLED CONSTRUCTION

A. Division 01 – General Requirements: Protecting installed construction.

B. Protect adjacent surfaces not scheduled to receive coating.

C. Protect landscaping, property, and vehicles.

D. When applied to unscheduled surfaces, remove immediately by methods as instructed by coating manufacturer.

END OF SECTION

SECTION 07 62 00
SHEET METAL FLASHING AND TRIM

PART 1 - GENERAL

1.1 SUMMARY

- A. Section Includes:
 - 1. Fabricated sheet metal items.
- B. Related Sections:
 - 1. Applicable provisions of Division 01 – General Requirements shall govern all work under this Section.
 - 2. Section 07 90 07 - Joint Protection for Parking Structures.

1.2 REFERENCES

- A. ASTM International (ASTM):
 - 1. ASTM A240 - Standard Specification for Chromium and Chromium-Nickel Stainless Steel Plate, Sheet, and Strip for Pressure Vessels and for General Applications.
 - 2. ASTM A625 - Standard Specification for Tin Mill Products, Black Plate, Single Reduced.
 - 3. ASTM A653 - Standard Specification for Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy-Coated (Galvannealed) by the Hot-Dip Process.
 - 4. ASTM A755 - Standard Specification for Steel Sheet, Metallic Coated by the Hot-Dip Process and Prepainted by the Coil-Coating Process for Exterior Exposed Building Products.

1.3 DELIVERY, STORAGE, AND HANDLING

- A. Division 01 – General Requirements: Product storage and handling requirements.
- B. Stack material to prevent twisting, bending, and abrasion, and to provide ventilation. Slope metal sheets to ensure drainage.
- C. Prevent contact with materials causing discoloration or staining.

PART 2 - PRODUCTS

2.1 SHEET METAL FLASHING AND TRIM

- A. Stainless Steel: ASTM A240; Type dead soft fully annealed, 21 gage; smooth surface, smooth surface.

2.2 ACCESSORIES

- A. Fasteners: Stainless steel with soft neoprene washers.
- B. Sealant: Silicone type.

C. Reglets: Surface mounted rigid extruded PVC.

2.3 FABRICATION

- A. Form sections shape indicated on Drawings, accurate in size, square, and free from distortion or defects.
- B. Fabricate cleats of same material as sheet metal, interlocking with sheet.
- C. Form pieces in longest possible lengths. Laps shall be 6" minimum.
- D. Hem exposed edges on underside 1/2 inch; miter and seam corners.
- E. Form material with standing seams, except where otherwise indicated. At moving joints, use sealed lapped, bayonet-type or interlocking hooked seams.
- F. Fabricate vertical faces with bottom edge formed outward 1/4 inch and hemmed to form drip.
- G. Seal metal joints.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Division 01 – General Requirements: Coordination and project conditions.
- B. Verify roof openings, curbs, pipes, sleeves, ducts, and vents through roof are solidly set, reglets in place, and nailing strips located.
- C. Verify roofing termination and base flashings are in place, sealed, and secure.

3.2 PREPARATION

- A. Install starter and edge strips, and cleats before starting installation.
- B. Install surface mounted reglets to lines and levels indicated on Drawings. Seal top of reglets with sealant.
- C. Paint concealed metal surfaces with protective backing paint to minimum dry film thickness of 15 mil.

3.3 INSTALLATION

- A. Secure flashings in place using concealed fasteners.
- B. Apply plastic cement compound between metal flashings and felt flashings.
- C. Fit flashings tight in place. Make corners square, surfaces true and straight in planes, and lines accurate to profiles.

D. Seal metal joints watertight.

END OF SECTION

SECTION 07 90 07
JOINT PROTECTION FOR PARKING STRUCTURES

PART 1 - GENERAL

1.1 SUMMARY

- A. Section Includes:
 - 1. Sealants.
 - 2. Joint backing.
 - 3. Accessories.

- B. Related Sections:
 - 1. Applicable provisions of Division 01 – General Requirements shall govern all work under this Section.

1.2 REFERENCES

- A. ASTM International (ASTM):
 - 1. ASTM C834 - Standard Specification for Latex Sealants.
 - 2. ASTM C919 - Standard Practice for Use of Sealants in Acoustical Applications.
 - 3. ASTM C920 - Standard Specification for Elastomeric Joint Sealants.
 - 4. ASTM C1193 - Standard Guide for Use of Joint Sealants.
 - 5. ASTM D1056 - Standard Specification for Flexible Cellular Materials-Sponge or Expanded Rubber.
 - 6. ASTM D1667 - Standard Specification for Flexible Cellular Materials-Vinyl Chloride Polymers and Copolymers (Closed-Cell Foam).
 - 7. ASTM D2628 - Standard Specification for Preformed Polychloroprene Elastomeric Joint Seals for Concrete Pavements.

1.3 QUALITY ASSURANCE

- A. Applicator Qualifications:
 - 1. Contractor shall have a minimum of 3 years of experience in performing work similar to that shown in Drawings and Specifications.

- B. Warranty:
 - 1. The completed installation shall be guaranteed jointly and severally on a single document, by sealant manufacturer and installer agreeing to repair or replace sealants which fail to perform as airtight and watertight joints or fail in joint adhesion, cohesion, abrasion resistance, weather resistance, extrusion resistance, migration resistance, stain resistance or general durability or appear to deteriorate in other manner not clearly specified by submitted manufacturer's data as an inherent quality of material for exposure indicated.
 - 2. Warranty period shall be 5 years.

1.4 SUBMITTALS

- A. Division 01 – General Requirements: Submittal procedures.

- B. Products Data: Submit data indicating sealant chemical characteristics, performance criteria, substrate preparation, limitations, and color availability.
- C. Samples: Submit two samples, 1/4-inch x 2-inch in size illustrating sealant colors for selection.
- D. Manufacturer's Installation Instructions: Submit special procedures, surface preparation, and perimeter conditions requiring special attention.
- E. Warranty: Include coverage for installed sealants and accessories failing to achieve watertight seal, exhibit loss of adhesion or cohesion, and sealants which do not cure.

1.5 QUALIFICATIONS

- A. Manufacturer: Company specializing in manufacturing products specified in this section with minimum five (5) years documented experience.
- B. Applicator: Company specializing in performing Work of this section with minimum five (5) years documented experience, and approved by manufacturer.

1.6 ENVIRONMENTAL REQUIREMENTS

- A. Division 01 – General Requirements.
- B. Maintain temperature and humidity recommended by sealant manufacturer during and after installation.

1.7 COORDINATION

- A. Division 01 – General Requirements: Coordination and project conditions.
- B. Coordinate Work with sections referencing this section.

PART 2 - PRODUCTS

2.1 JOINT SEALERS

- A. Manufacturers:
 - 1. Sika Corp., Model Sikaflex-2c, SL or NS.
 - 2. BASF, Model Sonolastic SL2 or NP2.
 - 3. Substitutions: In accordance with Division 01 – General Requirements.
- B. Sealant color will be chosen at time of construction from manufacturer's standard color pallet.

2.2 ACCESSORIES

- A. Primer: Non-staining type, recommended by sealant manufacturer to suit application.
- B. Joint Cleaner: Non-corrosive and non-staining type, recommended by sealant manufacturer;

compatible with joint forming materials.

- C. Joint Backing: Round rod compatible with sealant; ASTM D1667, closed cell PVC; oversized 30 to 50 percent larger than joint width.
- D. Bond Breaker: Pressure sensitive tape recommended by sealant manufacturer to suit application.

PART 3 - EXECUTION

3.1 PRE-INSTALLATION MEETING

- A. The installer, Engineer, sealant manufacturer's technical representative and other trades involved in coordination with sealant work shall meet with Contractor at Project Site to review procedures and time schedule proposed for installation of sealants and coordination with other work. Review each major sealant application required on the Project.

3.2 EXAMINATION

- A. Division 01 – General Requirements: Coordination and project conditions.
- B. Verify substrate surfaces and joint openings are ready to receive work.
- C. Verify joint backing and release tapes are compatible with sealant.

3.3 PREPARATION

- A. Removal of sealants by means of waterblasting is not permitted.
- B. Complete removal of existing sealant is required prior to installation of new sealants.
- C. Contractor shall saw and grind surface of cracks and joints. Edges of cracks or joints to be sealed shall be of sound substrate. Prior to installing sealant, surfaces shall be cleaned of foreign debris and edges ground. Joint edges shall be slightly rounded. Rout out random cracks to a nominal depth of 3/8" and a width of 1/4".
- D. Remove loose materials and foreign matter impairing adhesion of sealant.
- E. Clean and prime joints.
- F. Perform preparation in accordance with ASTM C1193.
- G. Protect elements surrounding Work of this section from damage or disfiguration.
- H. At location of weld plate or flange connectors, grit-blast exposed steel to near white metal condition and coat with zinc rich coating. Install bond breaker tape over horizontal steel surface prior to backer rod and sealant installation.

- I. Clean joint surfaces immediately before installation of sealant or caulking compound. Grind or grit-blast joint blackouts to remove dirt, coatings, existing sealant, moisture and other substances which interfere with bond of sealant or caulking compound.
- J. Installer must examine joint surfaces, backing and anchorage of units forming sealant rabbet and conditions under which sealant work is to be performed and notify Contractor in writing of conditions detrimental to proper and timely completion of work and performance of sealants. Do not proceed with sealant work until unsatisfactory conditions have been corrected in a manner acceptable to installer.

3.4 INSTALLATION

- A. Perform installation in accordance with ASTM C1193.
- B. Prime or seal joint surfaces wherever shown or recommended by the sealant manufacturer. Do not allow primer or sealant to spill or migrate onto adjoining surfaces.
- C. Measure joint dimensions and size joint backers to achieve width-to-depth ratio, neck dimension, and surface bond area as recommended by manufacturer.
- D. Install bond breaker where joint backing is not used.
- E. Install sealant free of air pockets, foreign embedded matter, ridges, and sags.
- F. Deposit sealant in uniform, continuous ribbons without gaps or air pockets, with complete "wetting" of joint bond surfaces equally on opposite sides. Except as otherwise indicated, fill sealant to a slightly concave surface slightly below adjoining surfaces. Where horizontal joints are between a horizontal surface and a vertical surface, fill joint to form a slight cove so joint will not trap moisture and dirt.
- G. Install sealant to depths as recommended by sealant manufacturer.
- H. Tool joints smooth with adjacent surfaces.

3.5 CLEANING

- A. Division 01 – General Requirements: Final cleaning.
- B. Clean adjacent soiled surfaces.

3.6 PROTECTION OF INSTALLED CONSTRUCTION

- A. Division 01 – General Requirements: Protecting installed construction.
- B. Protect sealants until cured.

END OF SECTION

SECTION 07 95 07

VEHICULAR TRAFFIC EXPANSION JOINT ASSEMBLIES FOR PARKING STRUCTURES

PART 1 - GENERAL

1.1 SUMMARY

A. Section Includes:

1. Expansion joint assemblies for parking garage floor surfaces.
2. Removal of the existing expansion joint system, surface preparation, patching and cleaning of the existing concrete slab to receive the new expansion joint; and the installation of the new expansion joint system.

B. Related Sections:

1. Applicable provisions of Division 01 – General Requirements shall govern Work under this Section.
2. Division 03 – Concrete: Expansion and contraction joints in concrete joints.

1.2 REFERENCES

A. ASTM International (ASTM):

1. ASTM B221 - Standard Specification for Aluminum and Aluminum-Alloy Extruded Bars, Rods, Wire, Profiles, and Tubes.
2. ASTM B455 - Standard Specification for Copper-Zinc-Lead Alloy (Leaded-Brass) Extruded Shapes.

1.3 SUBMITTALS

A. Division 01 – General Requirements: Submittal requirements.

B. Shop Drawings: Indicate joint and splice locations, miters, layout of work, affected adjacent construction, anchorage locations, and details for all special conditions.

C. Product Data: Submit joint assembly profiles, profile dimensions, and anchorage devices.

D. Samples: Submit two samples 2-inch long, illustrating profile, dimension, color, and finish selected.

E. Manufacturer's Installation Instructions:

1. The system manufacturer shall furnish the Owner with a written single source performance warranty that the expansion joint sealant system be free of defects related to design, workmanship or material deficiency for a five year period from the date of substantial completion of the work required under this section. The following problems shall be specifically covered under the warranty:
 - a. Adhesive or cohesive failure of the seal.
 - b. Discoloration, crazing or other weathering deficiency of the seal.
 - c. Abrasion or tear failure of the seal resulting from normal traffic use.
 - d. Defective joint installation.

2. Perform repair under this warranty at no cost to the Owner.
 3. The system manufacturer shall submit a detailed warranty consistent with the terms of this specification prior to construction for approval. The approved warranty shall be made part of the contractual agreement and shall represent the sole warranty statement for the project.
 4. Snowplows, abrasive maintenance equipment, and vandalism are not normal traffic use and are exempt from the warranty.
 5. Furnish the Owner with five copies of the snow removal guidelines for the areas covered by this warranty.
- F. Submit two copies of the Material Safety Data Sheets for all materials to be used. Contractor shall also submit two copies of his proposed safety procedures for handling and storage of this material.
- G. Submit a written statement from the manufacturer describing shelf life for materials and products to be furnished and used on this project.

1.4 QUALIFICATIONS

- A. Manufacturer: Company specializing in manufacturing products specified in this Section with not less than five (5) years experience.
- B. Applicator: Company specializing in applying work of this Section with not less than five (5) years experience and acceptable to manufacturer.

1.5 PRE-INSTALLATION MEETINGS

- A. Division 01 – General Requirements: Pre-installation meeting.
- B. Convene minimum one (1) week prior to commencing work of this section.

1.6 FIELD MEASUREMENTS

- A. Verify field measurements are as instructed by manufacturer.

1.7 DELIVERY, STORAGE, AND HANDLING

- A. Division 01 – Product Requirements: Product storage and handling requirements.
- B. Delivery material to project in sealed, original packages or containers bearing name and brand of manufacturer and date manufactured.
- C. Every precaution shall be taken to avoid danger of fire. Store hazardous materials in accordance with local ordinances. Provide dry chemical or CO2 fire extinguishers in areas. Allow no smoking or open containers of solvents. Store solvents in safety cans.
- D. Store materials at temperatures not exceeding those recommended by membrane manufacturer.

- E. Manufacturer shall submit to Engineer a written statement of materials' shelf life and proper storage conditions. Materials that have been improperly stored or that have an expired shelf life shall not be installed.

1.8 WARRANTY

- A. The system manufacturer shall furnish the Owner with a written single source performance warranty that the expansion joint sealant system be free of defects related to design workmanship or material deficiency for a five year period from the date of substantial completion of the work required under this section. The following problems shall be specifically covered under the warranty:
 - 1. Adhesive or cohesive failure of the seal.
 - 2. Discoloration, crazing or other weathering deficiency of the seal.
 - 3. Abrasion or tear failure of the seal resulting from normal traffic use.
 - 4. Defective joint installation.
- B. Perform repair under this warranty at no cost to the Owner.
- C. The system manufacturer shall submit a detailed warranty consistent with the terms of this specification prior to construction for approval. The approved warranty shall be made part of the contractual agreement and shall represent the sole warranty statement for the project.
- D. Snowplows, abrasive maintenance equipment, and vandalism and are not normal traffic use and are exempt from the warranty.
- E. Furnish the Owner with five copies of the snow removal guidelines for the areas covered by this warranty.

1.9 MAINTENANCE

- A. Manufacturer shall provide Owner a preventive maintenance guidelines for parking structure expansion control systems.

PART 2 - PRODUCTS

2.1 EXPANSION JOINT SYSTEMS

- A. Expansion joint system shall consist of a thermoplastic rubber elastomeric membrane embedded in an elastomeric concrete material capable of bonding to substrate. Joint shall have a fire barrier system capable of providing a two (2) hour fire rating.
- B. Expansion joint systems with nosing shall be:
 - 1. "WaboCrete Membrane System – ME Series" by Watson Bowman ACME
 - 2. "Thermafex Membrane/Nosing System, Type TCR" by Emseal
 - 3. Or approved equal.
- C. Expansion joint systems without nosing shall be:
 - 1. "Wabo H Seal – Model EH" by Watson Bowman ACME

2. "DSM System" by Emseal
3. Or approved equal.

2.2 COMPONENTS

- A. Gland Element: Thermoplastic elastomeric rubber membrane, exhibiting Shore A hardness of 60-80 Durometer.
- B. Header Material (Nosing): Elastomeric polyurethane material mixed with aggregate, exhibiting Shore D hardness of 35 Durometer minimum, compressive strength of 1,800 psi minimum, and bond strength of 300 psi minimum.

2.3 FABRICATION

- A. Ship membrane seal to jobsite in the longest practical continuous length.
- B. Provide membrane seals with factory heat welded splices at all horizontal and vertical changes in direction such as 90 degree corners, tees, and crosses and at curbs, walls, and columns. Spliced ends of the membrane seals shall be rimmed using factory made 45 degree miter cuts. Seal shall extend a minimum of 3'-0" in each direction from factory splice.
- C. Only straight, butt splice connections shall be heat welded on jobsite following manufacturer's written instructions and utilizing specialty heat fusing equipment approved by manufacturer.
- D. All factory and field heat fused connections shall incorporate welding of complete gland profile including all internal and external web configurations.
- E. Membrane seal and concrete header material shall be black in color. Changes in color shall be approved by Engineer.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Division 01 – General Requirements: Coordination and project conditions.
- B. Verify joint preparation, condition, and affected dimensions are acceptable.

3.2 PREPARATION

- A. Remove concrete around columns as necessary to create new blockouts in slab.
- B. Coordinate forming and placement of new blockouts with concrete contractor. Blockouts shall be formed to manufacturer's recommended dimensions.
- C. Contractor shall clean surfaces of all contaminants and prepare concrete surfaces according to manufacturer's recommendations.

- D. Manufacturer's representative shall be on site prior to commencement of installation for inspection of substrate preparation, inspection of blockout and joint configuration, and to discuss job specific installation instructions.
- E. Joints shall run up and across adjacent curbs and run at least six (6) inches up adjacent walls and columns.

3.3 INSTALLATION

- A. Protect adjacent areas by laying ground cloths and taping joint edges as required to prevent staining, marring, etc.
- B. Align work plumb and level, flush with adjacent surfaces.
- C. Install expansion joint in strict accordance with manufacturer's instructions.
- D. Do not permit traffic over unprotected floor joint surfaces.

END OF SECTION

SECTION 09 97 13
CLEANING AND REPAINTING STRUCTURAL STEEL

PART 1 - GENERAL

1.1 SUMMARY

- A. Section Includes:
 - 1. Clean and repaint existing structural steel surfaces including existing paint systems that have red lead primer.
 - 2. Remove existing paint from existing structural steel surfaces.
 - 3. Prepare existing steel surface for repainting, and paint cleaned structural steel surfaces.
- B. Related Sections
 - 1. Applicable provisions of Division 01 – General Requirements shall govern all work under this section.

1.2 REFERENCES

- A. ASTM International (ASTM):
 - 1. ASTM D4285 - Test Method for Indicating Oil or Water in Compressed Air.
 - 2. ASTM D4417 - Test Methods for Field Measurement of Surface Profile of Blast Cleaned Steel.
 - 3. ASTM E11: - Specification for Wire Cloth and Sieves For Testing Purposes.
- B. Federal Specification Unit (FS):
 - 1. FS A-A-3054 - Paint, Heat Resisting (204 C).
 - 2. FS A-A-3120 - Paint: For Swimming Pools.
 - 3. FS QPL-TT-P-28-15 - Paint, Aluminum, Heat Resisting (1200 Deg. F).
 - 4. FS TT-C-555 - Coating, Textured (For Interior and Exterior Masonry Surfaces).
- C. Northeast Protective Coatings Committee (NEPCOAT):
 - 1. Technology Guide Number 6 – Guide for Containing Surface Preparation Debris Generated During Paint Removal Operations
- D. SSPC: The Society for Protective Coatings (SSPC):
 - 1. SSPC - Steel Structures Painting Manual.
 - 2. SSPC Paint 16 - Coal Tar Epoxy-Polyamide Black (or Dark Red) Paint.
 - 3. SSPC SP 2 - Hand Tool Cleaning.
 - 4. SSPC SP 3 - Power Tool Cleaning.
 - 5. SSPC SP 5 - White Metal Blast Cleaning.
 - 6. SSPC SP 6 - Commercial Blast Cleaning.
 - 7. SSPC SP 7 - Brush-Off Blast Cleaning.
 - 8. SSPC SP 10 - Near-White Blast Cleaning.
 - 9. SSPC SP 11 - Power Tool Cleaning to Bare Metal.

1.3 SUBMITTALS

- A. Detailed plan for approval for protection methods that includes environmental protection.
- B. Source and gradation of blast abrasive.
 - 1. Type and source of solvent if required.
- C. Manufacturer's information regarding specified coating materials, including:
 - 1. Required wet and dry film thickness.
 - 2. Project safety data.
 - 3. Thinning recommendations.
 - 4. Temperature requirements.
 - 5. Profile recommendations.
 - 6. Mixing and application procedures.
 - 7. Required equipment.
- D. Provide Engineer with a copy of Quality Control Plan. At a minimum it must contain procedures and verification of the following:
 - 1. Compression Air Check: Refer to ASTM D4285.
 - 2. Dry Film Thickness: Refer to SSPC-PA2.
 - 3. Air Temperature.
 - 4. Humidity and Dew Point.
 - 5. Surface Temperature.
 - 6. Abrasive Cleanliness Check: Refer to SSPC AB 2.
 - 7. Degree of Cleanliness Achieved.
 - 8. Surface Profile: Refer to ASTM D4417 method C.
 - 9. Batch Number and Amount of Thinner Used.
 - 10. Batch Number of Paint Used.
- E. Provide daily reports to Engineer upon request.
 - 1. Submit no later than 24 hours following completion of work.
- F. Submit a written site specific compliance program documenting equipment, training, containment, and monitoring system to comply with OSHA's standard on lead exposure in construction as published in Federal Register, Section 29 CFR 1926.62, May 4, 1993.
 - 1. Worker Health and Safety Program
 - 2. Environmental Protection and Monitoring Program
 - 3. Hazardous Waste Handling and Reporting of Release Program
 - 4. Provide Engineer with Quality Control Plan and Procedures.
- G. Copy of SSPC Certifications.
- H. Paint samples from each batch or lot.
 - 1. Submit samples to Engineer.
 - 2. Reject paint that does not match standard.

1.4 QUALIFICATIONS

- A. Contractors and subcontractors performing surface preparation or coatings applications in the field:
 - 1. Obtain SSPC QP 2 Category A Certification prior to contract award.
 - 2. Remain certified for duration of project.
 - 3. Do not perform work if certification has expired.
 - 4. Requests for time extension for delay to project completion due to an inactive certification will not be considered and liquidated damages apply.
 - 5. Notify Engineer of any changes in certification status.

1.5 COATING APPLICATION REQUIREMENTS

- A. Have painter, blasting operator, or both consult with manufacturer's technical representative for answers to technical questions relating to application of specified coating materials.
- B. Obtain surface preparation approval from Engineer before applying paint.
- C. Use equipment capable of taking dry film thickness readings on all portions including nuts and bolts.

1.6 ENVIRONMENTAL REQUIREMENTS

- A. Follow manufacturer's recommendations if weather conditions require paint thinning.
- B. Apply paint only when the following weather conditions exist:
 - 1. Temperature of Air and Steel: Above 40 degrees F, but not so hot as to cause paint to blister.
 - 2. Relative Humidity:
 - a. Less than 85 percent or such that combination of temperature and humidity conditions inhibits surface condensation.
 - b. Apply a thin film of water to a small area to test humidity. Surface may be painted if film evaporates within 15 minutes.
 - c. Steel temperature a minimum of 5 degrees F above dew point.

PART 2 - PRODUCTS

2.1 MATERIALS

- A. Blasting Abrasive: Type and size as specified.
- B. Solvent: Type and source as required.
- C. Cold Galvanizing Compound: Premixed liquid organic zinc compound, ZRC Galvanizing Compound by ZRC Worldwide complying with the following:
 - 1. Metallic zinc content, 95 percent by weight in dry film.
 - 2. Solids content, 52 percent by volume.
 - 3. Application rate, 1.5 mils dry film thickness per coat.
 - 4. Number of coats required, 2.

PART 3 - EXECUTION

3.1 PREPARATION

- A. Clean surfaces including bearing units of oil, grease, and dirt with clean petroleum solvents or steam cleaning prior to blasting operation. Refer to SSPC-SP10.
- B. Blast surfaces clean to near white with 0.5 to 2 mil profile.
- C. Discoloration, light shadows, or slight streaks caused by stains of rust is not allowed on more than 5 percent of surface area.
- D. Define acceptable surface preparation using SSPC-Vis 1.
- E. Use SSPC-SP-11 to clean areas such as backside of base plates, corners, etc., that cannot otherwise be cleaned.
- F. Meet soluble salts requirements of SSPC and coatings manufacturer.
- G. Coat surface within 8 hours from blasting.
- H. Do not coat surface if rust has started to form. Clean surface again before applying prime coat.
- I. Protection:
 - 1. Enclosure system must withstand extreme high winds.
 - 2. Protect portions of structure that will not be painted.
- J. Recover a minimum of 95 percent of debris from cleaning operation.
 - 1. Sample debris from cleaning operation. Submit samples to an independent accredited Materials Testing Lab for composition and disposal evaluation.
 - 2. Place reclaimed waste paint in EPA-USDOT approved containment. Store at project site.
 - 3. Submit paint composition and disposal evaluation results from independent materials testing lab. Disposition will be given to Contractor within 30 days. Dispose of waste paint as directed by Engineer. Submit disposal certificates for waste paint.

3.2 APPLICATION

- A. Field Inspection:
 - 1. Do not apply paint until Engineer approves prepared surface.
 - 2. Use rubber rollers or other approved protective devices on scaffold fastenings.
 - 3. Do not use metal rollers, clamps, and other types of fastenings that mar or damage freshly coated surfaces.
- B. Prime Coat:
 - 1. Maintain dry film thickness of prime coat between 2.5 and 6.0-mils. Refer to SSPC PA2.
 - 2. Apply two or more coats without producing runs, bubbles, or sags if required film thickness cannot be obtained by one coat.
 - 3. Blast clean any coat that produces "mud-cracking" or adds more than 7.0 mils to a soundly bonded coating or bare steel. Refer to SSPC-SP 10. Re-coat surface.

4. Thoroughly clean areas having deficient primer thickness with power washing equipment to remove dirt. Wire-brush, vacuum, and re-coat area.
 - C. Intermediate Coat: Apply paint to produce a uniform, even coating that bonds to underlying surface. Refer to SSPC-PA 1.
 1. Use coating type and minimum dry film thickness specified.
 2. Produce a dry-film thickness of intermediate coat greater than 4 mils. Refer to SSPC PA2.
 - D. Use wet and dry film thickness gauges for testing coating thickness during and after application.
 - E. Painting Safety: Follow SSPC Paint Application Guide No. 3, "A Guide to Safety in Paint Application."
- 3.3 SUSPENSION OF WORK
- A. Engineer may suspend work for questionable performance of painter, blasting operator, or equipment.
 - B. Suspension of work results from inadequate surface preparation, improper profile, runs, sags, overspray, thin film thickness, excessive film build-up, uneven coating, non-uniform color, improper curing, or any other defect in coating system.

END OF SECTION



Department of Transportation

Traffic Engineering and Parking Divisions

Yang Tao, City Traffic Engineer

Sabrina Tolley, Assistant Parking Utility Manager

Madison Municipal Building, Suite 109

215 Martin Luther King, Jr. Blvd.

P.O. Box 2986

Madison, WI 53701-2986

Phone: (608) 266-4761 | Fax: (608) 267-1158

traffic@cityofmadison.com

parking@cityofmadison.com

April 21, 2020

NOTICE OF ADDENDUM ADDENDUM 1

CONTRACT NO. 8885 2020 Parking Garage Maintenance

Revise and amend the contract document(s) for the above project as stated in this addendum, otherwise, the original document shall remain in effect.

Please acknowledge this addendum on page E1 of the contract documents and/or in Section E: Bidder's Acknowledgement on Bid Express.

Electronic version of these documents can be found on the Bid Express web site at:

<http://www.bidexpress.com>

If you are unable to download plan revisions associated with the addendum, please contact the Engineering office at 608-266-4751 receive the material by another route.

Sabrina J. Tolley

Assistant City Parking Utility Manager

SECTION E: BIDDERS ACKNOWLEDGEMENT


**2020 PARKING GARAGE MAINTENANCE
CONTRACT NO. 8885**

Bidder must state a Unit Price and Total Bid for each item. The Total Bid for each item must be the product of quantity, by Unit Price. The Grand Total must be the sum of the Total Bids for the various items. In case of multiplication errors or addition errors, the Grand Total with corrected multiplication and/or addition shall determine the Grand Total bid for each contract. The Unit Price and Total Bid must be entered numerically in the spaces provided. All words and numbers shall be written in ink.

1. The undersigned having familiarized himself/herself with the Contract documents, including Advertisement for Bids, Instructions to Bidders, Form of Proposal, City of Madison Standard Specifications for Public Works Construction - 2020 Edition thereto, Form of Agreement, Form of Bond, and Addenda issued and attached to the plans and specifications on file in the office of the City Engineer, hereby proposes to provide and furnish all the labor, materials, tools, and expendable equipment necessary to perform and complete in a workmanlike manner the specified construction on this project for the City of Madison; all in accordance with the plans and specifications as prepared by the City Engineer, including Addenda Nos. 1 through 1 to the Contract, at the prices for said work as contained in this proposal. (Electronic bids submittals shall acknowledge addendum under Section E and shall not acknowledge here)
2. If awarded the Contract, we will initiate action within seven (7) days after notification or in accordance with the date specified in the contract to begin work and will proceed with diligence to bring the project to full completion within the number of work days allowed in the Contract or by the calendar date stated in the Contract.
3. The undersigned Bidder or Contractor certifies that he/she is not a party to any contract, combination in form of trust or otherwise, or conspiracy in restraint of trade or commerce or any other violation of the anti-trust laws of the State of Wisconsin or of the United States, with respect to this bid or contract or otherwise.
4. I hereby certify that I have met the Bid Bond Requirements as specified in Section 102.5. (IF BID BOND IS USED, IT SHALL BE SUBMITTED ON THE FORMS PROVIDED BY THE CITY. FAILURE TO DO SO MAY RESULT IN REJECTION OF THE BID).
5. I hereby certify that all statements herein are made on behalf of ProAxis LLC (name of corporation, partnership, or person submitting bid) a corporation organized and existing under the laws of the State of Wisconsin a partnership consisting of Kevin Marquardt Robert Nicholas; an individual trading as ProAxis LLC; of the City of Madison State of Wisconsin; that I have examined and carefully prepared this Proposal, from the plans and specifications and have checked the same in detail before submitting this Proposal; that I have fully authority to make such statements and submit this Proposal in (its, their) behalf; and that the said statements are true and correct.

K Marquardt
 SIGNATURE
LLC Member
 TITLE, IF ANY

Sworn and subscribed to before me this
23rd day of April, 2020
Cindy Drager
 (Notary Public or other officer authorized to administer oaths)
 My Commission Expires 8-30-2020

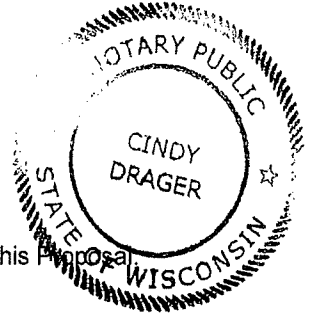

Bidders shall not add any conditions or qualifying statements to this Proposal

SECTION F: BEST VALUE CONTRACTING

ERROR! REFERENCE SOURCE NOT FOUND.
CONTRACT NO. ERROR! REFERENCE SOURCE NOT FOUND.

Best Value Contracting

1. The Contractor shall indicate the non-apprenticeable trades used on this contract.

N/A

2. Madison General Ordinance (M.G.O.), 33.07(7), does provide for some exemptions from the active apprentice requirement. Apprenticeable trades are those trades considered apprenticeable by the State of Wisconsin. Please check applicable box if you are seeking an exemption.

- Contractor has a total skilled workforce of four or less individuals in all apprenticeable trades combined.
- No available trade training program; The Contractor has been rejected by the only available trade training program, or there is no trade training program within 90 miles.
- Contractor is not using an apprentice due to having a journey worker on layoff status, provided the journey worker was employed by the contractor in the past six months.
- First-time Contractor on City of Madison Public Works contract requests a onetime exemption but intends to comply on all future contracts and is taking steps typical of a "good faith" effort.
- Contractor has been in business less than one year.
- Contractor doesn't have enough journeyman trade workers to qualify for a trade training program in that respective trade.
- An exemption is granted in accordance with a time period of a "Documented Depression" as defined by the State of Wisconsin.

3. The Contractor shall indicate on the following section which apprenticeable trades are to be used on this contract. Compliance with active apprenticeship, to the extent required by M.G.O. 33.07(7), shall be satisfied by documentation from an applicable trade training body; an apprenticeship contract with the Wisconsin Department of Workforce Development or a similar agency in another state; or the U.S Department of Labor. This documentation is required prior to the Contractor beginning work on the project site.

- The Contractor has reviewed the list and shall not use any apprenticeable trades on this project.

LIST APPRENTICABLE TRADES (check all that apply to your work to be performed on this contract)

- BRICKLAYER
- CARPENTER
- CEMENT MASON / CONCRETE FINISHER
- CEMENT MASON (HEAVY HIGHWAY)
- CONSTRUCTION CRAFT LABORER
- DATA COMMUNICATION INSTALLER
- ELECTRICIAN
- ENVIRONMENTAL SYSTEMS TECHNICIAN / HVAC SERVICE TECH/HVAC INSTALL / SERVICE
- GLAZIER
- HEAVY EQUIPMENT OPERATOR / OPERATING ENGINEER
- INSULATION WORKER (HEAT & FROST)
- IRON WORKER
- IRON WORKER (ASSEMBLER, METAL BLDGS)
- PAINTER & DECORATOR
- PLASTERER
- PLUMBER
- RESIDENTIAL ELECTRICIAN
- ROOFER & WATER PROOFER
- SHEET METAL WORKER
- SPRINKLER FITTER
- STEAMFITTER
- STEAMFITTER (REFRIGERATION)
- STEAMFITTER (SERVICE)
- TAPER & FINISHER
- TELECOMMUNICATIONS (VOICE, DATA & VIDEO) INSTALLER-TECHNICIAN
- TILE SETTER

2020 PARKING GARAGE MAINTENANCE
CONTRACT NO. 8885

Small Business Enterprise Compliance Report

This information may be submitted electronically through
Bid Express or submitted with bid in sealed envelope.

Cover Sheet

Prime Bidder Information

Company: ProAxis LLC
Address: 2738 Progress Rd. Madison WI 53716
Telephone Number: (608) 279-7699 Fax Number: —
Contact Person/Title: Kevin Marquardt LLC Member

Prime Bidder Certification

I, Kevin Marquardt, LLC Member of
Name Title
ProAxis LLC certify that the information
Company

contained in this SBE Compliance Report is true and correct to the best of my knowledge and belief.

Cindy Oraguz
Witness' Signature

K Marquardt
Bidder's Signature

4-23-2020
Date

2020 PARKING GARAGE MAINTENANCE

CONTRACT NO. 8885

DATE: 4/23/20

ProAxis LLC

Item	Quantity	Price	Extension
Section B: Proposal Page			
1 - Membrane Repair (Top/Wear) - SF	13300.00	\$3.53	\$46,949.00
2 - Membrane Repair (Full) - SF	632.00	\$9.70	\$6,130.40
3 - Concrete Vertical Surface Spall Repair - SF	419.00	\$97.74	\$40,953.06
4 - Concrete Surface Spall Repair - SF	462.00	\$41.88	\$19,348.56
5 - Overhead Surface Spall Repair - SF	913.00	\$98.76	\$90,167.88
6 - Stair Spall Repair - SF	24.00	\$154.79	\$3,714.96
7 - Concrete Joist Spall Repair - SF	201.00	\$143.30	\$28,803.30
8 - Concrete Beam/Column/Wall Crack Repair - LF	9.00	\$144.67	\$1,302.03
9 - Concrete Slab Crack Repair - LF	748.00	\$4.45	\$3,328.60
10 - CMU Crack Repair - LF	126.00	\$14.77	\$1,861.02
11 - Replace Compression Joint With Sealant/Backer Rod - LF	195.00	\$13.83	\$2,696.85
12 - Replace Expansion Joint - LF	50.00	\$233.70	\$11,685.00
13 - Replace 4" Polyurethane Seal with Expansion Joint with EJ with Nosing - LF	44.00	\$145.66	\$6,409.04
14 - Replace 8" Polyurethane Seal with Expansion Joint with EJ with Nosing - LF	116.00	\$135.12	\$15,673.92
15 - Steel Cleaning / Painting - SF	87.00	\$48.16	\$4,189.92
16 - Remove and Replace Existing Sealant - LF	3465.00	\$7.93	\$27,477.45
17 - Precast Shear Connector Repair - ITEM	30.00	\$104.90	\$3,147.00
18 - Overhead Concrete Demolition Only - SF	4.00	\$222.75	\$891.00
19 - Silane Sealer - LS	1.00	\$27,495.00	\$27,495.00
20 - Exposed Steel Reinforcing - LF	138.00	\$54.26	\$7,487.88
21 - Brick Masonry Repair - SF	24.00	\$177.92	\$4,270.08
22 - Brick Masonry Sealing (CSN) - SF	1200.00	\$1.04	\$1,248.00
24 - Steel Anchor Repair - ITEM	18.00	\$64.11	\$1,153.98
25 - Top of Column Sealing (CSN) - SF	480.00	\$2.87	\$1,377.60
26 - Stainless Steel Flashing Over occupied Space (CSN) - LF	20.00	\$141.15	\$2,823.00
27 - Expansion Joint Replacement with Resloping (SSCO) - LS	1.00	\$14,821.00	\$14,821.00
28 - Pour Strip Replacement (CSN) - LS	1.00	\$43,003.00	\$43,003.00
29 - Tapered Column Repair (SSCO) - ITEM	11.00	\$317.82	\$3,496.02
28 Items	Totals		\$421,904.55



Department of Public Works
Engineering Division
Robert F. Phillips, P.E., City Engineer

City-County Building, Room 115
210 Martin Luther King, Jr. Boulevard
Madison, Wisconsin 53703
Phone: (608) 266-4751
Fax: (608) 264-9275
engineering@cityofmadison.com
www.cityofmadison.com/engineering

Deputy City Engineer
Gregory T. Fries, P.E.

Deputy Division Manager
Kathleen M. Cryan

Principal Engineer 2
Christopher J. Petykowski, P.E.
John S. Fahrney, P.E.

Principal Engineer 1
Christina M. Bachmann, P.E.
Mark D. Moder, P.E.
Janet Schmidt, P.E.
James M. Wolfe, P.E.

Facilities & Sustainability
Bryan Cooper, Principal Architect

Mapping Section Manager
Eric T. Pederson, P.S.

Financial Manager
Steven B. Danner-Rivers

BIENNIAL BID BOND

ProAxis LLC

(a corporation of the State of Wisconsin)
(individual), (partnership), (hereinafter referred to as the "Principal") and
West Bend Mutual Insurance Company

a corporation of the State of Wisconsin (hereinafter referred to as the "Surety") and licensed to do business in the State of Wisconsin, are held and firmly bound unto the City of Madison, Wisconsin (hereinafter referred to as the "City"), in the sum equal to the individual proposal guaranty amounts of the total bid or bids of the Principal herein accepted by the City, for the payment of which the Principal and the Surety hereby jointly and severally bind ourselves, our heirs, executors, administrators, successors and assigns.

The condition of this obligation is that the Principal has submitted to the City certain bids for projects from the time period of February 1, 2020 through January 31, 2022.

If the Principal is awarded the contract(s) by the City and, within the time and manner required by law after the prescribed forms are presented for its signature, the Principal enters into (a) written contract(s) in accordance with the bid(s), and files with the City its bond(s) guaranteeing faithful performance and payment for all labor and materials, as required by law, or if the City rejects all bids for the work described, then this obligation shall be null and void; otherwise, it shall remain in full force and effect.

In the event the Principal shall fail to execute and deliver the contract(s) or the performance and payment bond(s), all within the time specified or any extension thereof, the Principal and Surety agree jointly and severally to pay to the City within ten (10) calendar days of written demand a total equal to the sum of the individual proposal guaranty amounts of the total bid(s) as liquidated damages.

The Surety, for value received, hereby agrees that the obligations of it and its bond shall be in no way impaired or affected by any extension of time within which the City may accept a bid, and the Surety does hereby waive notice of any such extension.

This bond may be terminated by the Surety upon giving thirty (30) days written notice to the City of its intent to terminate this bond and to be released and discharged therefrom, but such termination shall not operate to relieve or discharge the Surety from any liability already accrued or which shall accrue before the expiration of such thirty (30) day period.

IN WITNESS WHEREOF, the Principal and the Surety have hereunto set their hands and seals, and such of them as are corporations have caused their corporate seals to be hereto affixed and these presents to be signed by their proper officers, on the day and year set forth below.

PRINCIPAL

ProAxis LLC
COMPANY NAME AFFIX SEAL


December 20, 2019
DATE

By:  LLC Member
SIGNATURE AND TITLE

SURETY

West Bend Mutual Insurance Company
COMPANY NAME AFFIX SEAL

December 20, 2019
DATE

By: 
SIGNATURE AND TITLE
Elizabeth Mosca, Attorney-in-Fact

This certifies that I have been duly licensed as an agent for the Surety in Wisconsin under National Provider No. 12305256 for the year 2020 and appointed as attorney in fact with authority to execute this bid bond, which power of attorney has not been revoked.

December 20, 2019
DATE


AGENT SIGNATURE

PO Box 259408
ADDRESS

Madison, WI 53725-9408
CITY, STATE AND ZIP CODE

608-252-9674
TELEPHONE NUMBER

Note to Surety and Principal: Any bid submitted which this bond guarantees may be rejected if the Power of Attorney form showing that the Agent of Surety is currently authorized to execute bonds on behalf of Surety is not attached to this bond.



THE SILVER LINING®

Bond No. _____

POWER OF ATTORNEY

Know all men by these Presents, That West Bend Mutual Insurance Company, a corporation having its principal office in the City of West Bend, Wisconsin does make, constitute and appoint:

Patrick A. McKenna, Brooke L. Parker, Judith A. Walker, Elizabeth Mosca, David Zenobi

lawful Attorney(s)-in-fact, to make, execute, seal and deliver for and on its behalf as surety and as its act and deed any and all bonds, undertakings and contracts of suretyship, provided that no bond or undertaking or contract of suretyship executed under this authority shall exceed in amount the sum of: \$3,000,000

This Power of Attorney is granted and is signed and sealed by facsimile under and by the authority of the following Resolution adopted by the Board of Directors of West Bend Mutual Insurance Company at a meeting duly called and held on the 21st day of December, 1999.

Appointment of Attorney-In-Fact. The president or any vice president, or any other officer of West Bend Mutual Insurance Company may appoint by written certificate Attorneys-In-Fact to act on behalf of the company in the execution of and attesting of bonds and undertakings and other written obligatory instruments of like nature. The signature of any officer authorized hereby and the corporate seal may be affixed by facsimile to any such power of attorney or to any certificate relating therefore and any such power of attorney or certificate bearing such facsimile signatures or facsimile seal shall be valid and binding upon the company, and any such power so executed and certified by facsimile signatures and facsimile seal shall be valid and binding upon the company in the future with respect to any bond or undertaking or other writing obligatory in nature to which it is attached. Any such appointment may be revoked, for cause, or without cause, by any said officer at any time.

In witness whereof, the West Bend Mutual Insurance Company has caused these presents to be signed by its president undersigned and its corporate seal to be hereto duly attested by its secretary this 22nd day of September, 2017.


Attest Christopher C. Zwygart
Christopher C. Zwygart
Secretary



Kevin A. Steiner
Kevin A. Steiner
Chief Executive Officer/President

State of Wisconsin
County of Washington

On the 22nd day of September, 2017, before me personally came Kevin A. Steiner, to me known being by duly sworn, did depose and say that he resides in the County of Washington, State of Wisconsin; that he is the President of West Bend Mutual Insurance Company, the corporation described in and which executed the above instrument; that he knows the seal of the said corporation; that the seal affixed to said instrument is such corporate seal; that it was so affixed by order of the board of directors of said corporation and that he signed his name thereto by like order.



Juli A. Benedum
Juli A. Benedum
Senior Corporate Attorney
Notary Public, Washington Co., WI
My Commission is Permanent

The undersigned, duly elected to the office stated below, now the incumbent in West Bend Mutual Insurance Company, a Wisconsin corporation authorized to make this certificate, Do Hereby Certify that the foregoing attached Power of Attorney remains in full force effect and has not been revoked and that the Resolution of the Board of Directors, set forth in the Power of Attorney is now in force.

Signed and sealed at West Bend, Wisconsin this 20 day of December 2017.



Heather A. Dunn
Heather Dunn
Vice President – Chief Financial Officer

Notice: Any questions concerning this Power of Attorney may be directed to the Bond Manager at NSI, a division of West Bend Mutual Insurance Company.

SECTION H: AGREEMENT

THIS AGREEMENT made this 20 day of May in the year Two Thousand and Twenty between **PROAXIS LLC** hereinafter called the Contractor, and the City of Madison, Wisconsin, hereinafter called the City.

WHEREAS, the Common Council of the said City of Madison under the provisions of a resolution adopted **MAY 19, 2020**, and by virtue of authority vested in the said Council, has awarded to the Contractor the work of performing certain construction.

NOW, THEREFORE, the Contractor and the City, for the consideration hereinafter named, agree as follows:

1. **Scope of Work.** The Contractor shall, perform the construction, execution and completion of the following listed complete work or improvement in full compliance with the Plans, Specifications, Standard Specifications, Supplemental Specifications, Special Provisions and contract; perform all items of work covered or stipulated in the proposal; perform all altered or extra work; and shall furnish, unless otherwise provided in the contract, all materials, implements, machinery, equipment, tools, supplies, transportation, and labor necessary to the prosecution and completion of the work or improvements:

2020 PARKING GARAGE MAINTENANCE CONTRACT NO. 8885

2. **Completion Date/Contract Time.** Construction work must begin within seven (7) calendar days after the date appearing on mailed written notice to do so shall have been sent to the Contractor and shall be carried on at a rate so as to secure full completion SEE SPECIAL PROVISIONS, the rate of progress and the time of completion being essential conditions of this Agreement.
3. **Contract Price.** The City shall pay to the Contractor at the times, in the manner and on the conditions set forth in said specifications, the sum of **FOUR HUNDRED TWENTY-ONE THOUSAND NINE HUNDRED FOUR AND 55/100 (\$421,904.55)** Dollars being the amount bid by such Contractor and which was awarded to him/her as provided by law.
4. **Affirmative Action.** In the performance of the services under this Agreement the Contractor agrees not to discriminate against any employee or applicant because of race, religion, marital status, age, color, sex, disability, national origin or ancestry, income level or source of income, arrest record or conviction record, less than honorable discharge, physical appearance, sexual orientation, gender identity, political beliefs, or student status. The Contractor further agrees not to discriminate against any subcontractor or person who offers to subcontract on this contract because of race, religion, color, age, disability, sex, sexual orientation, gender identity or national origin.

The Contractor agrees that within thirty (30) days after the effective date of this agreement, the Contractor will provide to the City Affirmative Action Division certain workforce utilization statistics, using a form to be furnished by the City.

If the contract is still in effect, or if the City enters into a new agreement with the Contractor, within one year after the date on which the form was required to be provided, the Contractor will provide updated workforce information using a second form, also to be furnished by the City. The second form will be submitted to the City Affirmative Action Division no later than one year after the date on which the first form was required to be provided.

The Contractor further agrees that, for at least twelve (12) months after the effective date of this contract, it will notify the City Affirmative Action Division of each of its job openings at facilities in Dane County for which applicants not already employees of the Contractor are to be considered. The notice will include a job description, classification, qualification and application procedures

and deadlines. The Contractor agrees to interview and consider candidates referred by the Affirmative Action Division if the candidate meets the minimum qualification standards established by the Contractor, and if the referral is timely. A referral is timely if it is received by the Contractor on or before the date started in the notice.

Articles of Agreement
Article I

The Contractor shall take affirmative action in accordance with the provisions of this contract to insure that applicants are employed, and that employees are treated during employment without regard to race, religion, color, age, marital status, disability, sex, sexual orientation, gender identity or national origin and that the employer shall provide harassment free work environment for the realization of the potential of each employee. Such action shall include, but not be limited to, the following: employment, upgrading, demotion or transfer, recruitment or recruitment advertising, layoff or termination, rates of pay or other forms of compensation and selection for training including apprenticeship insofar as it is within the control of the Contractor. The Contractor agrees to post in conspicuous places available to employees and applicants notices to be provided by the City setting out the provisions of the nondiscrimination clauses in this contract.

Article II

The Contractor shall in all solicitations or advertisements for employees placed by or on behalf of the Contractors state that all qualified or qualifiable applicants will be employed without regard to race, religion, color, age, marital status, disability, sex, sexual orientation, gender identity or national origin.

Article III

The Contractor shall send to each labor union or representative of workers with which it has a collective bargaining agreement or other contract or understanding a notice to be provided by the City advising the labor union or worker's representative of the Contractor's equal employment opportunity and affirmative action commitments. Such notices shall be posted in conspicuous places available to employees and applicants for employment.

Article V

The Contractor agrees that it will comply with all provisions of the Affirmative Action Ordinance of the City of Madison, including the contract compliance requirements. The Contractor agrees to submit the model affirmative action plan for public works contractors in a form approved by the Affirmative Action Division Manager.

Article VI

The Contractor will maintain records as required by Section 39.02(9)(f) of the Madison General Ordinances and will provide the City Affirmative Action Division with access to such records and to persons who have relevant and necessary information, as provided in Section 39.02(9)(f). The City agrees to keep all such records confidential, except to the extent that public inspection is required by law.

Article VII

In the event of the Contractor's or subcontractor's failure to comply with the Equal Employment Opportunity and Affirmative Action Provisions of this contract or Section 39.03 and 39.02 of the Madison General Ordinances, it is agreed that the City at its option may do any or all of the following:

1. Cancel, terminate or suspend this Contract in whole or in part.

2. Declare the Contractor ineligible for further City contracts until the Affirmative Action requirements are met.
3. Recover on behalf of the City from the prime Contractor 0.5 percent of the contract award price for each week that such party fails or refuses to comply, in the nature of liquidated damages, but not to exceed a total of five percent (5%) of the contract price, or ten thousand dollars (\$10,000), whichever is less. Under public works contracts, if a subcontractor is in noncompliance, the City may recover liquidated damages from the prime Contractor in the manner described above. The preceding sentence shall not be construed to prohibit a prime Contractor from recovering the amount of such damage from the non-complying subcontractor.

Article VIII

The Contractor shall include the above provisions of this contract in every subcontract so that such provisions will be binding upon each subcontractor. The Contractor shall take such action with respect to any subcontractor as necessary to enforce such provisions, including sanctions provided for noncompliance.

Article IX

The Contractor shall allow the maximum feasible opportunity to small business enterprises to compete for any subcontracts entered into pursuant to this contract. (In federally funded contracts the terms "DBE, MBE and WBE" shall be substituted for the term "small business" in this Article.)

5. Substance Abuse Prevention Program Required. Prior to commencing work on the Contract, the Contractor, and any Subcontractor, shall have in place a written program for the prevention of substance abuse among its employees as required under Wis. Stat. Sec. 103.503.
6. **Contractor Hiring Practices.**

Ban the Box - Arrest and Criminal Background Checks. (Sec. 39.08, MGO)

This provision applies to all prime contractors on contracts entered into on or after January 1, 2016, and all subcontractors who are required to meet prequalification requirements under MGO 33.07(7)(l), MGO as of the first time they seek or renew pre-qualification status on or after January 1, 2016. The City will monitor compliance of subcontractors through the pre-qualification process.

- a. **Definitions.** For purposes of this section, "Arrest and Conviction Record" includes, but is not limited to, information indicating that a person has been questioned, apprehended, taken into custody or detention, held for investigation, arrested, charged with, indicted or tried for any felony, misdemeanor or other offense pursuant to any law enforcement or military authority.

"Conviction record" includes, but is not limited to, information indicating that a person has been convicted of a felony, misdemeanor or other offense, placed on probation, fined, imprisoned or paroled pursuant to any law enforcement or military authority.

"Background Check" means the process of checking an applicant's arrest and conviction record, through any means.

- b. **Requirements.** For the duration of this Contract, the Contractor shall:
 1. Remove from all job application forms any questions, check boxes, or other inquiries regarding an applicant's arrest and conviction record, as defined herein.

2. Refrain from asking an applicant in any manner about their arrest or conviction record until after conditional offer of employment is made to the applicant in question.
3. Refrain from conducting a formal or informal background check or making any other inquiry using any privately or publicly available means of obtaining the arrest or conviction record of an applicant until after a conditional offer of employment is made to the applicant in question.
4. Make information about this ordinance available to applicants and existing employees, and post notices in prominent locations at the workplace with information about the ordinance and complaint procedure using language provided by the City.
5. Comply with all other provisions of Sec. 39.08, MGO.

c. Exemptions: This section shall not apply when:

1. Hiring for a position where certain convictions or violations are a bar to employment in that position under applicable law, or
2. Hiring a position for which information about criminal or arrest record, or a background check is required by law to be performed at a time or in a manner that would otherwise be prohibited by this ordinance, including a licensed trade or profession where the licensing authority explicitly authorizes or requires the inquiry in question.

To be exempt, Contractor has the burden of demonstrating that there is an applicable law or regulation that requires the hiring practice in question, if so, the contractor is exempt from all of the requirements of this ordinance for the position(s) in question.

2020 PARKING GARAGE MAINTENANCE
CONTRACT NO. 8885

IN WITNESS WHEREOF, the Contractor has hereunto set his/her hand and seal and the City has caused these presents to be sealed with its corporate seal and to be subscribed by its Mayor and City Clerk the day and year first above written.

Countersigned:

PROAXIS LLC

Company Name

Cindy Drager 5-26-20
Witness Date

[Signature] 5-26-20
President Date

[Signature] 5-26-20
Witness Date

[Signature] 5-26-20
Secretary Date

CITY OF MADISON, WISCONSIN

Provisions have been made to pay the liability that will accrue under this contract.

Approved as to form:

[Signature]
Finance Director

[Signature]
City Attorney

Signed this 9th day of June, 2020

[Signature] 6/9/2020
Witness

[Signature] 6/9/2020
Mayor Date

[Signature] 6/3/20
Witness

[Signature] for 6-3-2020
City Clerk Date

SECTION I: PAYMENT AND PERFORMANCE BOND

LET ALL KNOW BY THESE DOCUMENTS PRESENTED, that we PROAXIS LLC as principal, and West Bend Mutual Insurance Company Company of Middleton, WI as surety, are held and firmly bound unto the City of Madison, Wisconsin, in the sum of FOUR HUNDRED TWENTY-ONE THOUSAND NINE HUNDRED FOUR AND 55/100 (\$421,904.55) Dollars, lawful money of the United States, for the payment of which sum to the City of Madison, we hereby bind ourselves and our respective executors and administrators firmly by these presents.

The condition of this Bond is such that if the above bounden shall on his/her part fully and faithfully perform all of the terms of the Contract entered into between him/herself and the City of Madison for the construction of:

2020 PARKING GARAGE MAINTENANCE
CONTRACT NO. 8885

in Madison, Wisconsin, and shall pay all claims for labor performed and material furnished in the prosecution of said work, and save the City harmless from all claims for damages because of negligence in the prosecution of said work, and shall save harmless the said City from all claims for compensation (under Chapter 102, Wisconsin Statutes) of employees and employees of subcontractor, then this Bond is to be void, otherwise of full force, virtue and effect.

Signed and sealed this 20 day of May, 2020

Countersigned:

PROAXIS LLC
Company Name (Principal)

Witness Cody Drager

K. Magrath 5-26-20
President Seal

Secretary Ron J. J.

Approved as to form:

West Bend Mutual Insurance Company
Surety Seal
 Salary Employee Commission

Michael Haas
City Attorney

By Patrick A. McKenna
Attorney-in-Fact Patrick A McKenna

This certifies that I have been duly licensed as an agent for the above company in Wisconsin under National Producer Number 650765 for the year 2020, and appointed as attorney-in-fact with authority to execute this payment and performance bond which power of attorney has not been revoked.

May 20, 2020
Date

Patrick A. McKenna
Agent Signature Patrick A McKenna



POWER OF ATTORNEY

Know all men by these Presents, That West Bend Mutual Insurance Company, a corporation having its principal office in the City of West Bend, Wisconsin does make, constitute and appoint:

Patrick A McKenna

lawful Attorney(s)-in-fact, to make, execute, seal and deliver for and on its behalf as surety and as its act and deed any and all bonds, undertakings and contracts of suretyship, provided that no bond or undertaking or contract of suretyship executed under this authority shall exceed in amount the sum of: **Ten Million Dollars (\$10,000,000)**

This Power of Attorney is granted and is signed and sealed by facsimile under and by the authority of the following Resolution adopted by the Board of Directors of West Bend Mutual Insurance Company at a meeting duly called and held on the 21st day of December, 1999.

Appointment of Attorney-In-Fact. The president or any vice president, or any other officer of West Bend Mutual Insurance Company may appoint by written certificate Attorneys-In-Fact to act on behalf of the company in the execution of and attesting of bonds and undertakings and other written obligatory instruments of like nature. The signature of any officer authorized hereby and the corporate seal may be affixed by facsimile to any such power of attorney or to any certificate relating therefore and any such power of attorney or certificate bearing such facsimile signatures or facsimile seal shall be valid and binding upon the company, and any such power so executed and certified by facsimile signatures and facsimile seal shall be valid and binding upon the company in the future with respect to any bond or undertaking or other writing obligatory in nature to which it is attached. Any such appointment may be revoked, for cause, or without cause, by any said officer at any time.

In witness whereof, the West Bend Mutual Insurance Company has caused these presents to be signed by its president undersigned and its corporate seal to be hereto duly attested by its secretary this 22nd day of September, 2017.


Attest Christopher C. Zwygart
Christopher C. Zwygart
Secretary



Kevin A. Steiner
Kevin A. Steiner
Chief Executive Officer/President

State of Wisconsin
County of Washington

On the 22nd day of September, 2017, before me personally came Kevin A. Steiner, to me known being by duly sworn, did depose and say that he resides in the County of Washington, State of Wisconsin; that he is the President of West Bend Mutual Insurance Company, the corporation described in and which executed the above instrument; that he knows the seal of the said corporation; that the seal affixed to said instrument is such corporate seal; that is was so affixed by order of the board of directors of said corporation and that he signed his name thereto by like order.



Juli A. Benedum
Juli A. Benedum
Senior Corporate Attorney
Notary Public, Washington Co., WI
My Commission is Permanent

The undersigned, duly elected to the office stated below, now the incumbent in West Bend Mutual Insurance Company, a Wisconsin corporation authorized to make this certificate, Do Hereby Certify that the foregoing attached Power of Attorney remains in full force effect and has not been revoked and that the Resolution of the Board of Directors, set forth in the Power of Attorney is now in force.

Signed and sealed at West Bend, Wisconsin this 20th day of May, 2020



Heather A. Dunn
Heather Dunn
Vice President – Chief Financial Officer

Notice: Any questions concerning this Power of Attorney may be directed to the Bond Manager at NSI, a division of West Bend Mutual Insurance Company.