


1.04

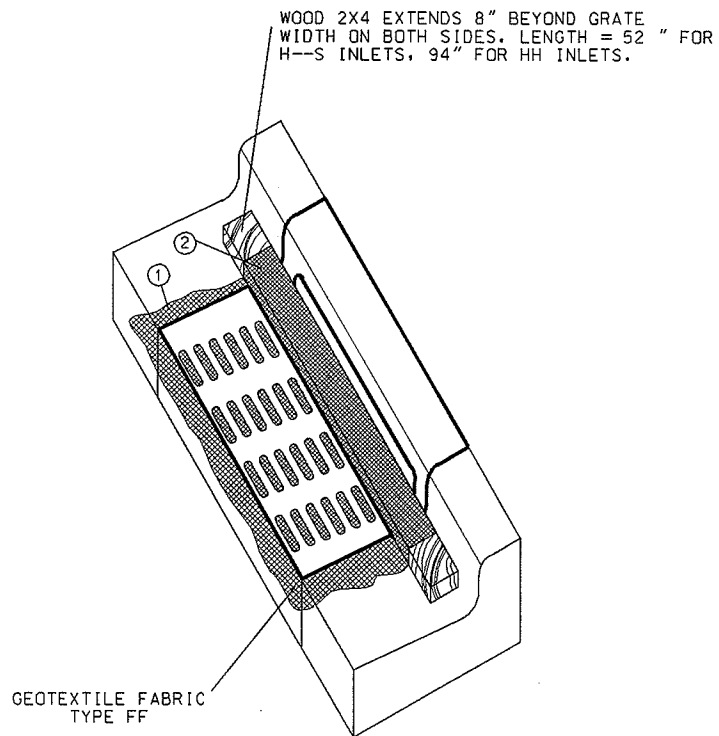

GENERAL NOTES:

FABRIC SHALL BE REPLACED AT THE ENGINEERS DISCRETION.

THE WOOD SHALL NOT BLOCK THE ENTIRE HEIGHT OF THE CURB BOX.

MANUFACTURED ALTERNATIVES APPROVED AND LISTED ON THE DEPARTMENT'S EROSION CONTROL PRODUCT ACCEPTIBILITY LIST MAY BE SUBSTITUTED.

WHEN REMOVING OR MAINTAINING INLET PROTECTION, CARE SHALL BE TAKEN SO THAT THE SEDIMENT TRAPPED ON THE GEOTEXTILE FABRIC DOES NOT FALL INTO THE INLET. ANY MATERIAL FALLING INTO THE INLET SHALL BE REMOVED IMMEDIATELY.

- ① FABRIC SIZE SHALL BE 8" (MIN) GREATER ON ALL SIDES OF THE INLET COVER TO PROVIDE A HAND HOLD WHEN MAINTENANCE OR REMOVAL IS REQUIRED.
- ② FOR INLET PROTECTION, TYPE C WITH A CURB BOX. AN ADDITIONAL 18" OF FABRIC IS WRAPPED AROUND THE WOOD AND SECURED WITH STAPLES.

2004

CITY OF MADISON ENGINEERING DIVISION
INLET PROTECTION TYPE C
STANDARD DETAIL DRAWING 1.04