

Madison, Wisconsin

INDEX OF SHEETS - STREET GRADES AND GEOMETRICS

SHEET NO. 1

SHEET NO. DI-D2 NOTES AND DETAILS

SHEET NO. PI

FIELD FLOWER WAY

INDEX OF SHEETS - SEWERS

SHEET NO. UI SHEET NO. U2 FIELD FLOWER WAY SEWERS

SEWER SCHEDULE

INDEX OF SHEETS - WATER

SHEET NO. WI SHEET NO. W2 FIELD FLOWER WATER WATER IMPACT PLAN

SHEET NO. W3

WATER MATERIALS

CITY OF MADISON


CITY ENGINEERING DIVISION
DEPARTMENT OF PUBLIC WORKS
PLAN OF PROPOSED IMPROVEMENT

THE MEADOWLANDS

PHASE 10

FIELD FLOWER WAY


PROJECT NO. 11507 CONTRACT NO. 7862

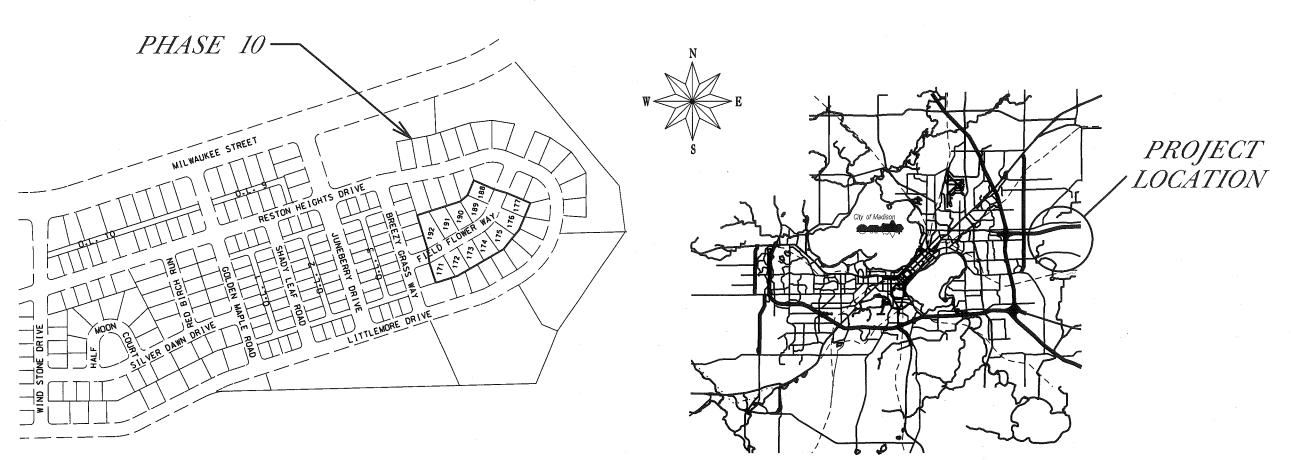


PUBLIC IMPROVEMENT PROJECT APPROVED
JANUARY 3, 2017
BY THE COMMON COUNCIL
OF MADISON, WISCONSIN

PUBLIC IMPROVEMENT DESIGN APPROVED BY:









NO TREES IN THE RIGHT OF WAY OR ON PUBLIC LANDS SHALL BE TRIMMED, PRUNED, REMOVED OR ADVERSELY AFFECTED IN ANY WAY UNTIL THE DEVELOPER HAS RECEIVED WRITTEN PERMISSION FROM THE CITY ENGINEER OR CITY FORESTER. SAID WRITTEN PERMISSION SHALL INCLUDE LANGUAGE INDICATING THAT SECTION 10.101 OF THE MADISON GENERAL ORDINANCES AND ADMINISTRATIVE PROCEDURE MEMORANDUM NO. 6–2, REFERING TO NOTIFICATION OF PROPERTY OCCUPANTS ANDOR OWNERS, HAS BEEN COMPLIED WITH.

CONVENTIONAL SIGNS						
FIELD VERIFY ALL UTILITY LOCATIONS						
GAS	— с —					
STORM SEWER	st					
SANITARY SEWER	SAN					
WATER	—— w ——					
OVERHEAD ELECTRIC	—— ОН ———					
POWER POLE	ф					
ADA COMPLIANT RAMP DETECTABLE WARNING	· · · ·					
COMBUSTIBLE FLUIDS	< CAPRISTS					

ALL PAVEMENT IN THE FIELD FLOWER WAY RIGHT-OF-WAY SHALL BE TYPE A PAVEMENT PER STANDARD DETAIL DRAWING 4.02.

UNDERDRAINS SHALL BE INSTALLED, PER STANDARD DETAIL DRAWING 4.05 FOR 75'ON EACH SIDE OF THE LOW POINT, OR TO THE NEAREST CURB HIGH POINT. ALL UNDERDRAIN SHALL BE WRAPPED.

ALL GUTTERS SHALL DRAIN WITH A MINIMUM GRADES OF 0.5% TOWARD STORM SEWER INLETS.

ALL DITCHES SHALL DRAIN WITH A MINIMUM GRADES OF 0.5%

THE CROSS SLOPE OF SIDEWALKS AND BARRIER FREE SIDEWALK CURB
RAMPS SHALL BE 1.5%. THE LONGITUDINAL GRADE OF BARRIER
FREE SIDEWALK CURB RAMPS SHALL NOT EXCEED 8.33%. ALL SIDEWALK
RAMPS SHALL BE CONSTRUCTED ACCORDING TO S.D.D. 3.03. AT ALL
OTHER LOCATIONS THE LONGITUDINAL GRADE OF SIDEWALKS SHALL
NOT EXCEED 5.0 % OR THE ADJACENT STREET GRADE WHICHEVER
IS GREATER NOR BE LESS THAN 0.5% AND SHALL DRAIN TOWARD
STORM SEWER INLETS. SIDE SLOPES WITHIN TEN FEET OF A PUBLIC
SIDEWALK SHALL NOT EXCEED 4.00:1. ALL SIDEWALK AND SIDEWALK RAMP
ELEVATIONS AND GRADES SHALL BE FIELD VERIFIED AND SET TO COMPLY WITH
THE CITY OF MADISON STANDARD SPECIFICATIONS AND THE A.D.A. GUIDELINES.

OBTAIN A PRINT OUT OF THE ALIGNMENT FROM THE CITY ENGINEER PRIOR TO STAKING THIS PROJECT.

CURB STATION AND OFFSETS SHALL BE TO THE FACE OF CURB UNLESS OTHERWISE INDICATED. CURB ELEVATIONS SHALL BE TO THE TOP OF CURB (OR EXTENDED TOP OF CURB FOR DRIVEWAYS OR RAMPS) UNLESS OTHERWISE INDICATED.

POWER POLES AND OTHER OBSTRUCTIONS SHALL BE MOVED TO PROVIDE 2 FEET MINIMUM OF CLEAR DISTANCE FROM ANY FACE OF CURB OR EDGE OF SIDEWALK.

ANY INFORMATION SHOWN ON THIS PLAN, WHICH IS NOT PART OF THIS PROJECT, IS PRELIMINARY AND NOT FOR CONSTRUCTION.

THERE MAY BE EXISTING UTILITIES OR OTHER FEATURES WHICH ARE EITHER NOT SHOWN OR SHOWN INCORRECTLY ON THIS PLAN. IT IS THE RESPONSIBILITY OF THE DEVELOPER TO LOCATE AND IDENTIFY ALL UTILITIES AND TOPOGRAPHY WHICH MAY AFFECT THE CONSTRUCTION OF THESE IMPROVEMENTS.

ALL PERMANENT SIGNING AND POSTING WILL BE DETERMINED AND PROVIDED BY THE TRAFFIC ENGINEERING DIVISION, FOLLOWING CONSTRUCTION OF THESE IMPROVEMENTS.

THE DEVELOPER SHALL PROVIDE, INSTALL AND MAINTAIN ALL STREET END BARRICADES, SIGNING AND TRAFFIC CONTROL, AS REQUIRED BY THE CITY TRAFFIC ENGINEER.

PAVEMENT SAWCUTS SHALL BE AS DIRECTED BY THE CITY CONSTRUCTION ENGINEER. SAWCUTS SHOWN ON THE PLAN ARE APPROXIMATE.

CURB ON CUL DE SACS SHALL BE INSTALLED ACCORDING TO SDD 3.05.

MEADOWLANDS PH. 10 PROJECT NO. 11507 SHEET NO. D-1

DETAIL

STANDARD NOTES AND COMMENTS

CITY OF MADISON

ORIGINATOR: CITY OF MADISON, STREETS DIVI


MEADOWLANDS PH. 10
PROJECT NO. 11507

DETAIL

TYPICAL SECTION

MEADOWLANDS PH. 10
D-2

CITY OF MADISON

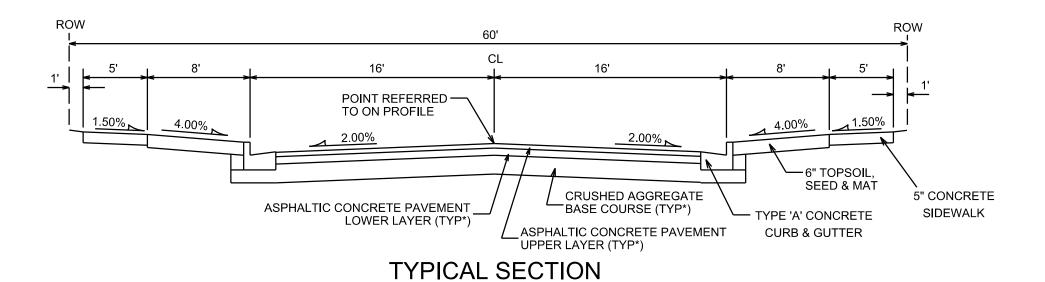


FIELD FLOWER WAY
NOT TO SCALE


NOTES:

* FIELD FLOWER WAY SHALL BE CONSTRUCTED AS TYPE 'A' PAVEMENT PER CITY OF MADISON MINIMUM PAVEMENT DESIGN

CITY OF MADISON MINIMUM PAVEMENT DESIGN

TYPE	CRUSHED AGG	. BASE COURSE	ASPHALTIC CONCRETE PAVEMENT			
	LOWER LAYER	UPPER LAYER	LOWER LAYER		UPPER LAYER	
	GRADATION 1	GRADATION 2	TYPE	THICKNESS	TYPE	THICKNESS
Α	6"	4"	E-0.3	1.75"	E-0.3	1.75"
В	6"	4"	E-1	2.25"	E-1	2"
С	6"	4"	E-3	3.25"	E-3	2"

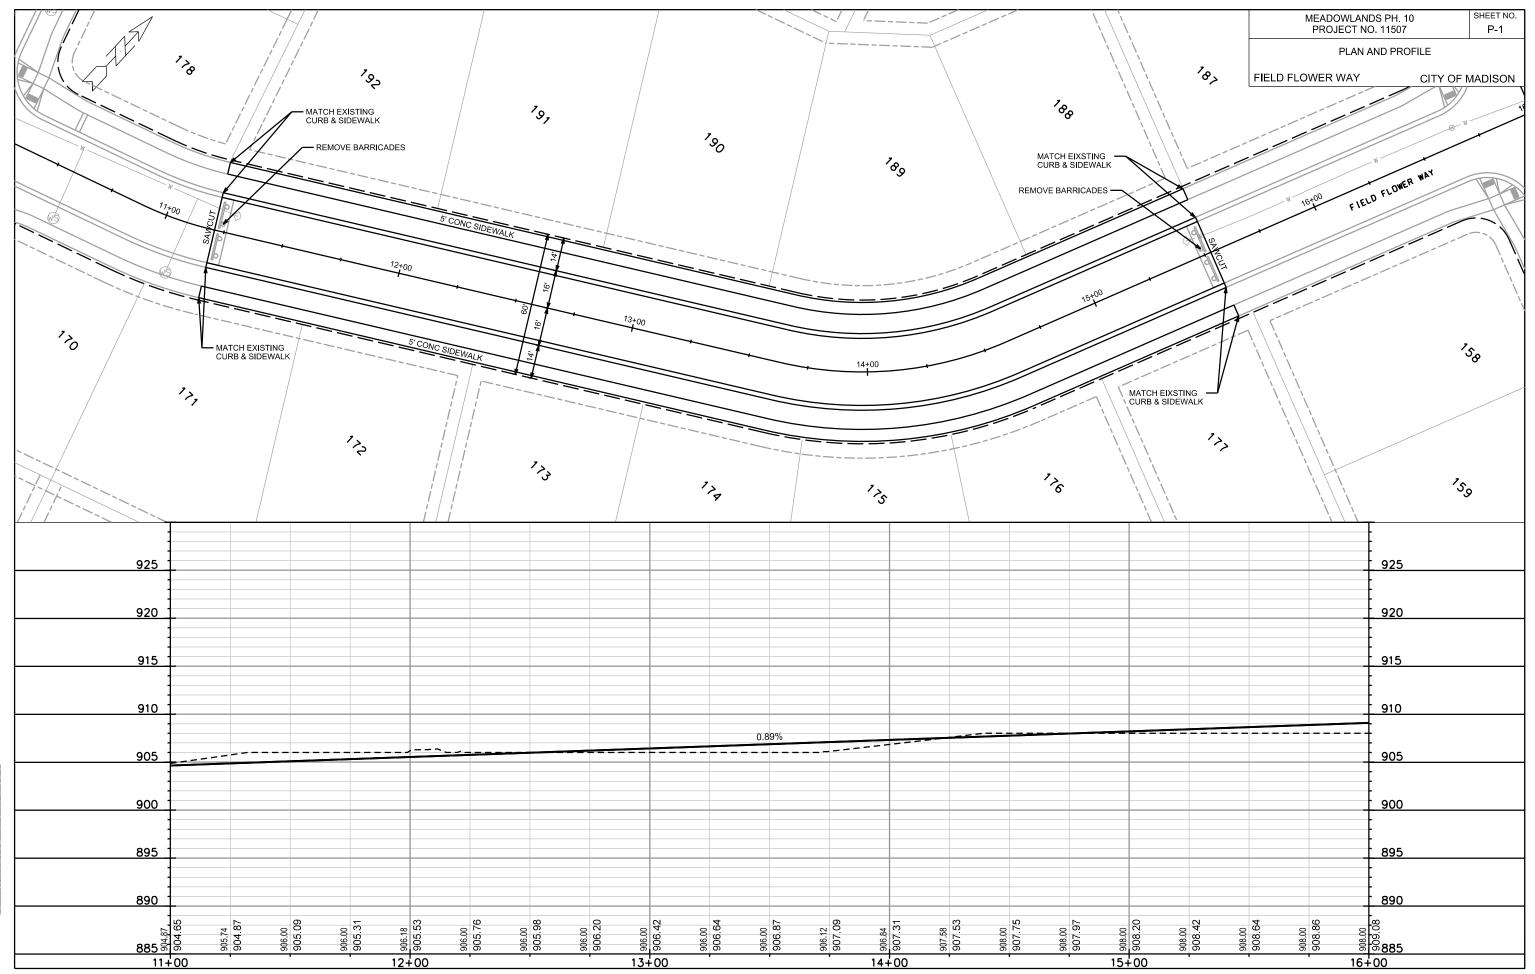

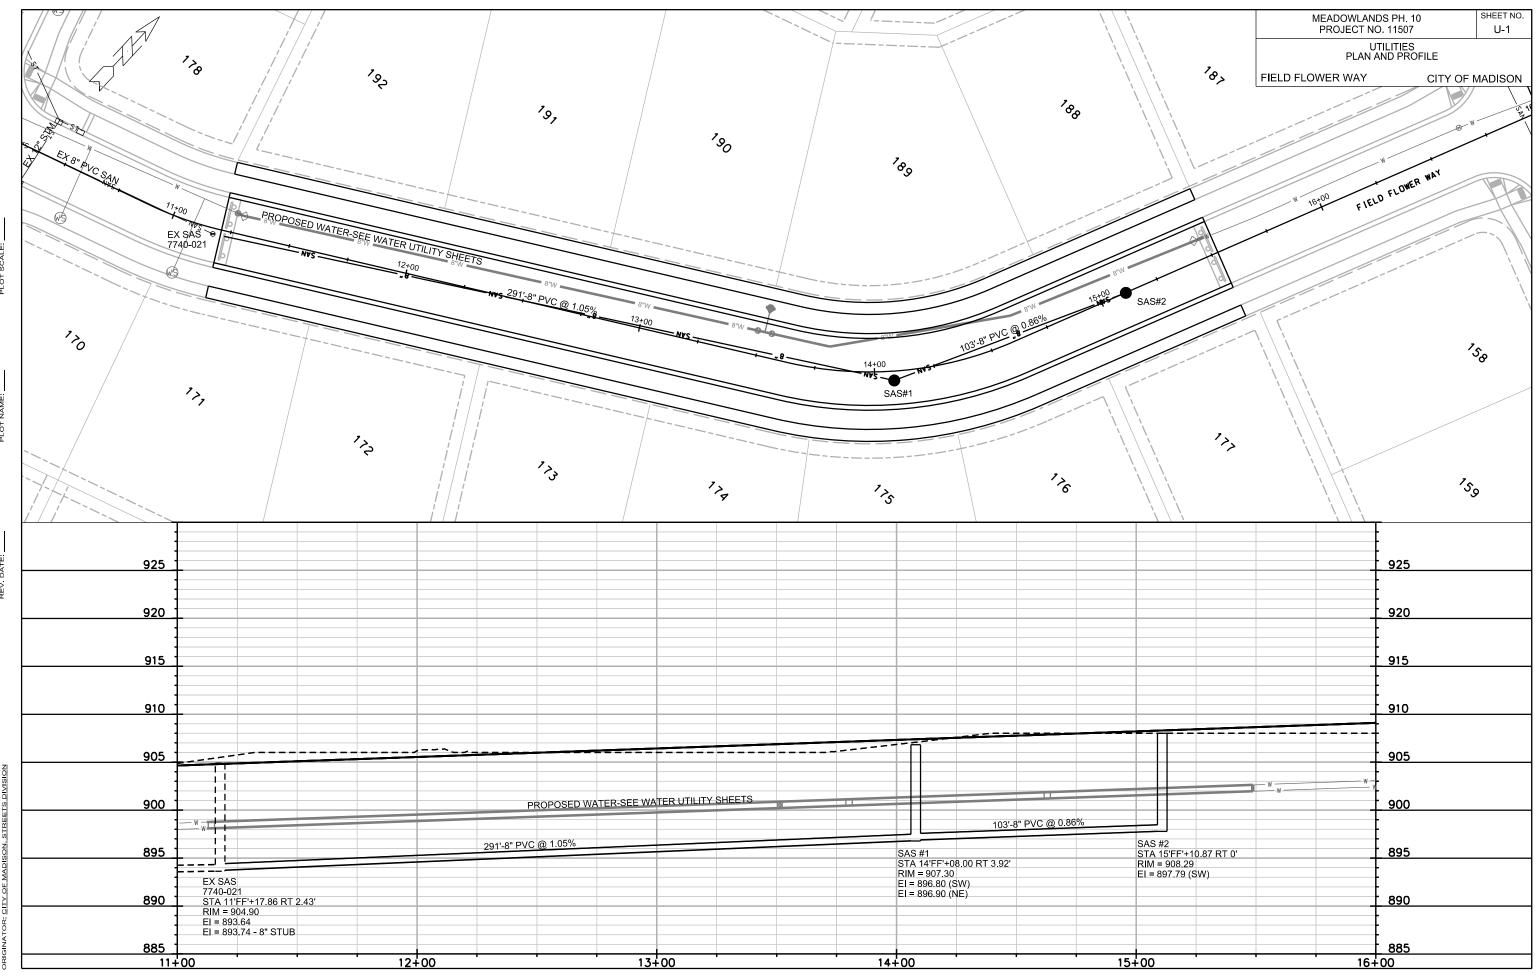

SANITARY SEWER SCHEDULE

CASTING

896.80

897.79

10.50

10.50

907.30

908.29

(OFFSET)

CL

14'FF'+08.00 RT-3.92

15'FF'+10.87

NO.

SAS#1

SAS#2

ALIGNMENT CODES:

'FF' = FIELD FLOWER WAY

THE MEADOWLANDS PH 10 PROJECT NO. 11507

U-2

SHEET NO


SANITARY SEWER SCHEDULE

CITY OF MADISON

PROPOSED SANITARY STRUCTURESSASSTATIONLOCATIONTOP OFE.I.DEPTHNOTES
PROPOSED SANITARY PIPES
FROM
TO

FROM DWNSTRM UPSTRM PLAN SLOPE PIPE PVC NOTES TO (DNSTM) (UPSTM) E.I. E.I. LGTH (FT) (%) SIZE TYPE EX SAS 7740-021 SAS#1 893.74 896.80 291 1.05% SDR-35 SAS#1 SAS#2 0.86% SDR-35 896.90 897.79 103 8"

M:\DESIGN\Projects\11507\Sanitary\Design\[Sewer Schedule Meadowlands Ph 10.xls]San Schedule

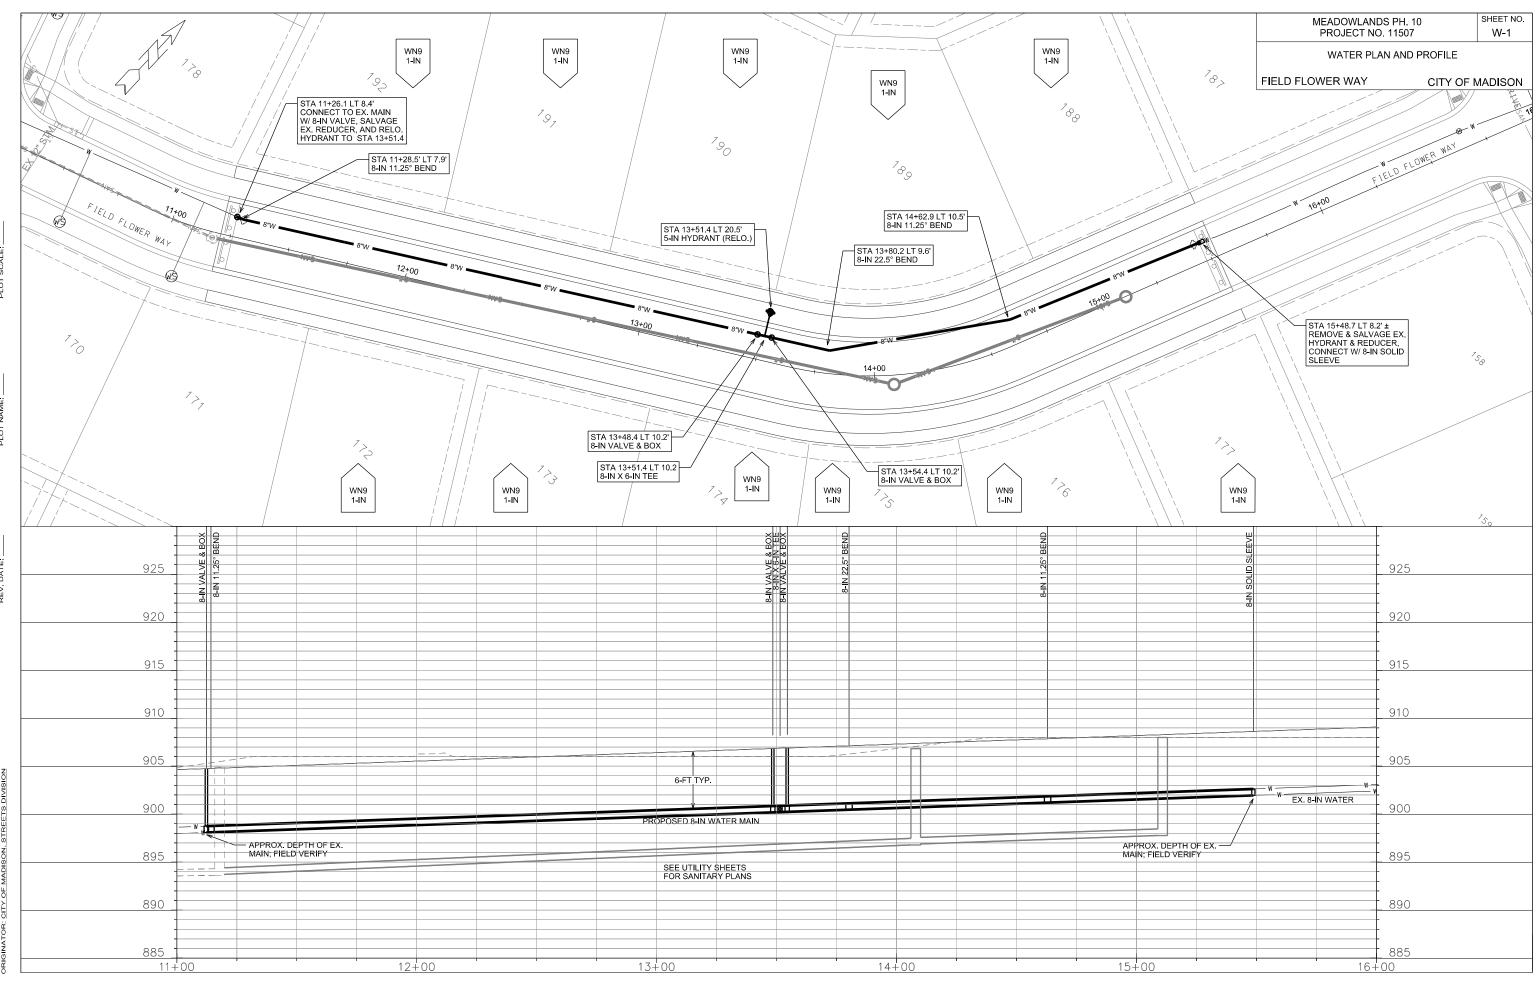

- 1. CONSTRUCT NEW WATER MAIN 6.0' BELOW FINISHED GRADE, UNLESS OTHERWISE NOTED. INSULATE MAIN WITH POLYSTYRENE BOARD AT UTILITY CROSSINGS OR OTHER AREAS IDENTIFIED BY ENGINEER AS HAVING INADEQUATE
- 2. VERIFY SIZE OF EXISTING WATER SERVICES AND RECONNECT SERVICES
- 3. MINIMIZE DISRUPTION OF SERVICE TO EXISTING CUSTOMERS. NOTIFY PER CONTRACT REQUIREMENTS OF ANY PLANNED WATER OUTAGE.
- 4. THE EXISTING UTILITIES SHOWN ON THIS PLAN REPRESENT THE BEST INFORMATION AVAILABLE TO THE WATER UTILITY AT THE TIME OF PLAN PREPARATION. CONTRACTOR IS RESPONSIBLE FOR HAVING EACH UTILITY LOCATED PRIOR TO COMMENCING WORK TO COMMENCING WORK.

- WN1 REPLACE THE EXISTING LEAD SERVICE WITH A NEW COPPER
- WN2 EXTEND AND RECONNECT THE EXISTING COPPER SERVICE TO THE NEW WATER MAIN.
- WN3 EXISTING SERVICE TO BE ABANDONED WHEN THE WATER MAIN IS CUT OFF.
- WN4 DISCONNECT FROM THE OLD WATER MAIN AND RECONNECT THE EXISTING COPPER WATER SERVICE LATERAL TO THE NEW
- WN5 RELOCATE THE EXISTING FIRE HYDRANT.
- WN6 ABANDON WATER VALVE ACCESS STRUCTURE.
- WN7 FURNISH AND INSTALL THE NEW TOP SECTION FOR THE WATER ACCESS STRUCTURE.
- WN8 ABANDON THE VALVE BOX.
- WN9 FURNISH THE DITCH, COMPACTION, AND ALL MATERIALS AND LABOR FOR THE INSTALLATION OF NEW SERVICE LATERAL.
- WN10 REMOVE AND SALVAGE EXISTING HYDRANT
- WN11 REPLACE THE EXISTING COPPER SERVICE WITH A COPPER
- WN20+ SEE WATER IMPACT PLAN FOR CONNECTION POINT ISOLATION AND WATER SHUT-OFF NOTFICATION INFORMATION.

ESTIMATE OF MATERIALS SUPPLIED BY CONTRACTOR:

ESTIMATE OF MATERIALS IS FOR INFORMATION ONLY. ENGINEER DOES NOT GUARANTEE ACCURACY OF MATERIAL TAKE-OFF.

20-FT - 6-IN PIPE 420-FT - 8-IN PIPE 3 - 8-IN VALVE & BOX 1 - 8-IN X 6-IN TEE

1 - 8-IN 22.5° BEND 2 - 8-IN 11.25° BEND

2-IN STYROFOAM INSULATION (AS REQ'D) 500-FT - POLY WRAP 1-IN & COPPER (AS REQ'D)

ESTIMATE OF MATERIALS SALVAGED:

- ESTIMATE OF MATERIALS IS FOR INFORMATION ONLY. ENGINEER DOES NOT GUARANTEE ACCURACY OF MATERIAL TAKE-OFF.
- 2 8-IN X 6-IN REDUCER
- 1 5-IN HYDRANT (RELOCATED)

TO OBTAIN LOCATION OF PARTICIPANTS' UNDERGROUND FACILITIES BEFORE YOU DIG IN WISCONSIN

CALL DIGGERS HOTLINE TOLL FREE 811 OR 1-800-242-8511 FAX-A-LOCATE 1-800-338-3860 TDD (FOR HEARING IMPAIRED) 1-800-542-2289

> WIS. STATUTE 182.0175 (1974) REQUIRES MIN. OF 3 WORK DAYS NOTICE BEFORE YOU EXCAVATE.



DISCLAIMER NOTE: UTILITY LOCATIONS SHOWN ARE APPROXIMATE ONLY. IT SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO DETERMINE THE EXACT HORIZONTAL AND VERTICAL LOCATION OF ALL EXISTING UNDERGROUND AND OVERHEAD UTILITIES PRIOR TO COMMENCING WORK.

MEADOWLANDS PH. 10 PROJECT NO. 11507

SHEET NO. W-2

WATER ESTIMATE OF MATERIALS

FIELD FLOWER WAY

CITY OF MADISON

