NOTES & DETAILS

SEWER SCHEDULE

ELECTRICAL PLAN CROSS SECTIONS

SEWERS PLAN

SHEET NO. MI-M2 PAVEMENT MARKING PLAN

STREET PLAN & PROFILES

INDEX OF SHEETS

SHEET NO. D1-D2

SHEET NO. 1

SHEET NO. PI

SHEET NO. UI

SHEET NO. EI

SHEET NO. XI-X2

STORM SEWER SANITARY SEWER


POWER POLE

WATER

CITY PROJECT NO. 53B2046 (MUNIS #10048) CONTRACT NO. 2046

CONVENTIONAL SIGNS FIELD VERIFY ALL UTILITY LOCATIONS OVERHEAD ELECTRIC

PROJECT **LOCATION**



ALL GUTTERS SHALL DRAIN WITH A MINIMUM GRADE OF 0.50% TOWARD STORM SEWER INLETS.


SIDEWALK RAMPS AND CURB THRU SIDEWALK RAMPS SHALL HAVE A MAXIMUM SLOPE OF 1" PER 12". SIDEWALK AND CURB RAMPS SHALL BE. CONSTRUCTED WITH A SIDE SLOPE OF 2.00%. SIDEWALK SHALL HAVE A MINIMUM LONGITUDINAL SLOPE OF 0.50% AND A MAXIMUM LONGITUDINAL SLOPE OF 5.00%


LAKE MONONA


PUBLIC IMPROVEMENT PROJECT APPROVED NOVEMBER 8, 2005


BY THE COMMON COUNCIL OF MADISON, WISCONSIN

PUBLIC IMPROVEMENT DESIGN APPROVED BY:











CONTRACTORDEVELOPER SHALL SUBMIT A TRAFFIC CONTROL PLAN
TO CITY TRAFFIC ENGINEERING AT LEAST 10 WORKING DAYS PRIOR
TO THE START OF WORK. WORK WITHIN THE RIGHT-OF-WAY SHALL
NOT BEGIN UNTIL THE TRAFFIC CONTROL PLAN IS APPROVED.

NO TREES IN THE RIGHT OF WAY OR ON PUBLIC LANDS SHALL BE TRIMMED, PRUNED, REMOVED OR ADVERSELY AFFECTED IN ANY WAY UNTIL THE DEVELOPER HAS RECEIVED WRITTEN PERMISSION FROM THE CITY ENGINEER OR CITY FORESTER. SAID WRITTEN PERMISSION SHALL INCLUDE LANGUAGE INDICATING THAT SECTION 10.101 OF THE MADISON GENERAL ORDINANCES AND ADMINISTRATIVE PROCEDURE MEMORANDUM NO. 6–2, REFERING TO NOTIFICATION OF PROPERTY OCCUPANTS AND/OR OWNERS, HAS BEEN COMPLIED WITH.

ALL PAVEMENT WITHIN THE RIGHT-OF-WAY SHALL BE TYPE C PAVEMENT.

ALL GUTTERS SHALL DRAIN WITH A MINIMUM GRADES OF 0.5% TOWARD STORM SEWER INLETS.

THE CROSS SLOPE OF SIDEWALKS AND BARRIER FREE SIDEWALK CURB
RAMPS SHALL BE 1.5%. THE LONGITUDINAL GRADE OF BARRIER
FREE SIDEWALK CURB RAMPS SHALL NOT EXCEED 8.33%. ALL SIDEWALK
RAMPS SHALL BE CONSTRUCTED ACCORDING TO S.D.D. 3.03. AT ALL
OTHER LOCATIONS THE LONGITUDINAL GRADE OF SIDEWALKS SHALL
NOT EXCEED 5.0 % OR THE ADJACENT STREET GRADE WHICHEVER
IS GREATER NOR BE LESS THAN 0.4% AND SHALL DRAIN TOWARD
STORM SEWER INLETS. SIDE SLOPES WITHIN TEN FEET OF A PUBLIC
SIDEWALK SHALL NOT EXCEED 4.00:1. ALL SIDEWALK AND SIDEWALK RAMP
ELEVATIONS AND GRADES SHALL BE FIELD VERIFIED AND SET TO COMPLY WITH
THE CITY OF MADISON STANDARD SPECIFICATIONS AND THE A.D.A. GUIDELINES.

OBTAIN A PRINT OUT OF THE ALIGNMENT FROM THE CITY ENGINEER PRIOR TO STAKING THIS PROJECT.

CURB STATION AND OFFSETS SHALL BE TO THE FACE OF CURB UNLESS OTHERWISE INDICATED. CURB ELEVATIONS SHALL BE TO THE TOP OF CURB (OR EXTENDED TOP OF CURB FOR DRIVEWAYS OR RAMPS) UNLESS OTHERWISE INDICATED.

POWER POLES AND OTHER OBSTRUCTIONS SHALL BE MOVED TO PROVIDE 2 FEET MINIMUM OF CLEAR DISTANCE FROM ANY FACE OF CURB OR EDGE OF SIDEWALK.

ANY INFORMATION SHOWN ON THIS PLAN, WHICH IS NOT PART OF THIS PROJECT, IS PRELIMINARY AND NOT FOR CONSTRUCTION.

THERE MAY BE EXISTING UTILITIES OR OTHER FEATURES WHICH ARE EITHER NOT SHOWN OR SHOWN INCORRECTLY ON THIS PLAN. IT IS THE RESPONSIBILITY OF THE DEVELOPER TO LOCATE AND IDENTIFY ALL UTILITIES AND TOPOGRAPHY WHICH MAY AFFECT THE CONSTRUCTION OF THESE IMPROVEMENTS.

ALL PERMANENT SIGNING AND POSTING WILL BE DETERMINED AND PROVIDED BY THE TRAFFIC ENGINEERING DIVISION, FOLLOWING CONSTRUCTION OF THESE IMPROVEMENTS.

THE DEVELOPER SHALL PROVIDE, INSTALL AND MAINTAIN ALL STREET END BARRICADES, SIGNING AND TRAFFIC CONTROL, AS REQUIRED BY THE CITY TRAFFIC ENGINEER.

PAVEMENT SAWCUTS SHALL BE AS DIRECTED BY THE CITY CONSTRUCTION ENGINEER. SAWCUTS SHOWN ON THE PLAN ARE APPROXIMATE.

DAMAGE TO ANY EXISTING CURB, PAVEMENT, SIDEWALK, ETC. THAT IS TO REMAIN SHALL BE REPAIRED BY THE DEVELOPER/CONTRACTOR AS DIRECTED BY THE ENGINEER.

KENNEDY POINT CDM (FIRST ST) PROJECT NO. 53B2046

D-1

SHEET NO.

DETAIL


STANDARD NOTES AND COMMENTS


CITY OF MADISON

LOT NAME:


EV. DATE:


OF MADISON, STREETS DIVISION

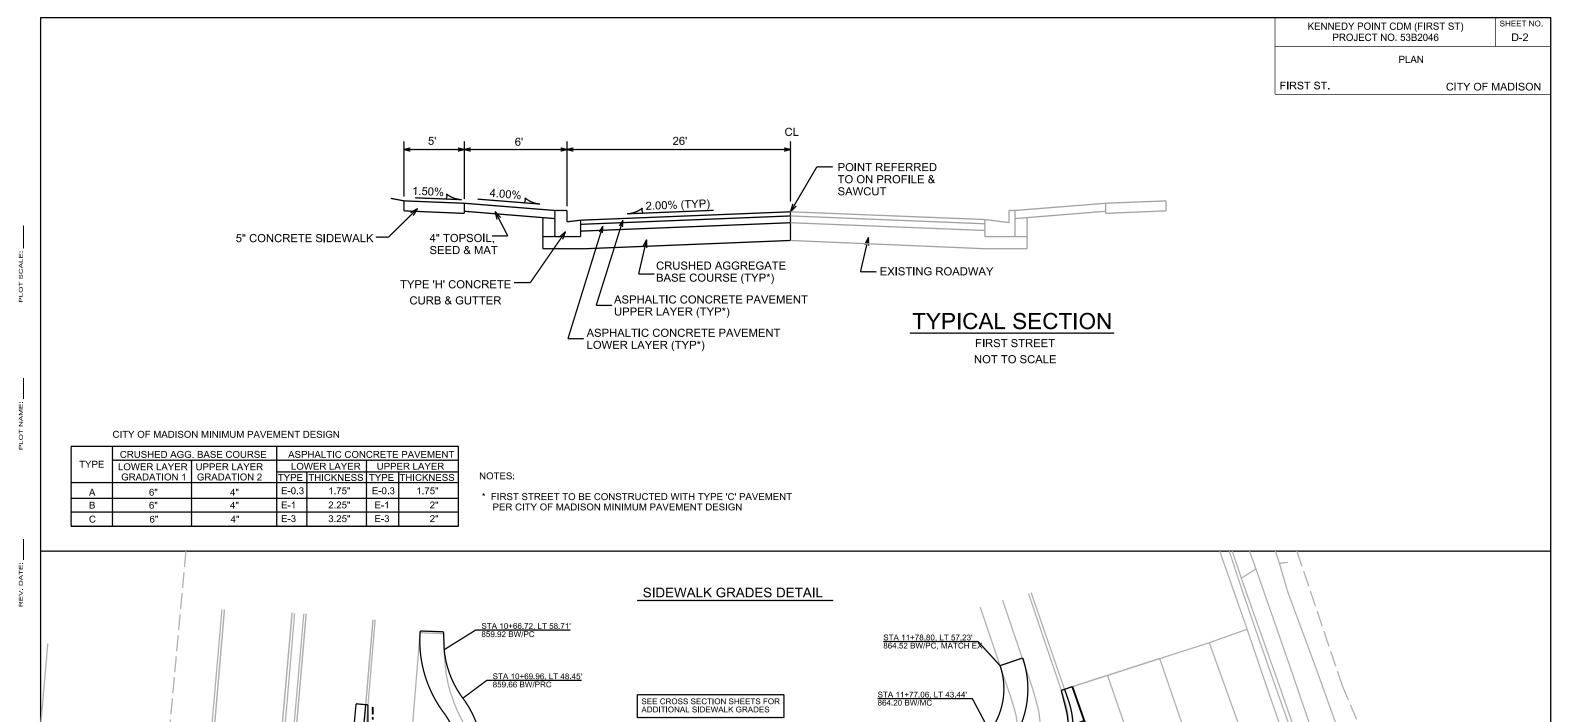


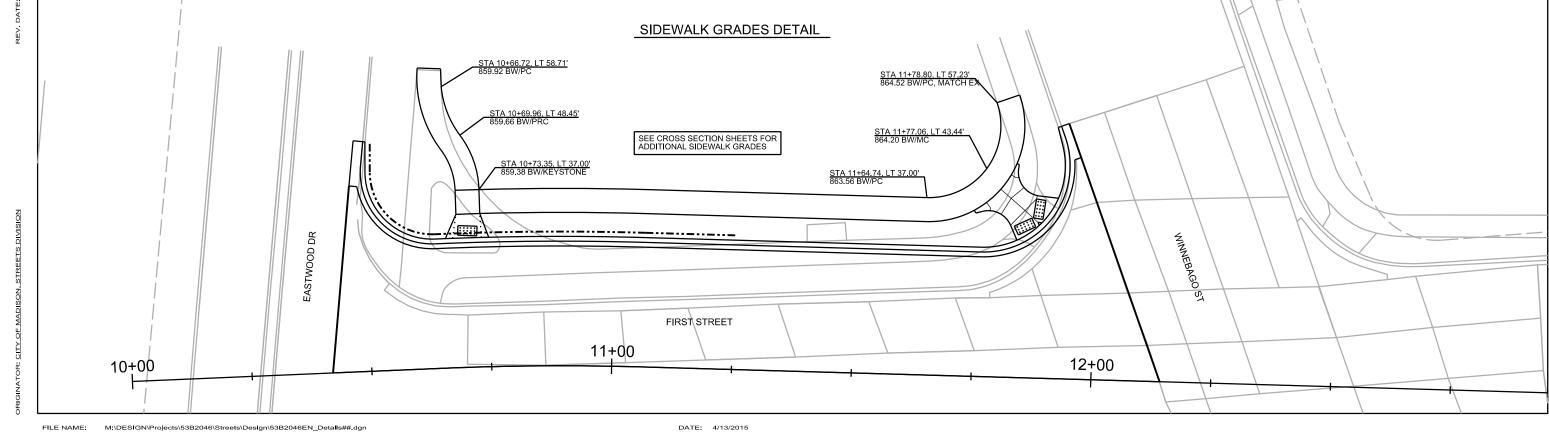


FILE NAME:

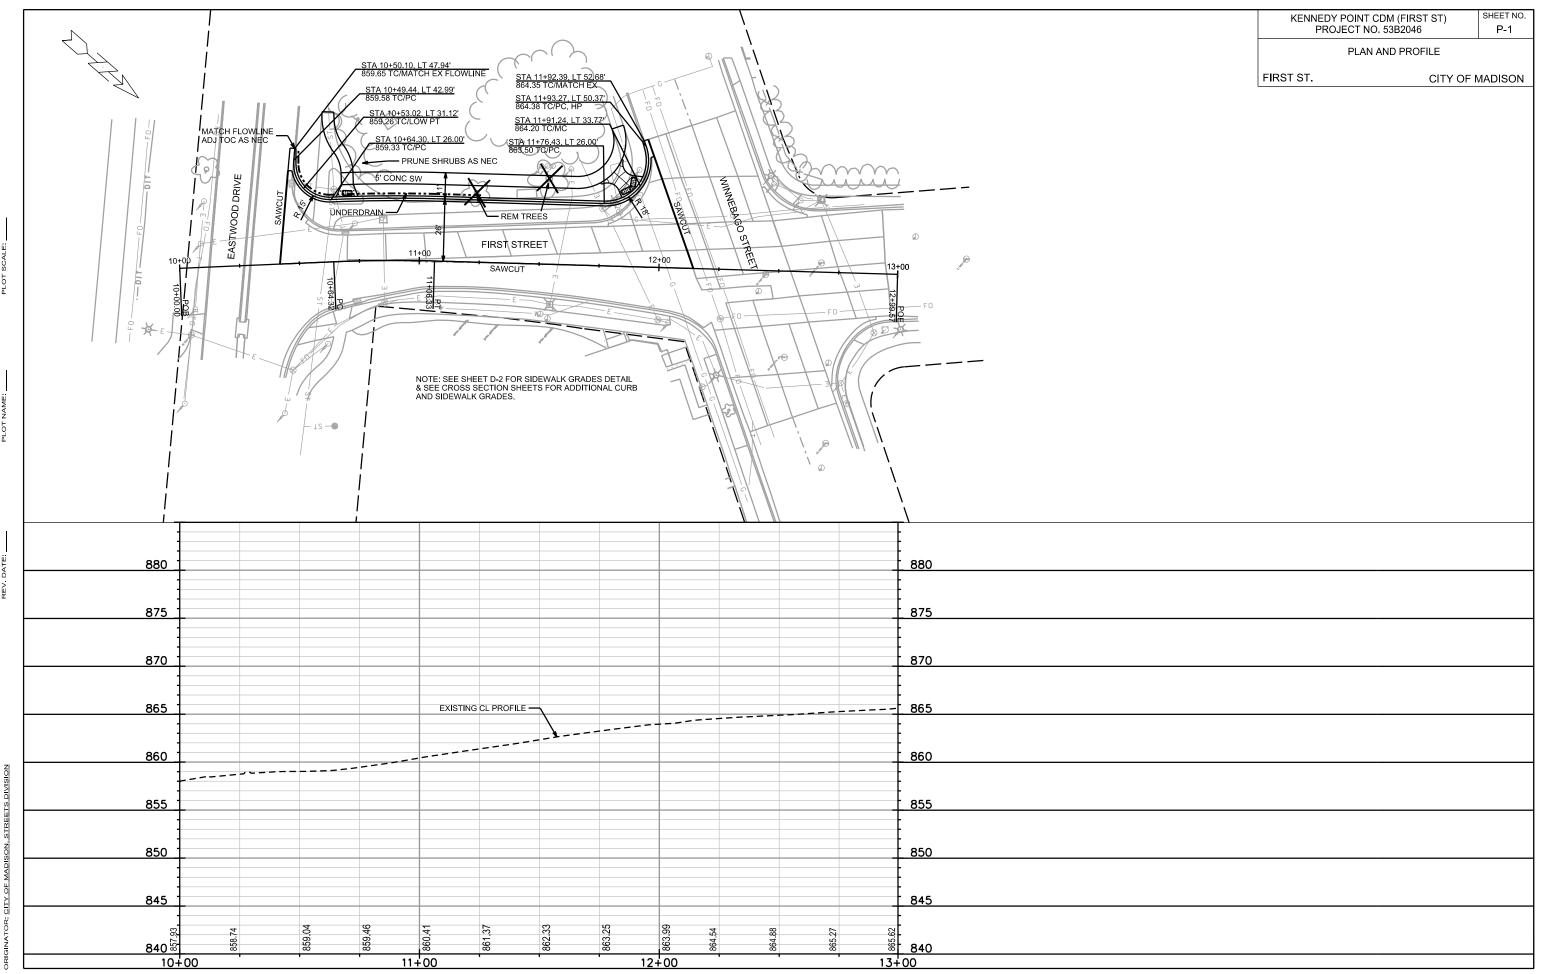

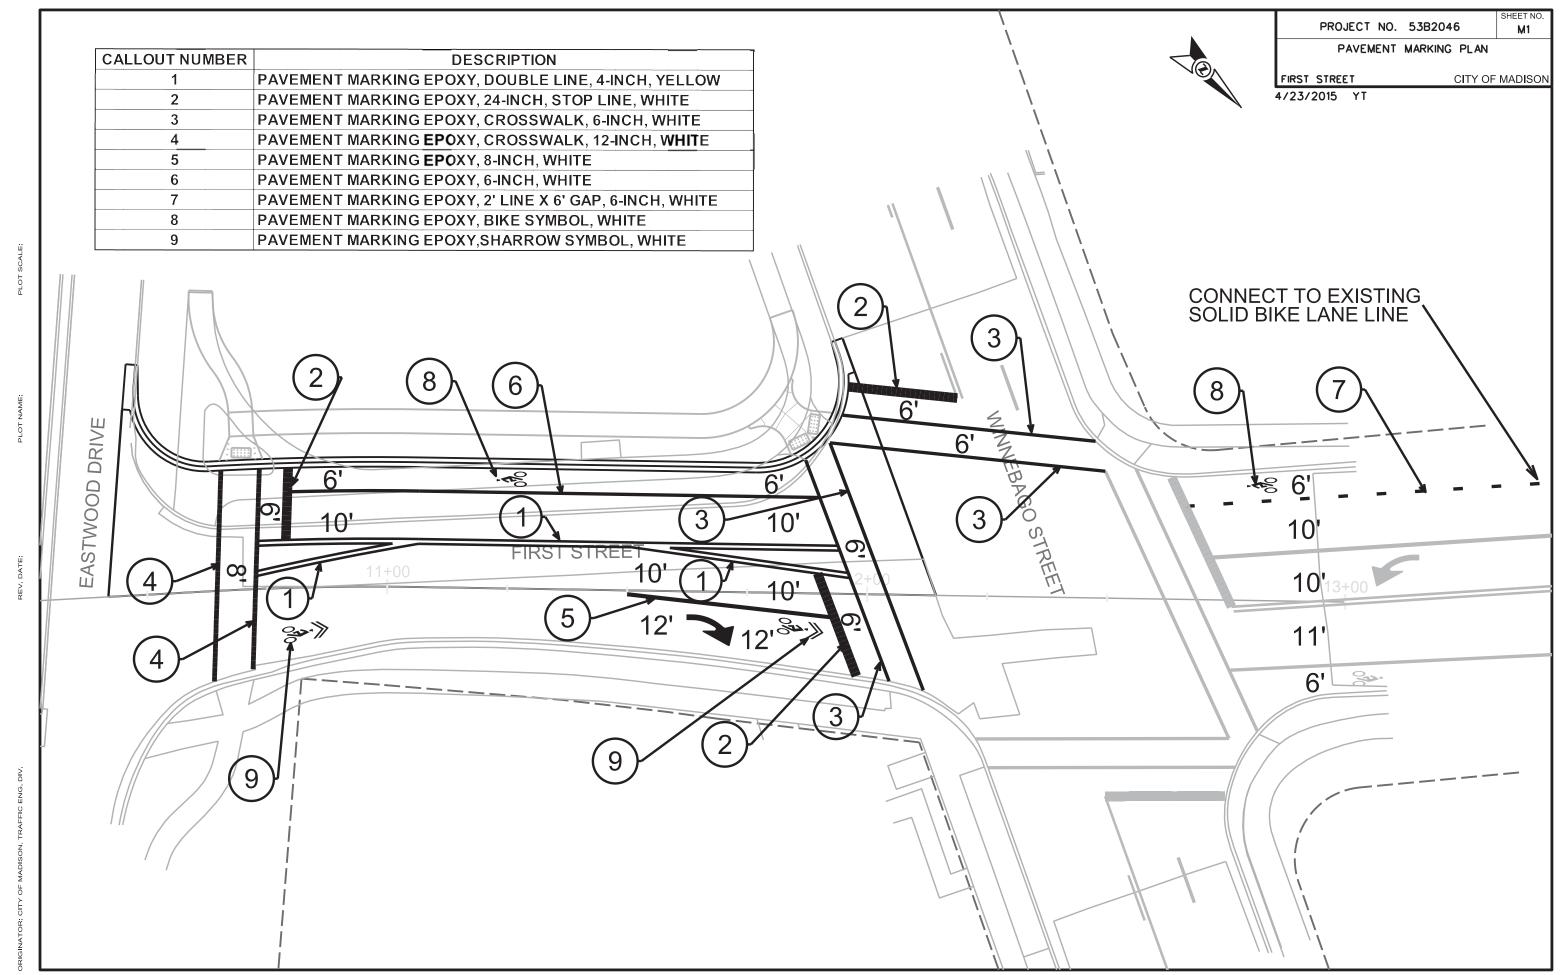

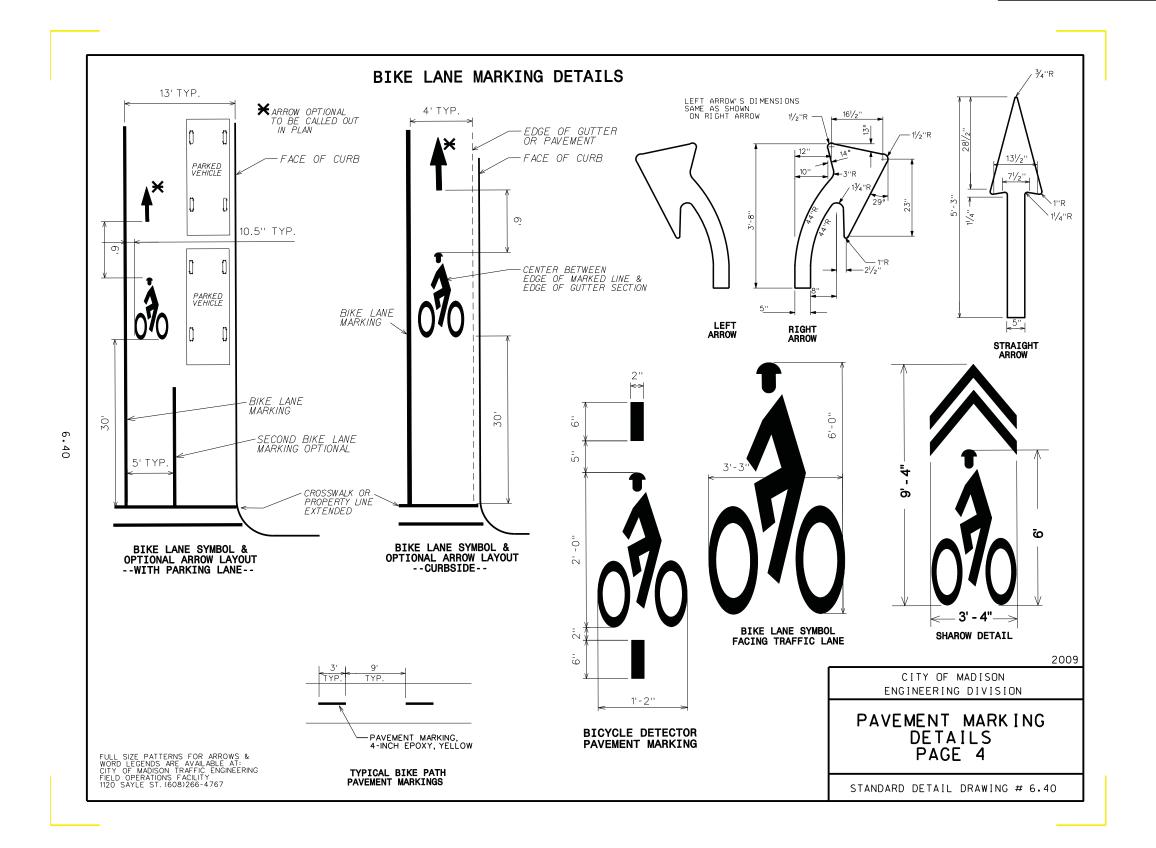

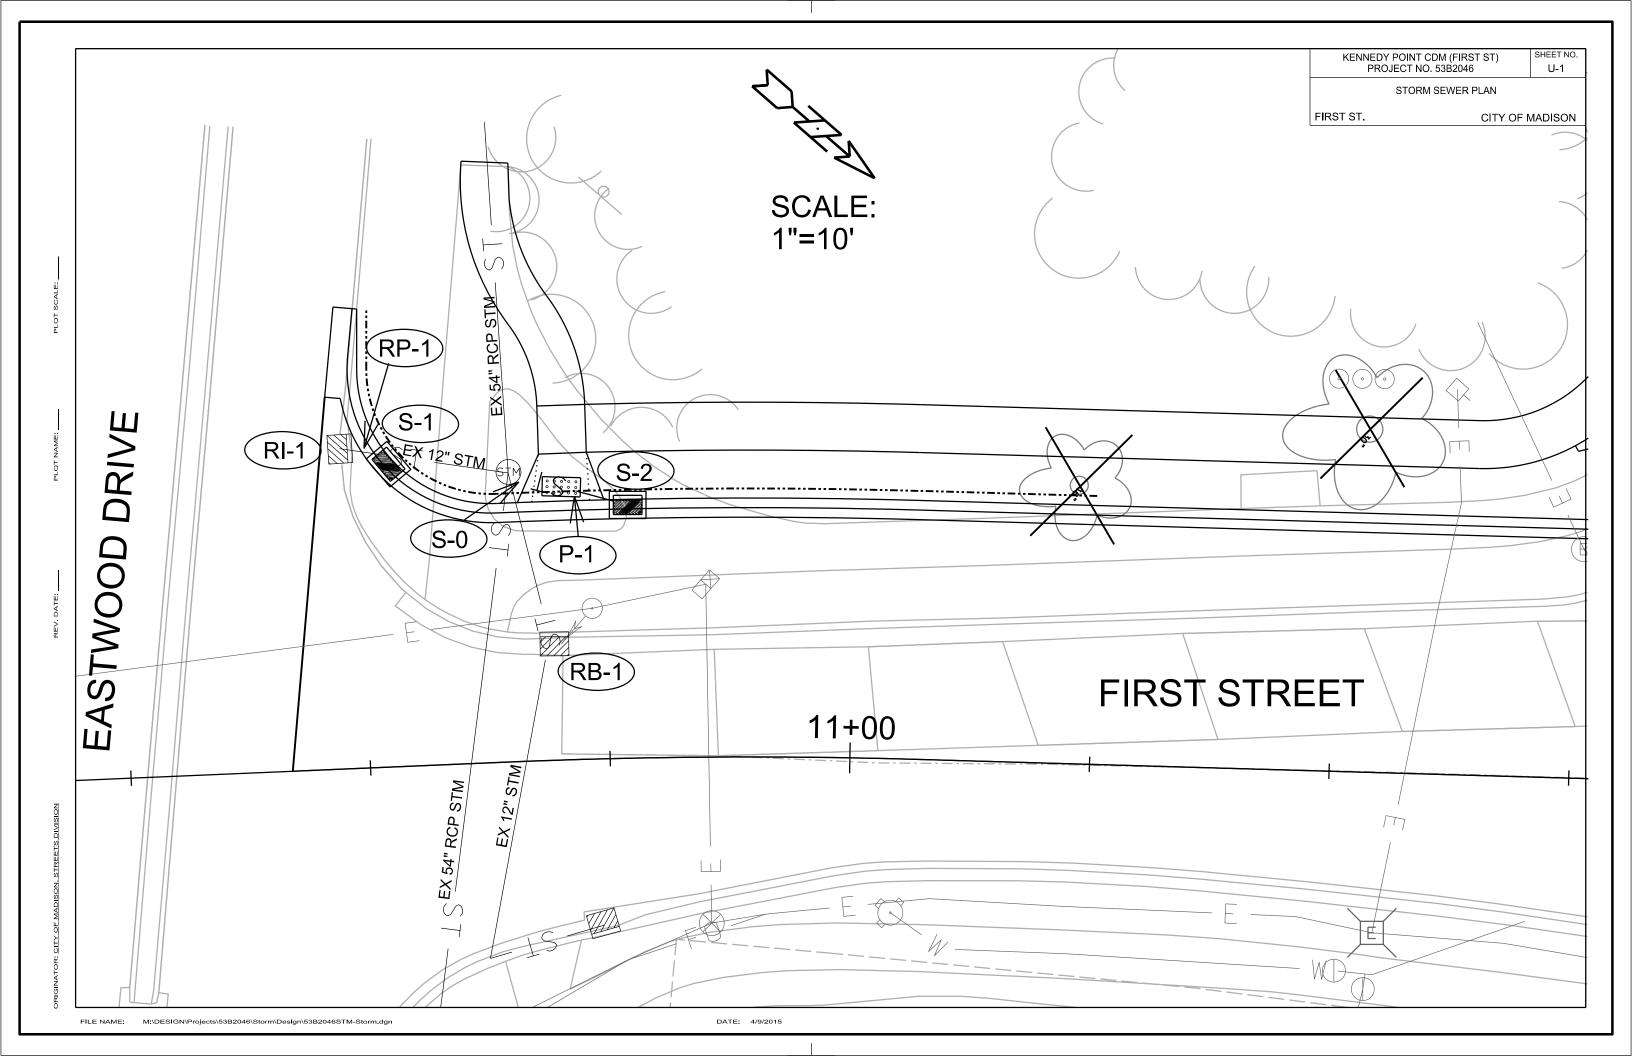

STRUCTURES	S.	TF	₹U	C.	ΤŪ	R	ES
------------	----	----	----	----	----	---	----

STRUC. NO.	STATION	LOCATION (OFFSET)	TYPE	TOP OF CASTING	E.I.	DEPT	H NOTES
S-0	10+65.39	LT-29.91	STM TAP	-	855.86	-	EX AS 5643-013
S-1	10+53.02	LT-31.12	H INLET	859.26	855.50	3.76	(1); LP; FP; W/ R-3067-7004-VB
S-2	10+77.37	LT-26.42	H INLET	859.82	856.22	3.60	W/ R-3067-7004-V

PIPES

PIPE NO.	FROI (DNS	_	PLAN M) LGTH (F	PIPE T) LGTH (FT)	DISCH. E.I.	INLET E.I.	SLOPE (%)	PIPE SIZE	TYPE	NOTES
P-1	S-0	S-2	13	9.00	855.86	856.22	3.87%	12"	RCP	-

REBUILD STORM STRUCTURE

STRUC. NO.	ID NO.	STATION	LOCATION (OFFSET)	TYPE	NOTES
RB-1	IN 5643-016	10+70.00	LT-12.75	H INLET	(2)

STORM STRUCTURE REMOVALS

STRUC. NO.	ID NO.	STATION	LOCATION (OFFSET)	TYPE	NOTES
RI-1	IN 5643-015	10+48 65	LT-33 00	H INI ET	_

STORM PIPE REMOVALS

PIPE REMOVAL NO.	REMOVE FROM	REMOVE TO	LENGTH (FT)	PAID (Y/N)	SIZE	TYPE	NOTES
RP-1	RI-1	S-1	4	N	12"	RCP	-

STANDARD NOTES:

DATE: 04/09/2015

- ABBREVIATIONS: AE = APRON ENDWALL; RCP = REINFORCED CONCRETE PIPE; HERCP = HORIZONTAL ELLIPTICAL REINFORCED CONCRETE PIPE; DNA = DOES NOT APPLY; SAS = SEWER ACCESS STRUCTURE; LP = LOW POINT INLET STRUCTURE; FP = FIELD POURED STRUCTURE; TR = TOP OF CONCRETE ROOF; NCM = NO CROWN MATCH FOR PIPES

- APPROXIMATE DISCHARGE E.I. GIVEN, ADJUST E.I. AND PIPE SLOPE IN THE FIELD.
- TOP OF CASTING GRADE GIVEN IS THE TOP OF CURB FOR INLET STRUCTURES AND THE FLOWLINE OF THE CLOSED CASTING FOR SAS's.
- TOP OF CONCRETE ROOF (TR) IS 1.25' BELOW TOP OF CASTING UNLESS OTHERWISE NOTED.
- ALL REINFORCED CONCRETE PIPES TO BE CLASS III UNLESS OTHERWISE NOTED.
- SURVEYOR TO CONFIRM THAT ALL INLET STATION / OFFSETS LINE UP WITH PROPOSED CURB AND GUTTER.
- ALL STRUCTURES CALLED OUT AS FIELD POURED SHALL BE FIELD POURED. ALL OTHER STRUCTURES (NOT INDICATED AS FIELD POURED) SHALL BE SUBMITTED TO CITY ENGINEERING FOR APPROVAL IF PRECAST STRUCTURES ARE PREFERRED. CONTACT ELIA E. ACOSTA OF CITY ENGINEERING AT (608) 266-4096 FOR PRECAST APPROVALS, OR FAX SHOP DRAWINGS TO (608)264-9275.

SPECIFIC NOTES

(1) RECONNECT EXISTING 12" STM PIPE TO NORTH; FIELD VERIFY

(2) REMOVE THE EXISTING ROOF AND ANY ADJUSTMENT FROM THE EXISTING INLET. LOWER THE WALLS UP TO 12 INCHES. CONSTRUCT A NEW ROOF TO ACCOMMODATE A NEW R-1550-0054 CASTING. INSTALL NEW CASTING TO THE PROPOSED GRADE. THE NEW ROOF SHALL BE CONSTRUCTED TO BE IN COMPLIANCE WITH THE ROOF DETAIL FOR SEWER ACCESS STRUCTURES IN THE CITY OF MADISON STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION.

