



Madison Water Utility 2021 PFOA+PFOS Results

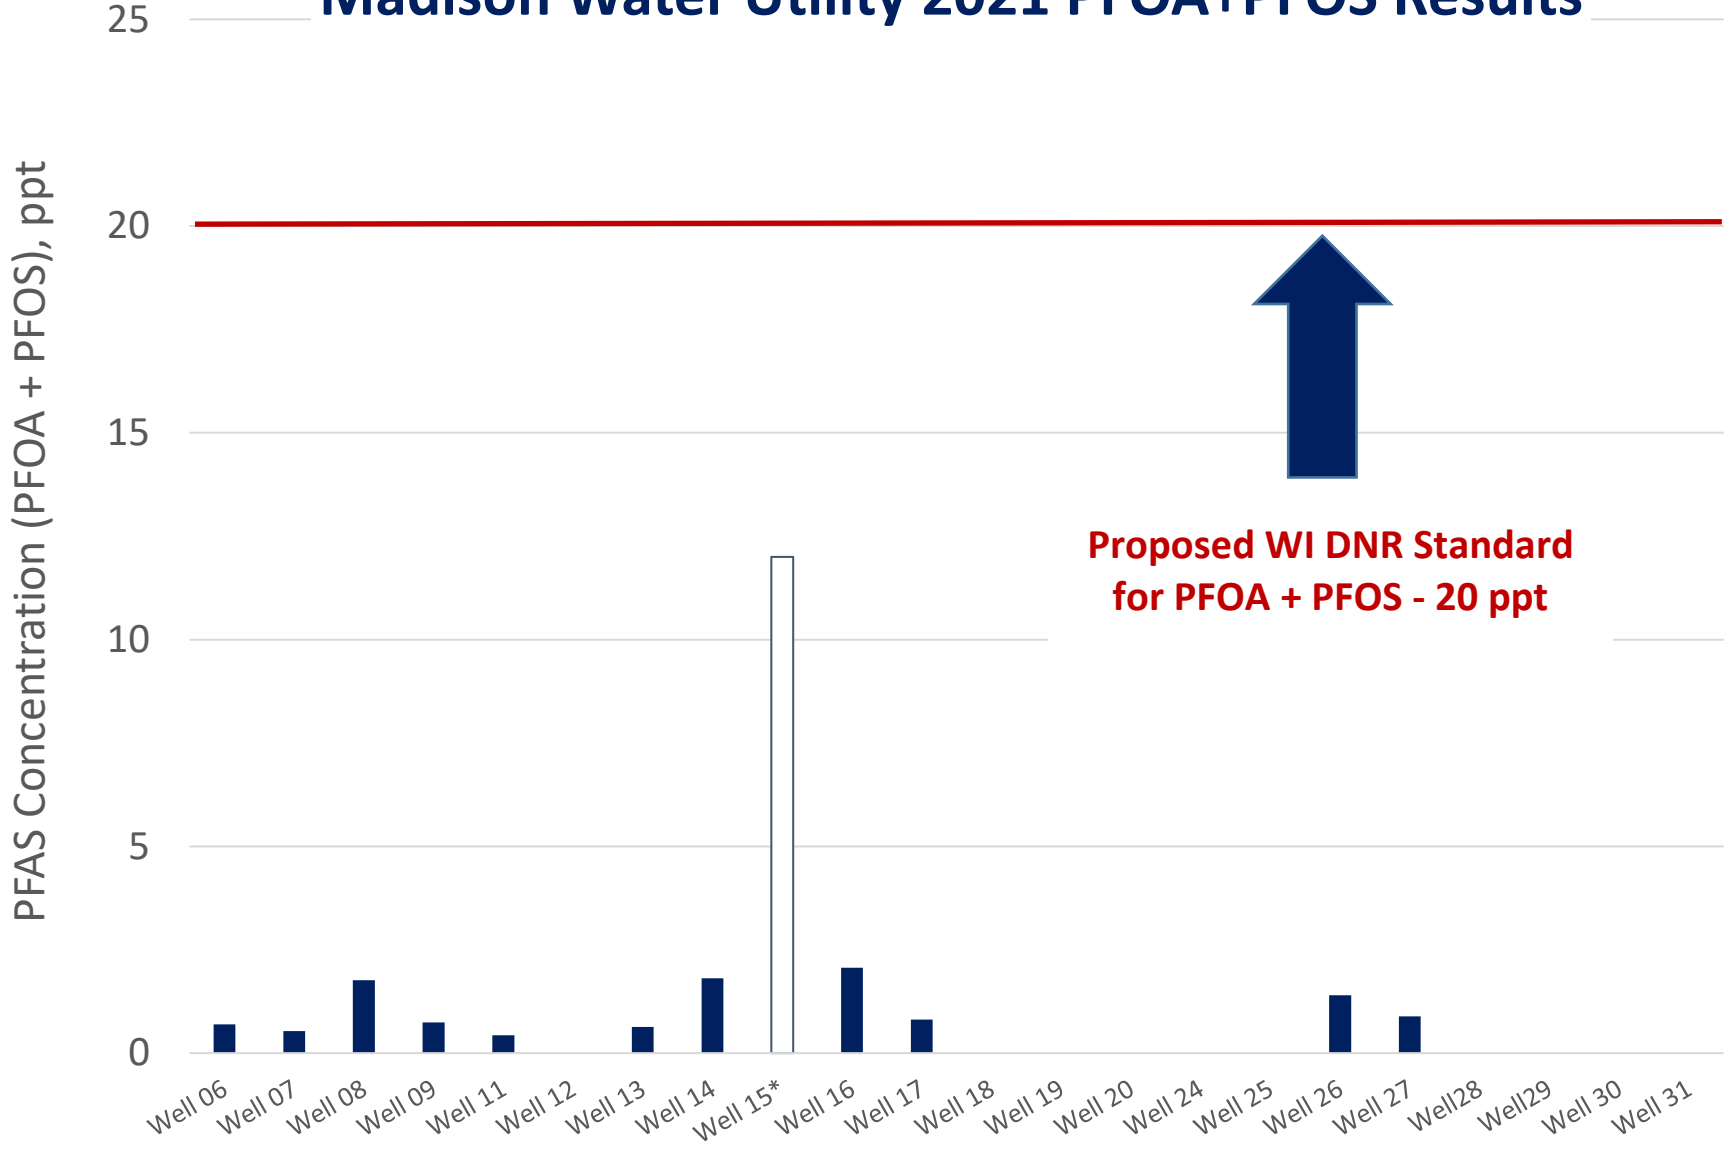

**Proposed WI DNR Standard
for PFOA + PFOS - 20 ppt**

* Currently shut down / out of service (data from 2019)

Madison Water Utility 2020 PFOA+PFOS Results

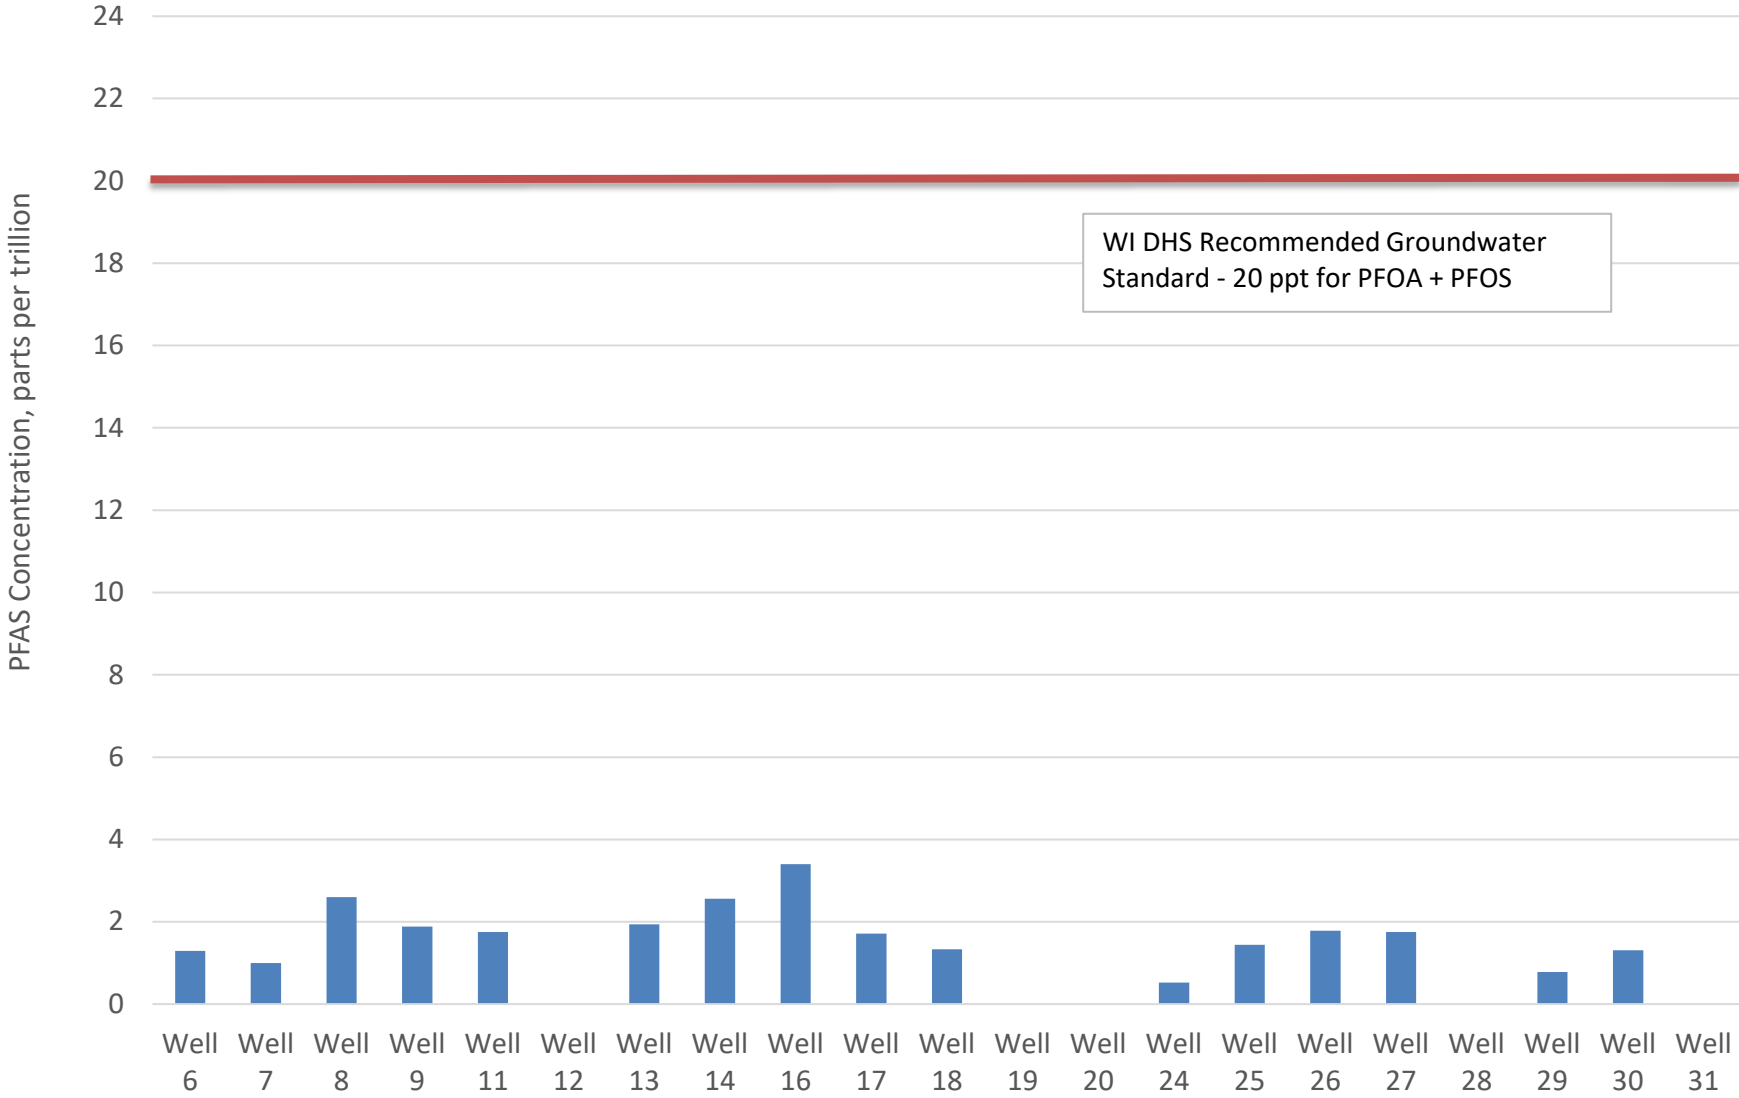

WI DHS Recommended Groundwater Standard - 20 ppt for PFOA + PFOS